
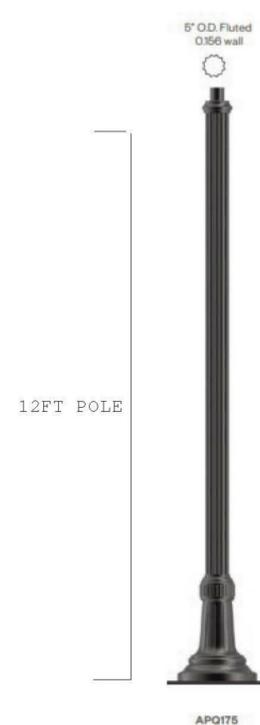


NOTES

- Contractor shall provide 120V/15A service from existing power pole on Cottage Street to secure underground meter box then to 3 light poles via 2" conduit buried a minimum of 24 inches and marked with underground detectable/metal core tape.
- Light post to be installed on concrete pedestal with anchor bolts according to manufacturer's recommendations.

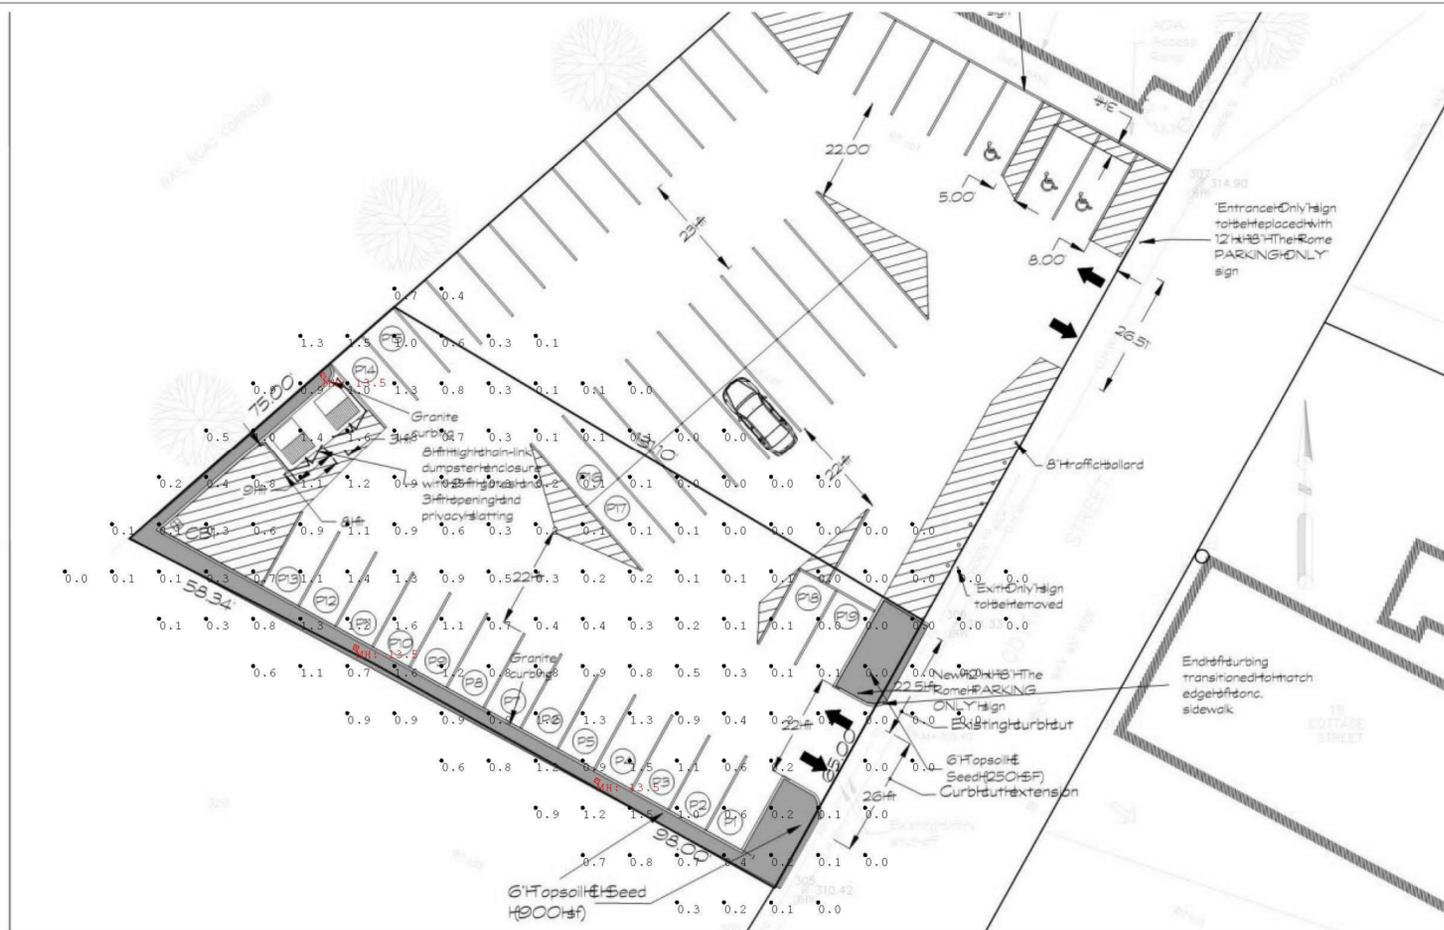

**EXPOSURE**  
LIGHTING — CONTROLS — ELECTRICAL

#	Date	Comments

#	Date	Comments

Drawn By: CL  
Checked By: Date: 9/5/2024  
Scale: NTS

Colace Rome Parking Lot  
Franklin, MA

Symbol	Qty	Label	Arrangement	Description	[MANUFAC]	Tag
☐	3	Luminaire	Single	D771-PC-CL-AVI-G3-AS-40-P2-CLB-PCL	Amerlux, LLC	Mounted on a 12ft pole

Ching Ling  
Exposure Lighting  
cling@exposure2lighting.com  
(401)523-9623

PHOTOMETRIC PLAN  
NTS

SPECIAL PERMIT & SITE PLAN APPROVAL  
REQUIRED  
FRANKLIN PLANNING BOARD

DATE \_\_\_\_\_

REVISIONS		
2	9/12/24	Light fixture changed to Amerlux D771 (almost identical photometric plan).
1	5/9/24	New plg layout Lots 217 & 17; Luminaire height changed to 13.5 ft.

PREPARED BY:  
**Dunbar**  
ENGINEERING & MANAGEMENT  
stevedunbar@dunbarem.com (774) 737-4301

**PHOTOMETRIC PLAN**  
PROPOSED PARKING LOT  
19 Cottage Street  
FOR  
James A. Colace/Abbruzzi Realty Trust  
55 Court Street  
Franklin, MA 02038

DATE: March 15, 2024  
DRAWN BY: S. Dunbar  
PLAN NO: 24-04