

SITE PLAN

100 AND 110 EAST CENTRAL STREET



LOCUS MAP
SCALE: 1" = 100'

- ALL EROSION CONTROL MITIGATION MEASURES SHALL BE IN PLACE PRIOR TO MAJOR CONSTRUCTION OR SOIL DISTURBANCE COMMENCING ON THE SITE.

WAIVER REQUESTS:
 1. TO ALLOW THE USE OF PVC AND HPDE PIPE FOR THE ROOF DRAINS AND UNDERGROUND STORMWATER STORAGE AREA.
 2. TO ALLOW SITE LIGHTING TO EXTEND PAST THE PROPERTY LINE.

THE 100 AND 110 EAST CENTRAL STREET PROPERTIES ARE LOCATED WITHIN A COMMERCIAL 1 ZONE.

	REQUIREMENTS: 5,000 S.F.	EXISTING 56,329± S.F.	PROPOSED 56,329± S.F.
FRONTAGE:	50'	245.1'	245.1'
DEPTH:	50'	293.7'	293.7'
HEIGHT:	3 STORIES - 40' *15	2 STORIES	3 STORIES < 40' **
WIDTH:	45'	> 45'	> 45'
SETBACKS			
FRONT:	20' *1	31.3'	20.5'
SIDE WEST:	10' *14	15.0'	15.0'
SIDE EAST:	10' *14	14.7'	10.4'
REAR:	15'	114.5'	120.4'
COVERAGE			
STRUCTURES:	80%	11.7%	18.2%
STRUC. & PAVING:	90%	34.1%	64.9%

LOT COVERAGE BASED ON UPLAND AREA.

**REFER TO ARCHITECTURAL PLANS FOR BUILDING HEIGHT.

*1 - BUT NO NEW STRUCTURE SHALL BE REQUIRED TO PROVIDE A DEEPER YARD THAN EXISTED ON THAT PARCEL UPON ADOPTION OF THIS AMENDMENT.

*14 - THE 10-FOOT SIDE SETBACK IS ONLY REQUIRED ON ONE SIDE OF THE LOT; IF LOT ADJUTS A RESIDENTIAL DISTRICT, A 20-FOOT SETBACK IS REQUIRED ON THE ADJUTING SIDE.

*15 - BUILDINGS UP TO 50 FEET IN HEIGHT, REGARDLESS OF THE NUMBER OF STORIES, MAY BE PERMITTED BY A SPECIAL PERMIT FROM THE PLANNING BOARD.

REQUIREMENTS FOR 100 AND 110 EAST CENTRAL STREET ZONE COMMERCIAL 1 EXISTING AND PROPOSED LOT AREA, FRONTAGE, DEPTH, WIDTH AND COVERAGE BASED ON THE LOTS BEING COMBINED.

BUILDING HEIGHT, AND SETBACKS BASED ON EXISTING AND PROPOSED BUILDINGS LOCATED ON 100 AND 110 EAST CENTRAL STREET.
 PROPERTY IS NOT LOCATED WITHIN A FRANKLIN WATER RESOURCE DISTRICT.
 THE PROPERTY IS LOCATED IN A ZONE C BASED ON FEMA FIRM MAP 25021C0309E DATED JULY 17, 2012.

100 EAST CENTRAL STREET

	REQUIREMENTS: 5,000 S.F.	EXISTING 33,061± S.F.	PROPOSED 33,061± S.F.
FRONTAGE:	50'	109.78'	109.78'
DEPTH:	50'	278.1'	278.1'
HEIGHT:	3 STORIES - 40' *15	2 STORIES	2 STORIES < 40' **
WIDTH:	45'	> 45'	> 45'
SETBACKS			
FRONT:	20' *1	70.8'	70.6'
SIDE WEST:	10' *14	15.0'	15.0'
SIDE EAST:	10' *14	15.2'	15.2'
REAR:	15'	127.8'	127.8'
COVERAGE			
STRUCTURES:	80%	13.3%	13.3%
STRUC. & PAVING:	90%	66.1%	71.8%

LOT COVERAGE BASED ON UPLAND AREA.

110 EAST CENTRAL STREET

	REQUIREMENTS: 5,000 S.F.	EXISTING 22,268± S.F.	PROPOSED 22,268± S.F.
FRONTAGE:	50'	135.32'	135.32'
DEPTH:	50'	220.9'	220.9'
HEIGHT:	3 STORIES - 40' *15	2 STORIES	3 STORIES < 40' **
WIDTH:	45'	> 45'	> 45'
SETBACKS			
FRONT:	20' *1	29.4'	20.5'
SIDE WEST:	10' *14	62.0'	14.4'
SIDE EAST:	10' *14	14.7'	10.4'
REAR:	15'	85.1'	120.4'
COVERAGE			
STRUCTURES:	80%	9.1%	25.7%
STRUC. & PAVING:	90%	14.7%	56.0%

LOT COVERAGE BASED ON UPLAND AREA.

DRAWING INDEX

1. COVER SHEET
2. EXISTING CONDITIONS PLAN
3. SITE LAYOUT PLAN
4. SITE GRADING AND UTILITY PLAN
5. PLANTING PLAN
6. EROSION CONTROL PLAN
7. CONSTRUCTION DETAILS - 1
8. CONSTRUCTION DETAILS - 2
9. CONSTRUCTION DETAILS - 3
10. CONSTRUCTION DETAILS - 4
- SITE LIGHTING LIGHTING PLAN, PHOTOMETRICS AND SCHEDULES BY SK & ASSOCIATES

REFERENCES:
 ASSESSORS MAP 286 PARCELS 30 AND 31
 DEED BOOK 38897 PAGE 557
 CERTIFICATE NUMBER 209218

PLAN 19290B
 PLAN IN BOOK 1091 PAGE 108
 PLAN 3334 OF 1913

OWNERS:
 100 EAST CENTRAL STREET RE, LLC
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS


APPLICANT:
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS

SITE PLAN
COVER SHEET
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'


SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

DATE

GRAPHIC SCALE

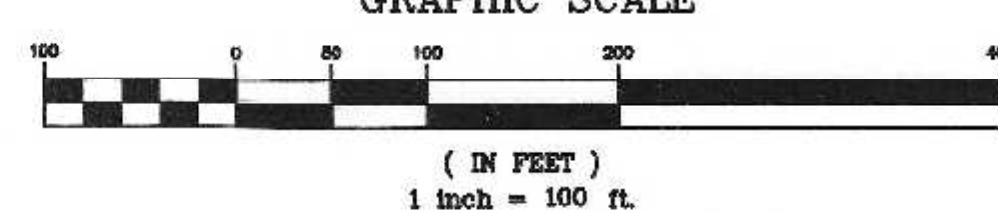



NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

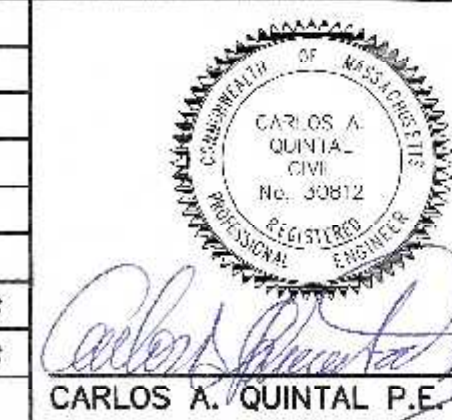

DATE	FIELD BY:	INT.
7/23	BL	BL
BK#	FIELD BOOK	PG#
1/24	RRG	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-384-6560 FAX 508-384-6566

DATE
JAN. 5, 2024
SCALE
1" = 100'
PROJECT
UC1587
SHEET
1 of 10

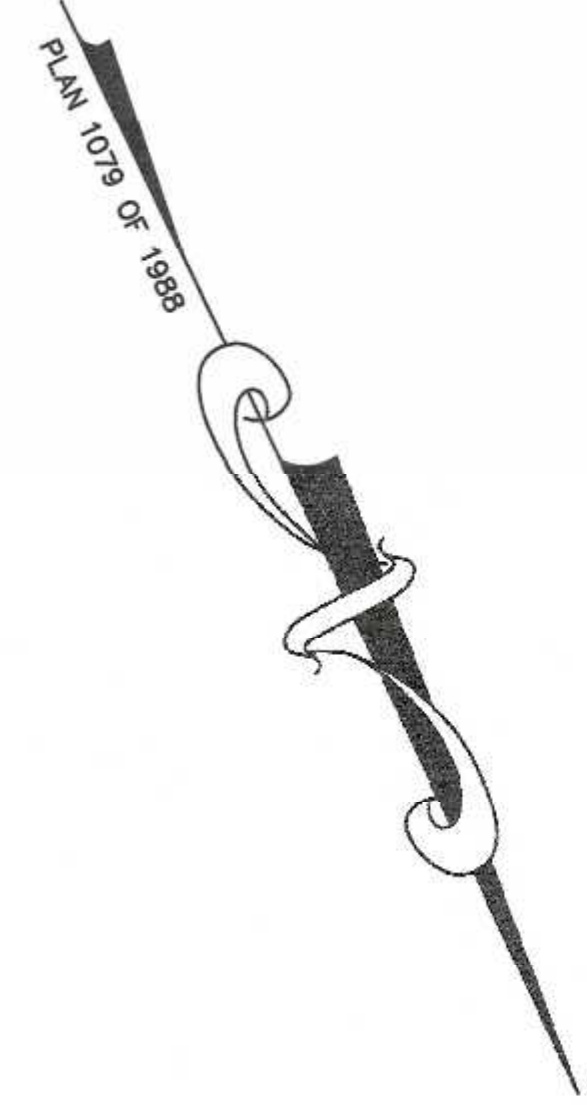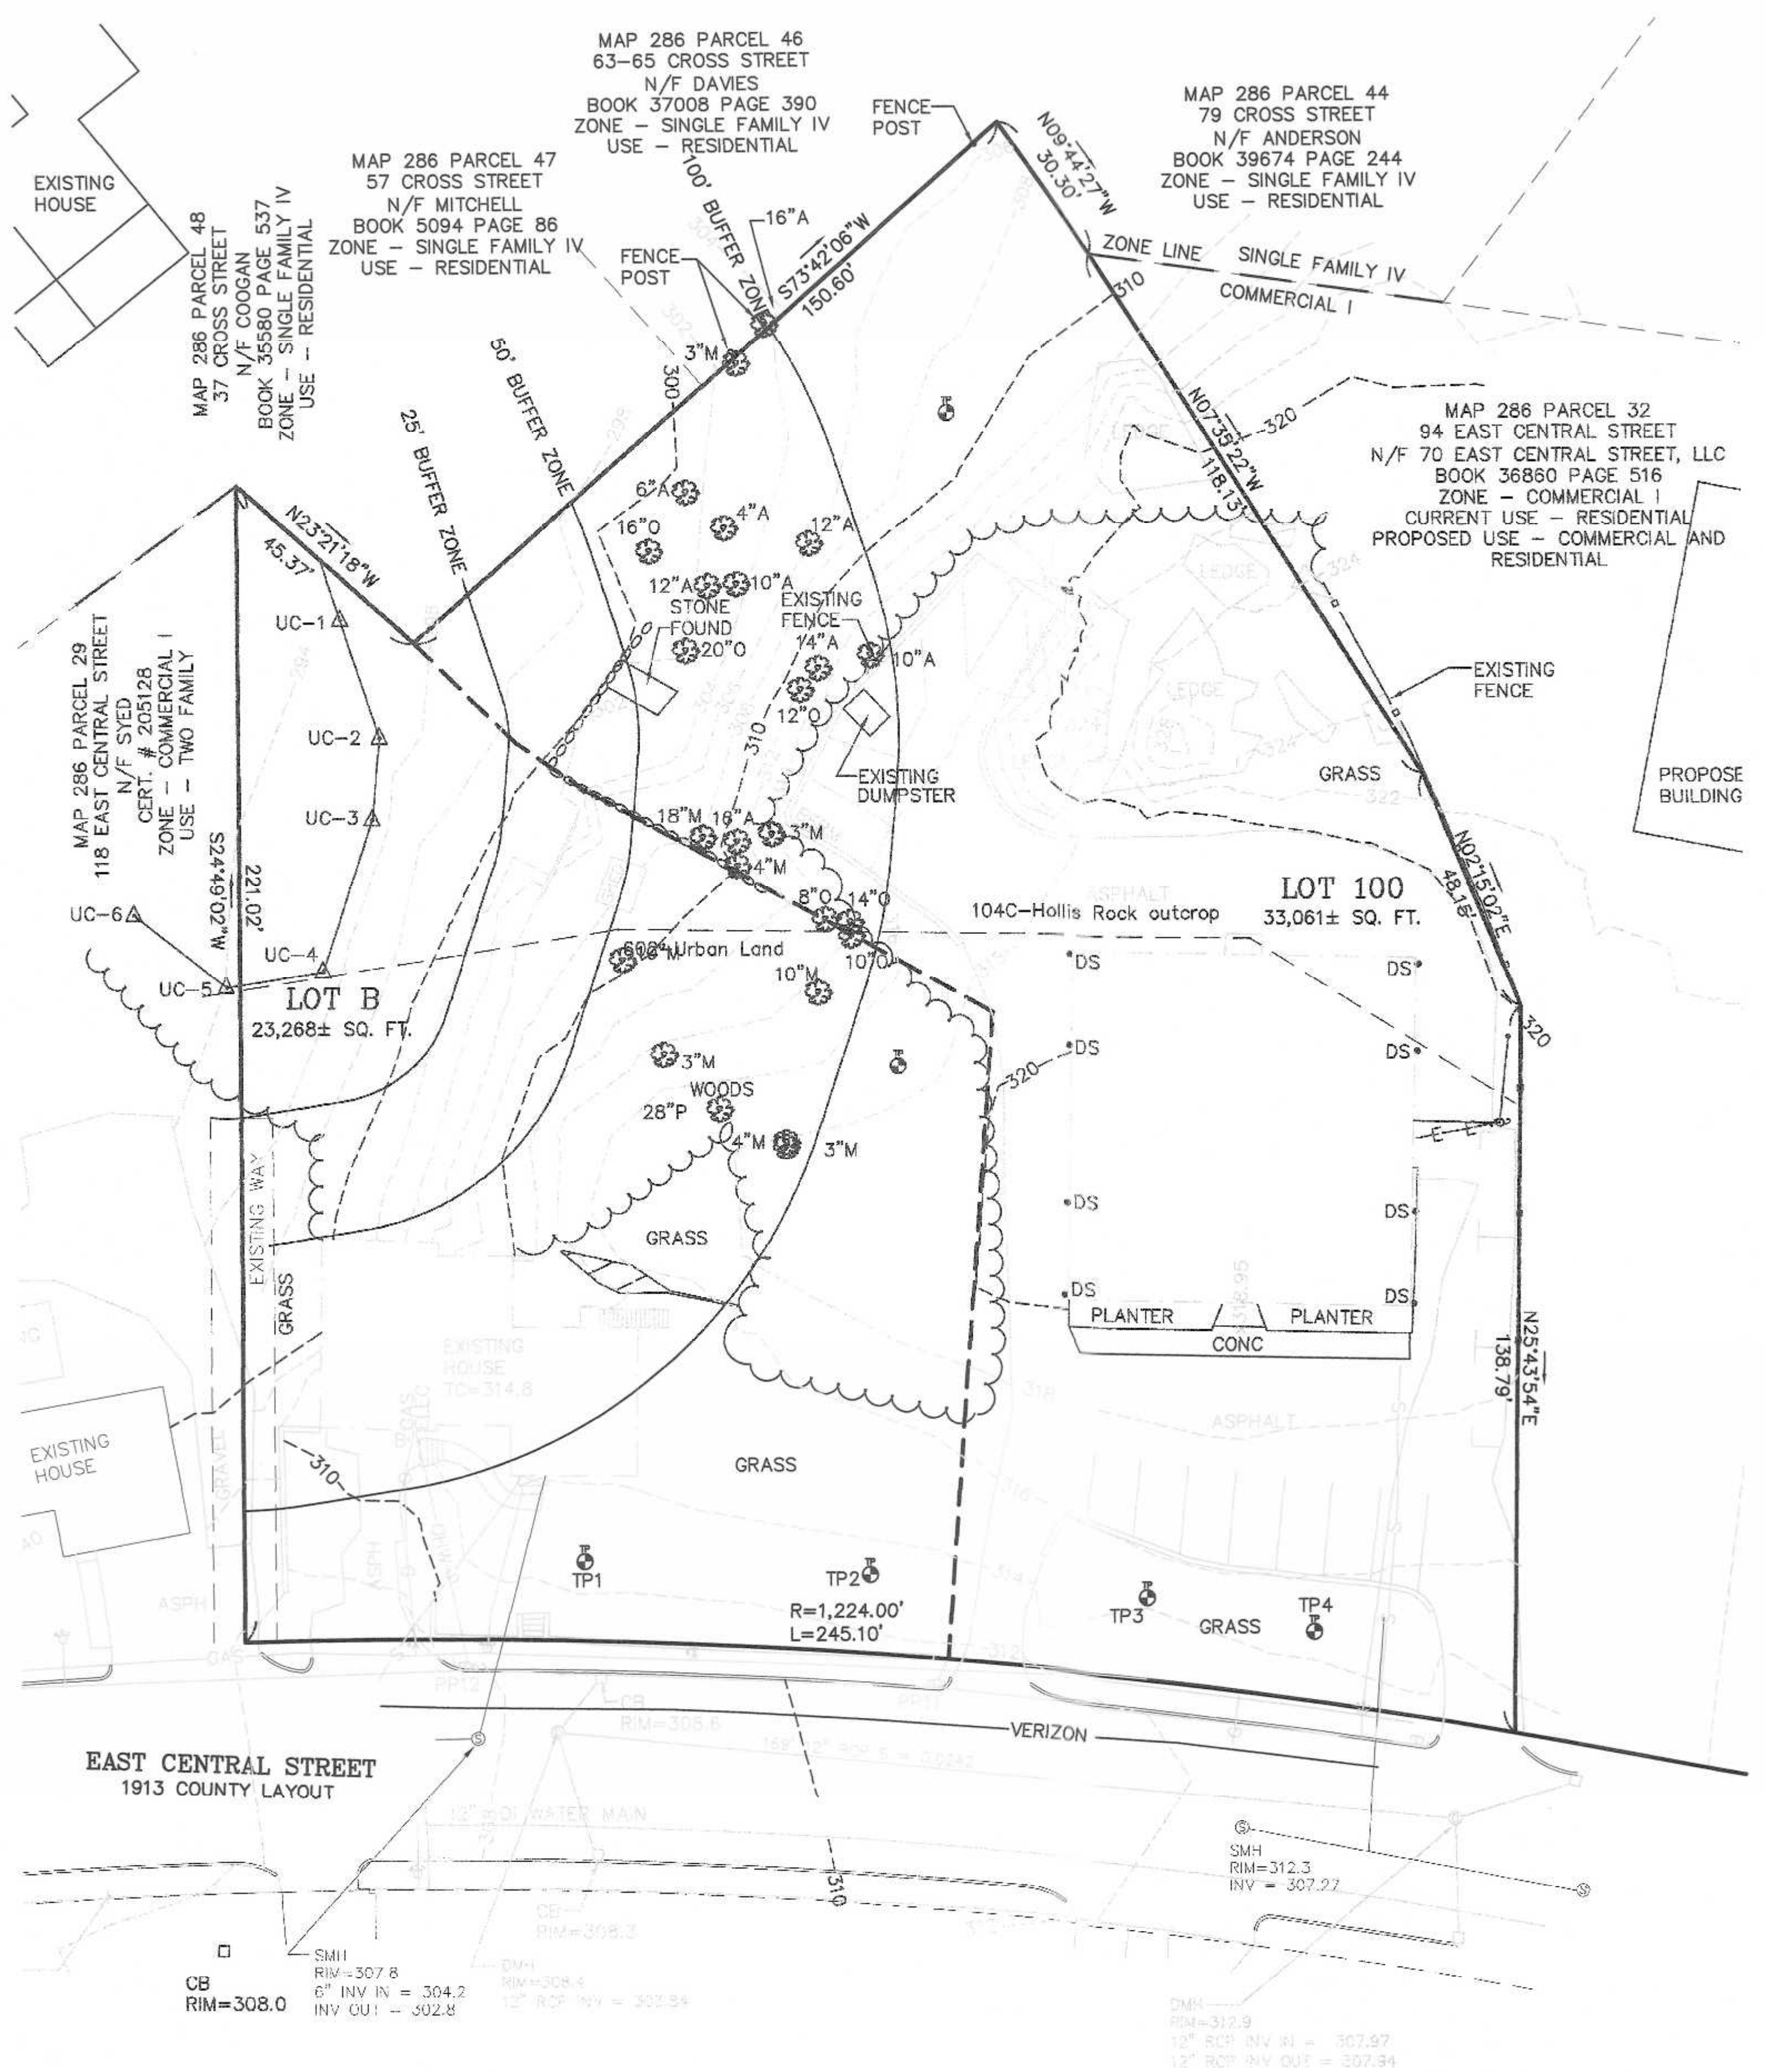

NOTES:
 1. ELEVATIONS DATUM NGVD 1929.
 2. EXISTING CONDITIONS SURVEY WAS COMPLETED BETWEEN AUGUST 28, 2020 AND JULY 18, 2023.
 3. SOIL TYPES TAKEN FROM SOILS MAP OF NORFOLK COUNTY.

EXISTING UTILITY NOTE:
 SEWER, DRAIN AND WATER LOCATIONS AND ELEVATIONS WERE TAKEN FROM PLANS OF RECORD AND ARE NOT THE RESULT OF A FIELD SURVEY.

EXISTING TREE NOTES:
 1. 14" - TREE DIAMETER
 2. A - ASH, O - OAK, M - MAPLE, P - PINE
 3. 22 TREES PROPOSED FOR REMOVAL.

- LEGEND:
- 297--- EXISTING CONTOUR
 - 297- PROPOSED CONTOUR
 - x274.3 SPOT GRADE - PROPOSED
 - x274.3EX. SPOT GRADE - EXISTING
 - ⊙ 4.3M EXIST. TREE - DIAMETER - SPECIES
 - UTILITY POLE
 - OVERHEAD WIRES
 - ⊕ GAS GATE
 - ⊕ WATER CURB STOP
 - ⊕ WATER GATE
 - ⊕ FIRE HYDRANT
 - ⊕ DRAIN MANHOLE
 - ⊕ CATCH BASIN
 - ⊕ SEWER MANHOLE
 - D DUMPSTER
 - VCC VERTICAL CONCRETE CURBING (REINFORCED)
 - VGC VERTICAL GRANITE CURBING
 - ⊕ HANDICAP PARKING SPACE
 - ⊕ BUILDING MOUNTED LIGHT
 - ⊕ B BOLLARD
 - ⊕ M MONITOR WELL

REFERENCES:
 ASSESSORS MAP 286 PARCELS 30 AND 31
 DEED BOOK 38897 PAGE 557
 CERTIFICATE NUMBER 209218

PLAN 19290B
 PLAN IN BOOK 1091 PAGE 108
 PLAN 3334 OF 1913


OWNERS:
 100 EAST CENTRAL STREET RE, LLC
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS

APPLICANT:
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS

SITE PLAN
 EXISTING CONDITIONS PLAN
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'

SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

DATE _____

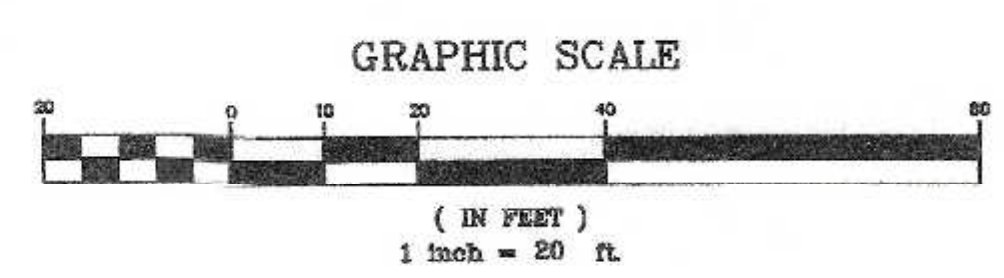


NO.	DATE	DESCRIPTION	BY
1	2/26/24	REVIEW COMMENTS	RRG

ANDREW C. MURPHY P.L.S. #35042

DATE	FIELD BY:	INT.
7/23	BL	BL
BK#	FIELD BOOK	PG#
1/24	RRG	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	ACM

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02098
 508-384-6560 FAX 508-384-8668

DATE	JAN. 5, 2024
SCALE	1" = 20'
PROJECT	UC1587
SHEET	2 of 10

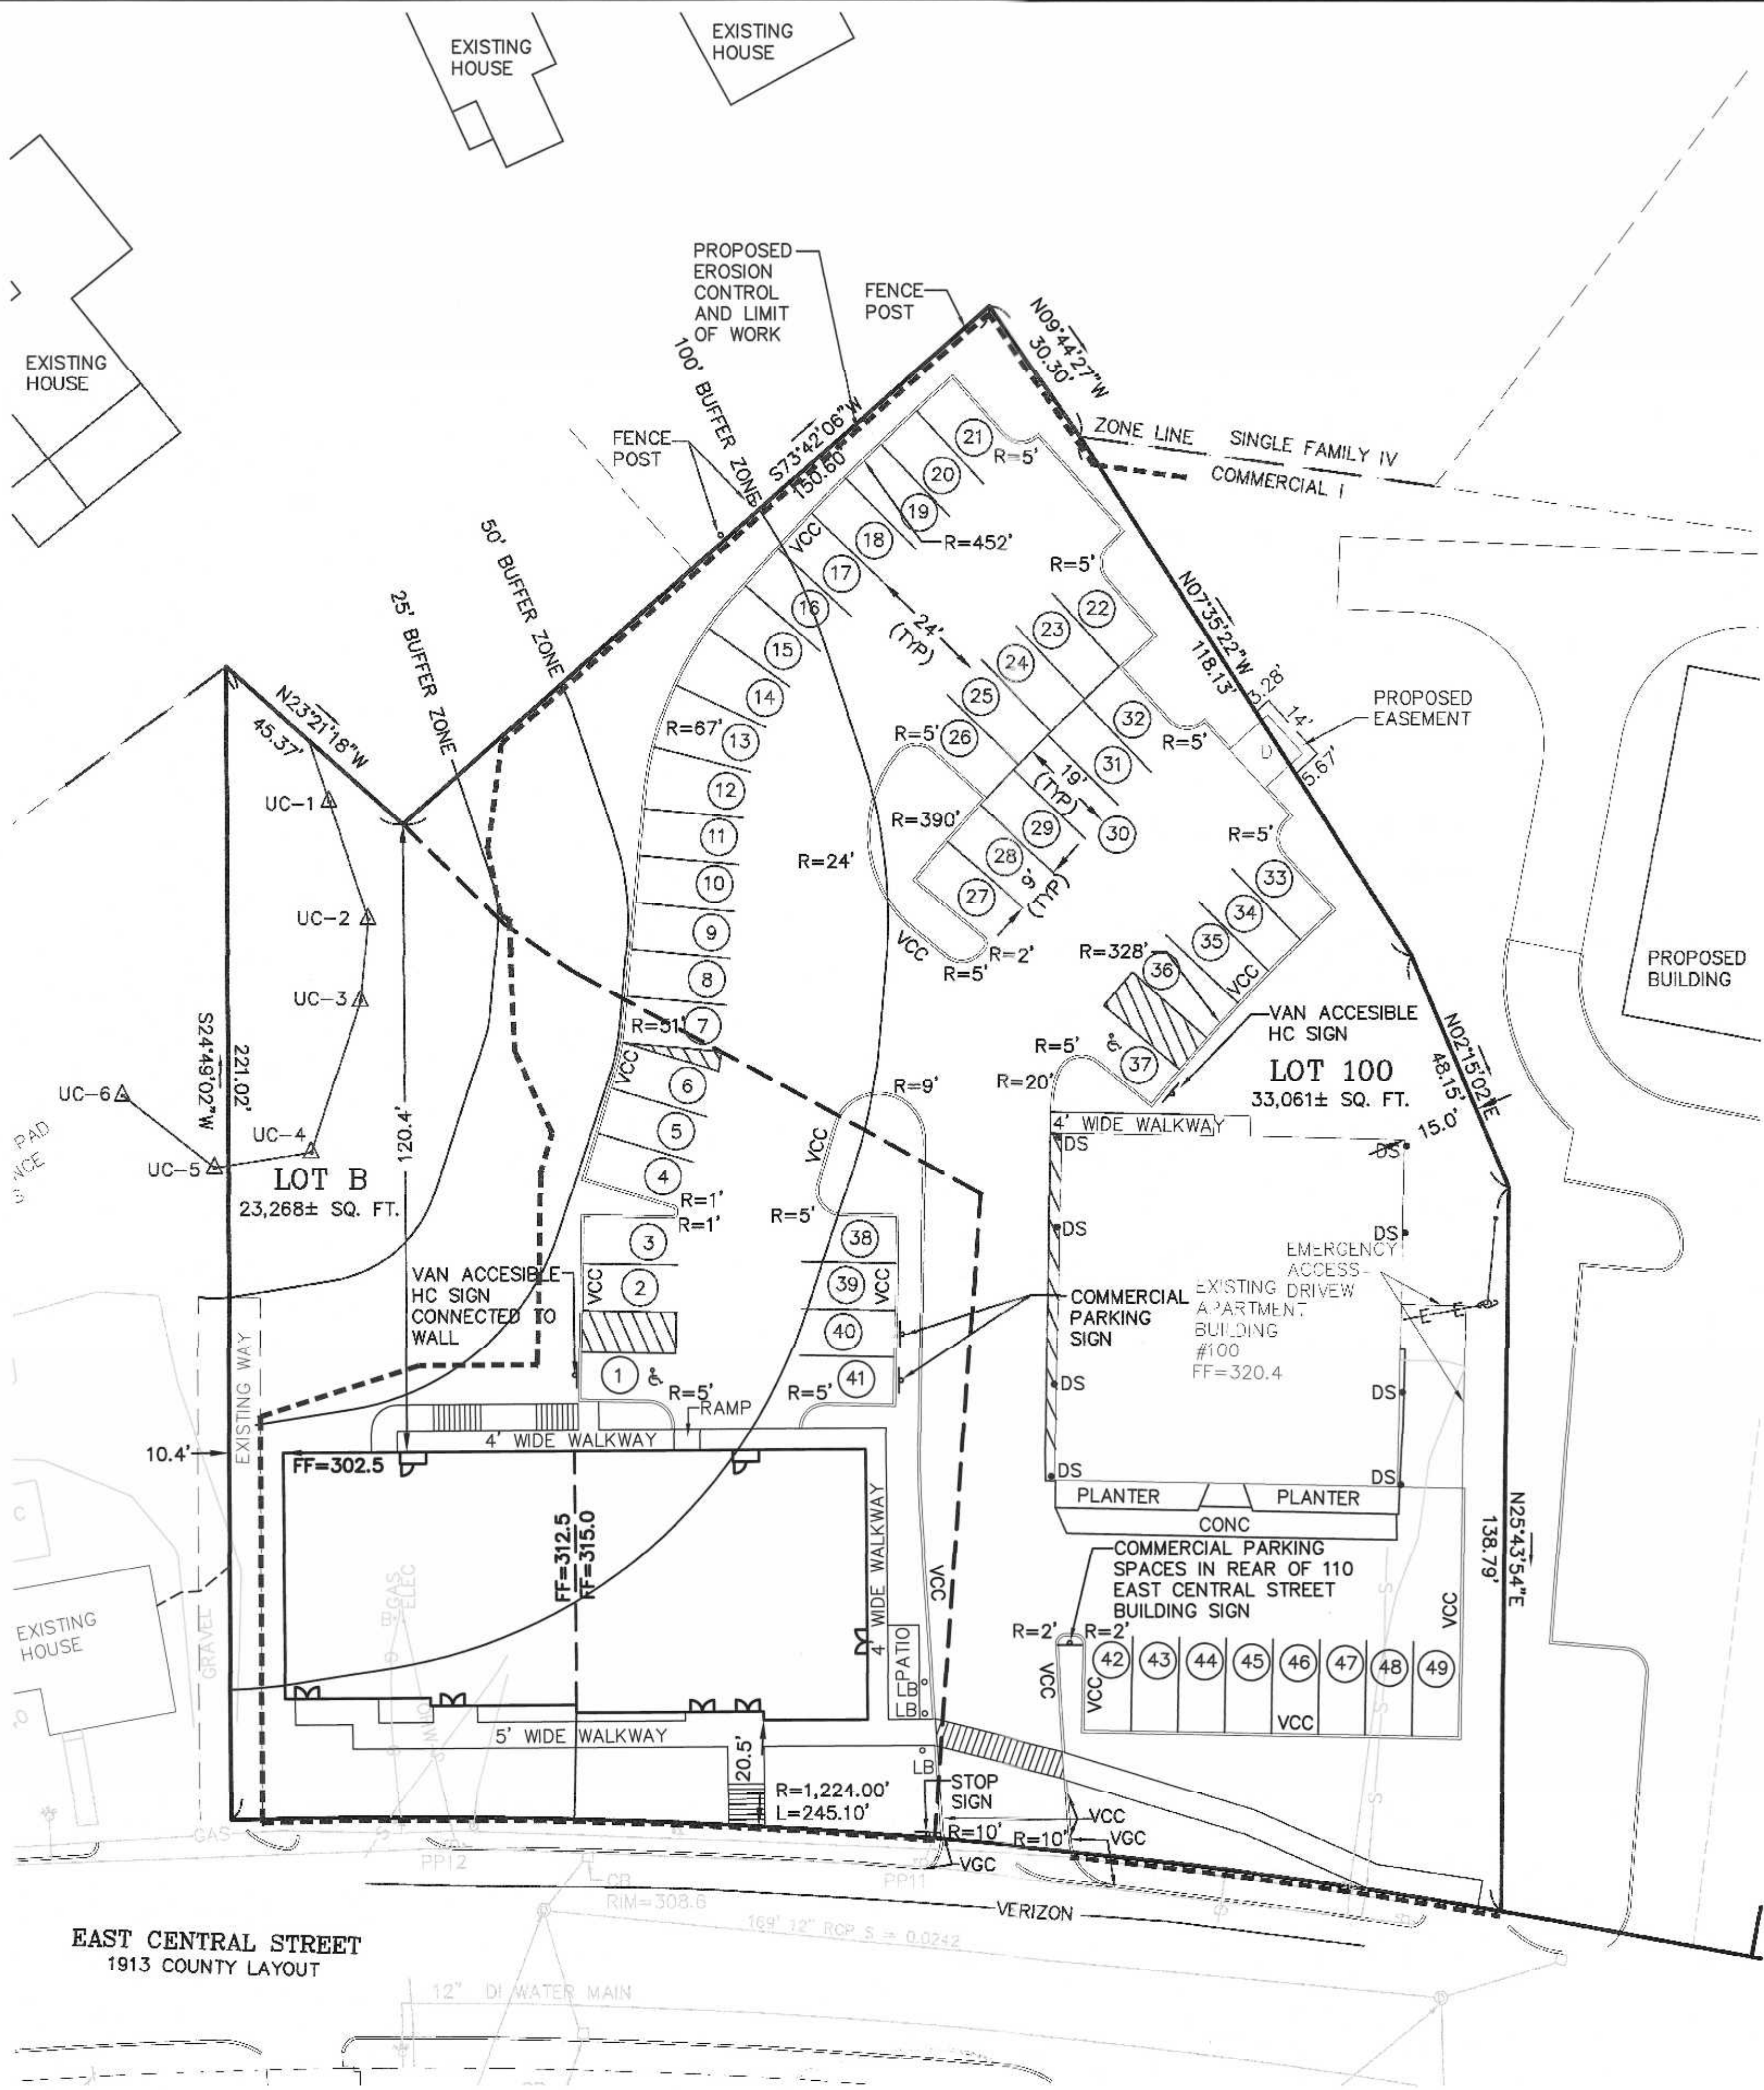

PARKING CALCULATIONS:
 #100 - #110 EAST CENTRAL STREET
 COMMERCIAL I REQUIREMENTS (SECTIONS 185-21B.(2)(a))
 1.5 SPACES PER DWELLING UNIT
 RESIDENTIAL DWELLINGS - 30 x 1.5 = 45

COMMERCIAL I REQUIREMENTS (SECTIONS 185-21B.(2)(b))
 COMMERCIAL SPACE (NON RESIDENTIAL USE) 1 SPACE PER 500
 SQ. FT. = 949 SQ. FT. / 500 = 2 SPACE REQUIRED

47 SPACES REQUIRED
 49 TOTAL SPACES PROVIDED INCLUDING 2 HANDICAP SPACES.

RESIDENTIAL UNIT DENSITY:
 1 UNIT PER 2,250 SQ. FT.
 56,329 SQ. FT. / 2,250 = 25.03 UNITS
 SEE 185 ATTACHMENT 7 NOTE 3.
 30 DWELLING UNITS PROPOSED (INCLUDING 10 EXISTING UNITS)
 SPECIAL PERMIT REQUIRED.

PARKING NOTES:
 1. PARKING SPACES 40 AND 41 ARE FOR THE COMMERCIAL
 USE AND SIGNS HAVE BEEN ADDED.

- LEGEND:
- 297- EXISTING CONTOUR
 - 297- PROPOSED CONTOUR
 - x274.3 SPOT GRADE - PROPOSED
 - x274.3EX. SPOT GRADE - EXISTING
 - 48M EXIST. TREE - DIAMETER - SPECIES
 - UTILITY POLE
 - OVERHEAD WIRES
 - GAS GATE
 - WATER CURB STOP
 - WATER GATE
 - FIRE HYDRANT
 - DRAIN MANHOLE
 - CATCH BASIN
 - SEWER MANHOLE
 - D DUMPSTER
 - VCC VERTICAL CONCRETE CURBING (REINFORCED)
 - VGC VERTICAL GRANITE CURBING
 - Handicap symbol HANDICAP PARKING SPACE
 - Building symbol BUILDING MOUNTED LIGHT
 - B BOLLARD
 - LB LIGHTED BOLLARD
 - M MONITOR WELL

REFERENCES:
 ASSESSORS MAP 286 PARCELS 30 AND 31
 DEED BOOK 38897 PAGE 557
 CERTIFICATE NUMBER 209218

PLAN 19290B
 PLAN IN BOOK 1091 PAGE 108
 PLAN 3334 OF 1913


OWNERS:
 100 EAST CENTRAL STREET RE, LLC
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS

APPLICANT:
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS

SITE PLAN
 SITE LAYOUT PLAN
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'

SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

 DATE _____

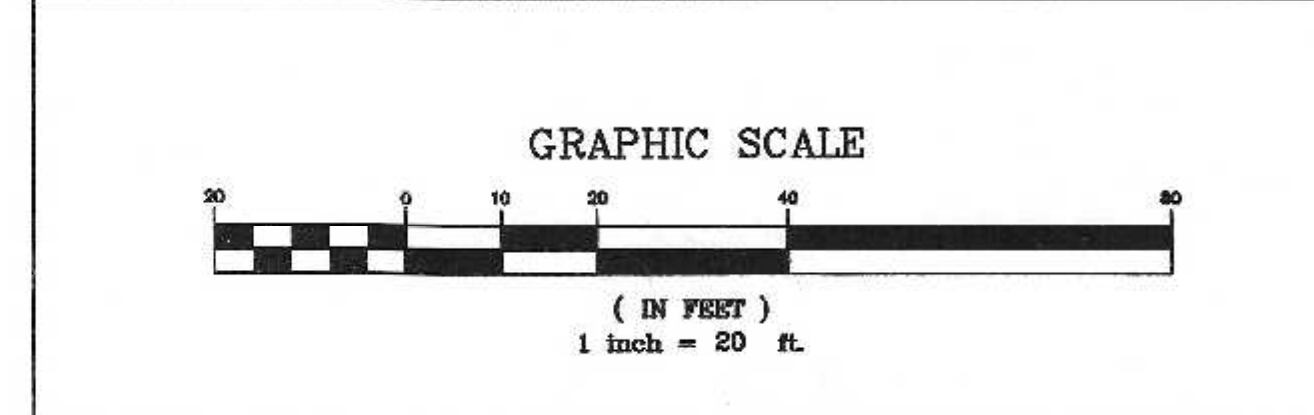

NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

CARLOS A. QUINTAL
 P.E. #30812

DATE	FIELD BY:	INT.
7/23	BL	
1/24	RRG	
1/24	RRG	
1/24	COMP	
1/24	CAQ	

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-884-8580 FAX 508-884-8586

DATE
 JAN. 5, 2024
 SCALE
 1" = 20'
 PROJECT
 UC1587
 SHEET
 3 of 10

MAY 8, 2023

PERFORMED BY CARLOS A. QUINTAL, P.E., SOIL EVALUATOR
RICHARD GOODREAU AND JARED LIBERTI

LEGEND:

EXISTING SITE FEATURES NOTES:

- EXISTING 110 EAST CENTRAL STREET HOUSE TO BE REMOVED.
- EXISTING FOUNDATION, STONE WALLS AND FENCES TO BE REMOVED.
- EXISTING ASPHALT TO BE REMOVED.
- EXISTING WATER SERVICES TO BE REMOVED.
- EXISTING SEWER SERVICES TO BE REMOVED.
- EXISTING UTILITY SERVICES TO REMAIN. (100 EAST CENTRAL STREET). EXISTING UTILITIES TO 110 EAST CENTRAL STREET TO BE REMOVED.
- EXISTING WATER AND SEWER SERVICE TAKEN FROM TIES PROVIDED BY THE TOWN OF FRANKLIN AND SHOULD BE FIELD VERIFIED.
- THE EXISTING EASTERLY AND WESTERLY CURB CUTS TO BE REMOVED. VERTICAL GRANITE CURBING SHALL BE INSTALLED AND THE SIDEWALK SHALL BE RECONSTRUCTED.

- 297--- EXISTING CONTOUR
- 297- PROPOSED CONTOUR
- x274.3 SPOT GRADE - PROPOSED
- x274.3EX. SPOT GRADE - EXISTING
- ⊙ 48M EXIST. TREE - DIAMETER - SPECIES
- UTILITY POLE
- OVERHEAD WIRES
- ⊕ GAS GATE
- ⊕ WATER CURB STOP
- ⊕ WATER GATE
- ⊕ FIRE HYDRANT
- ⊕ DRAIN MANHOLE
- ⊕ CATCH BASIN
- ⊕ SEWER MANHOLE
- D DUMPSTER
- VCC VERTICAL CONCRETE CURBING (REINFORCED)
- VGC VERTICAL GRANITE CURBING
- ⊕ HANDICAP PARKING SPACE
- ⊕ BUILDING MOUNTED LIGHT
- ⊕ B BOLLARD
- ⊕ LB LIGHTED BOLLARD
- ⊕ M MONITOR WELL

DRAINAGE STRUCTURE SCHEDULE:

CB 1
RIM = 314.5
INV OUT = 311.39 - 12" RCP

CB 2
RIM = 316.7
INV OUT = 311.2 - 12" RCP

GI 3
GRATE RIM = 314.3
MH RIM = 314.8
INV OUT = 311.98 - 12" RCP

CB 4
RIM = 314.4
INV OUT = 305.70 - 12" RCP

CB 5
RIM = 315.0
INV OUT = 310.21 - 12" HDPE

DMH 1
RIM = 315.2
INV IN = 311.63 - 8" SDR 35 PVC
INV IN = 311.30 - 12" RCP
INV OUT = 311.20 - 12" HDPE

DMH 2
RIM = 318.5
INV IN = 312.1 - 8" PVC
INV IN = 311.70 - 12" RCP
INV OUT = 311.60 - 12" RCP

DMH 3
RIM = 318.5
INV IN = 312.31
INV IN = 311.91 - 12" RCP
INV OUT = 311.81 - 12" RCP

DMH 4
RIM = 316.2
INV IN = 309.88
INV OUT = 298.75

SEWER STRUCTURE SCHEDULE:

SMH 1
RIM = 311.0
INV IN = 304.78 - 8" SDR 35
INV OUT = 304.68 - 6" PVC (EXISTING)

SMH 2
RIM = 313.8
INV IN = 307.76 - 8" SDR 35
INV OUT = 307.66 - 8" SDR 35

SMH 3
RIM = 317.0
INV IN = 309.02 - 8" SDR 35
INV OUT = 308.92 - 8" SDR 35

SEWER NOTES:

- CONTRACTOR TO CONFIRM ELEVATION OF THE EXISTING 6" PVC SEWER SERVICE AT THE RIGHT OF WAY LINE PRIOR TO INSTALLING AND SEWER LINES OR MANHOLES. CONTRACTOR TO COORDINATE WITH THE DESIGN ENGINEER AND PROVIDE 48 HOUR NOTICE (MINIMUM) PRIOR TO ANY SEWER WORK COMMENCING.
- CONTRACTOR TO CONFIRM THE LOCATION OF THE DUCT BANK AND REPORT LOCATIONS TO THE DESIGN ENGINEER A MINIMUM OF 48 HOURS PRIOR TO COMMENCING WITH ANY SEWER LINES OR MANHOLE INSTALLATION.
- ALL NEW SEWER LINES TO BE 8" SDR 35 PVC SEWER.

BUFFER ZONE DISTURBANCES:


- 0 - 25' BUFFER ZONE
0 - SQ. FT.
- 25' - 50' BUFFER ZONE
1,852 SQ. FT.
- 50' - 100' BUFFER ZONE
13,652 SQ. FT.

EXISTING WETLAND FLAGS WERE CONFIRMED BY UNITED CONSULTANTS, INC. AND WERE FIELD LOCATED ON JULY 17 AND 18 2023.

PAVEMENT RESTORATION WITHIN THE 140 RIGHT OF WAY SHALL MATCH THE EXISTING GRAVEL, DENSE GRADE, BINDER COURSE AND FINISH COURSE DEPTHS OF BITUMINOUS CONCRETE. EXISTING CONCRETE SIDEWALK TO BE REMOVED AND RECONSTRUCTED AS NECESSARY AND SHALL MATCH EXISTING CONCRETE SIDEWALK ALONG THE FRONTAGE OF 100 AND 110 EAST CENTRAL STREET.


ACCESSIBLE ROUTE SHALL NOT HAVE A CROSS SLOPE GREATER THAN 2% OR A RUNNING SLOPE GREATER THAN 5%
SEE 521 CMR 20.9.

SITE PLAN
SITE GRADING AND UTILITY PLAN
100 & 110 EAST CENTRAL STREET
FRANKLIN, MASSACHUSETTS
PREPARED FOR
110 EAST CENTRAL STREET RE, LLC
37 EAST CENTRAL STREET
FRANKLIN, MASSACHUSETTS
JANUARY 5, 2024
SCALE: 1" = 100'

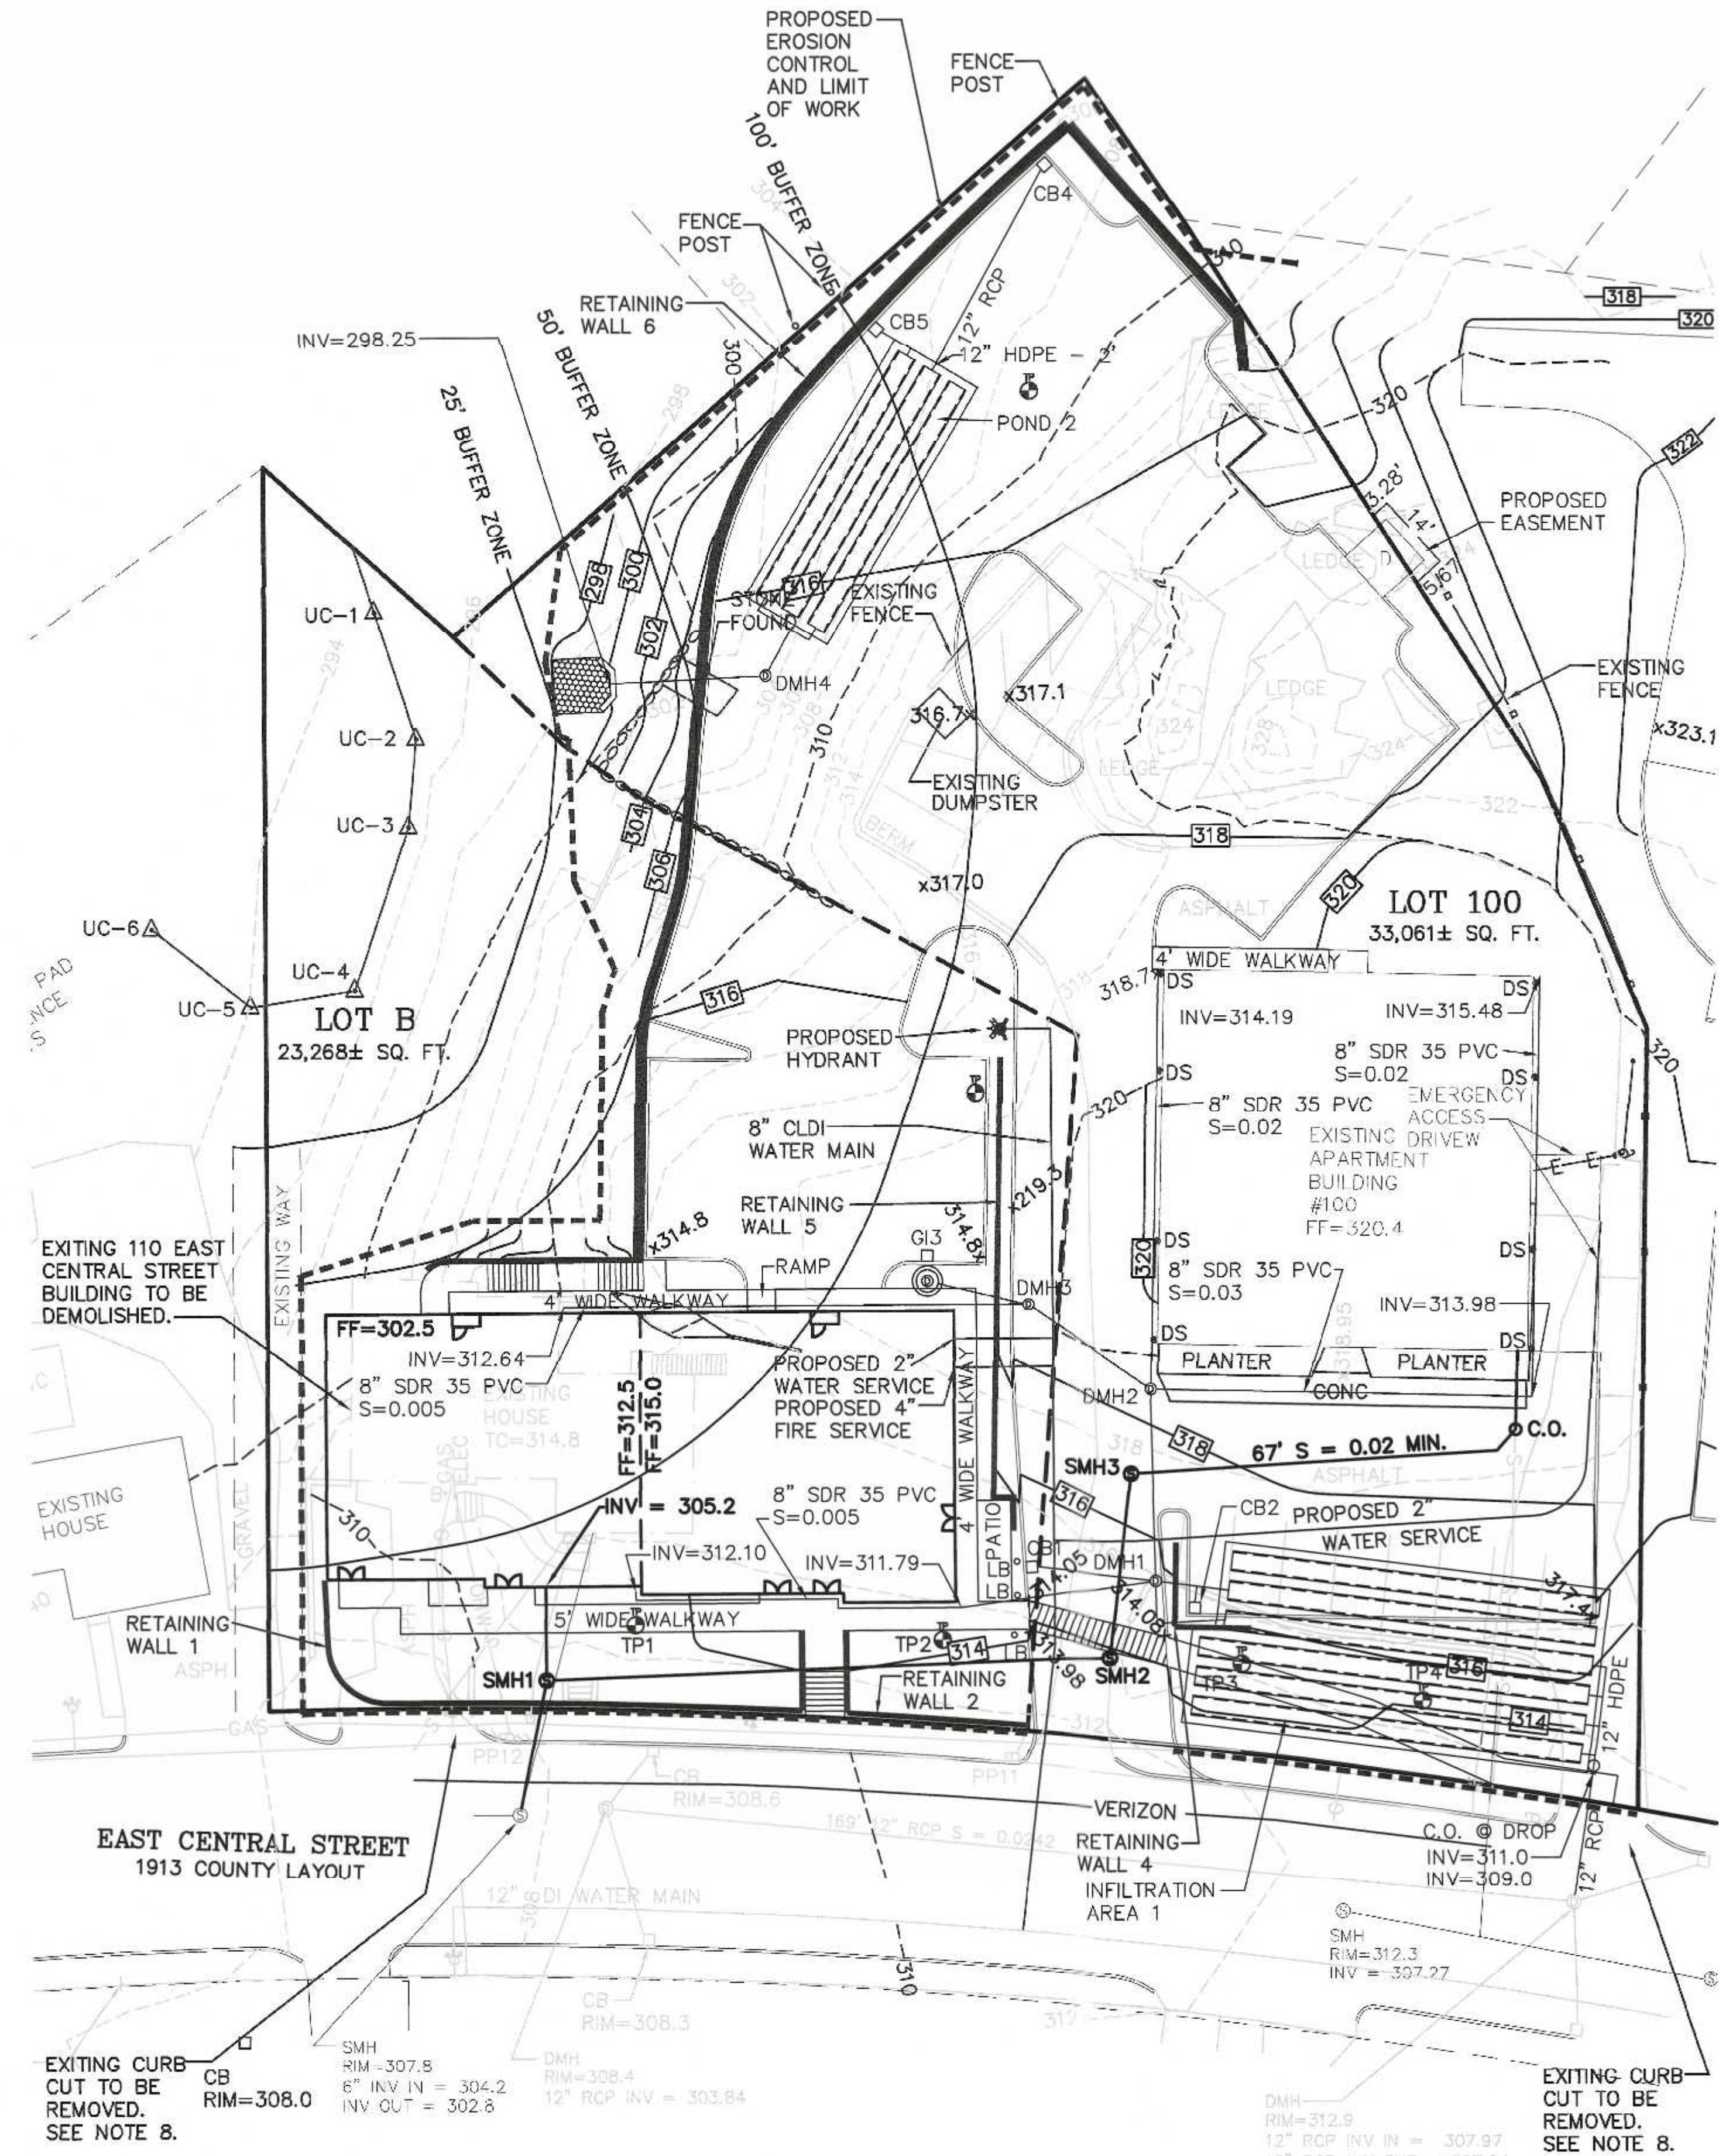

SITE PLAN APPROVAL
REQUIRED
FRANKLIN PLANNING BOARD

DATE _____

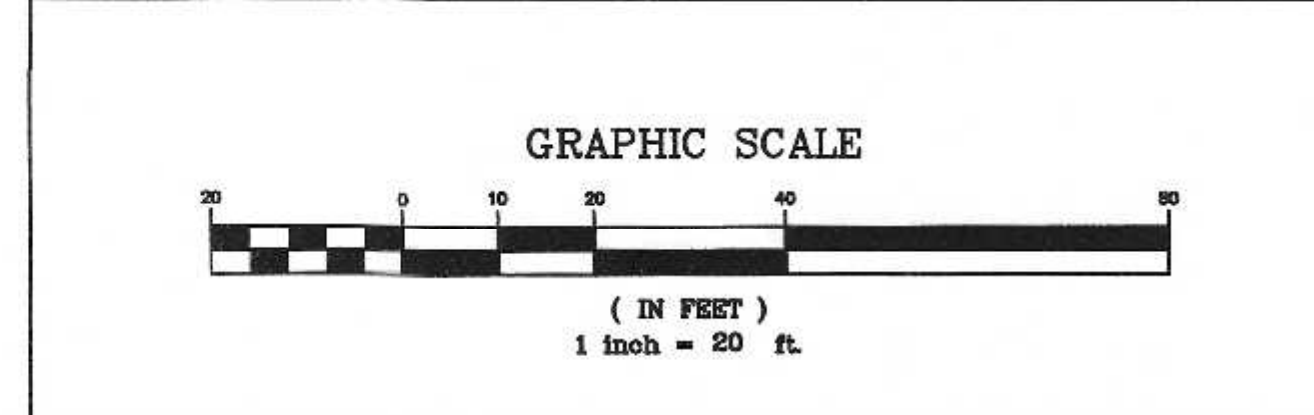

NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

DATE	FIELD BY:	INT.
7/23	FIELD BOOK	BL
1/24	CALCS BY:	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.

850 FRANKLIN STREET SUITE 11D
WRENTHAM, MASSACHUSETTS 02093
508-384-8560 FAX 508-384-8566

DATE
JAN. 5, 2024

SCALE
1" = 20'

PROJECT
UC1587

SHEET
4 of 10


PLANTING SCHEDULE

NUMBER	SCIENTIFIC NAME	SIZE	CONDITION
2	SUGAR MAPLE - SM	ACER SACCHARUM	2 - 2 1/2" B&B
3	RED MAPLE - RM	ACER RUBRUM	2 - 2 1/2" B&B
6	BAY BERRY - BB	MYRTICA PENNSYLVANICA	1 GAL CONTAINER
9	VIRGINIA ROSE - VR	ROSA VIRGINIANA	1 GAL CONTAINER
7	HIGHBUSH BLUEBERRY - HB	VACCINIUM MACROCARPON	1 GAL CONTAINER


LANDSCAPE AND SNOW STORAGE / REMOVAL NOTES:
 1. LANDSCAPE AREAS TO BE COVERED WITH MULCH OR DECORATIVE STONE.
 2. LANDSCAPE AREAS TO BE UTILIZED AS SNOW STORAGE AREAS.
 3. SNOW STORAGE TO BE IN EXTRA PARKING SPACES.

INVASIVE SPECIES NOTE:
 THE APPLICANT SHALL SCHEDULE A PRE-CONSTRUCTION MEETING WITH THE CONSERVATION AGENT TO DISCUSS THE INVASIVE SPECIES REMOVAL.

- PER SECTION 185-210(5) PROVIDE 1 TREE PER 10 PARKING SPACES. 49 PARKING SPACES = 5 TREES 5 TREES PROVIDED.
 - ALL PLANTINGS ARE IN ACCORDANCE WITH THE TOWN OF FRANKLIN BEST DEVELOPMENT PRACTICES GUIDEBOOK OR WILL BE APPROVED BY THE TOWN OF FRANKLIN CONSERVATION COMMISSION.

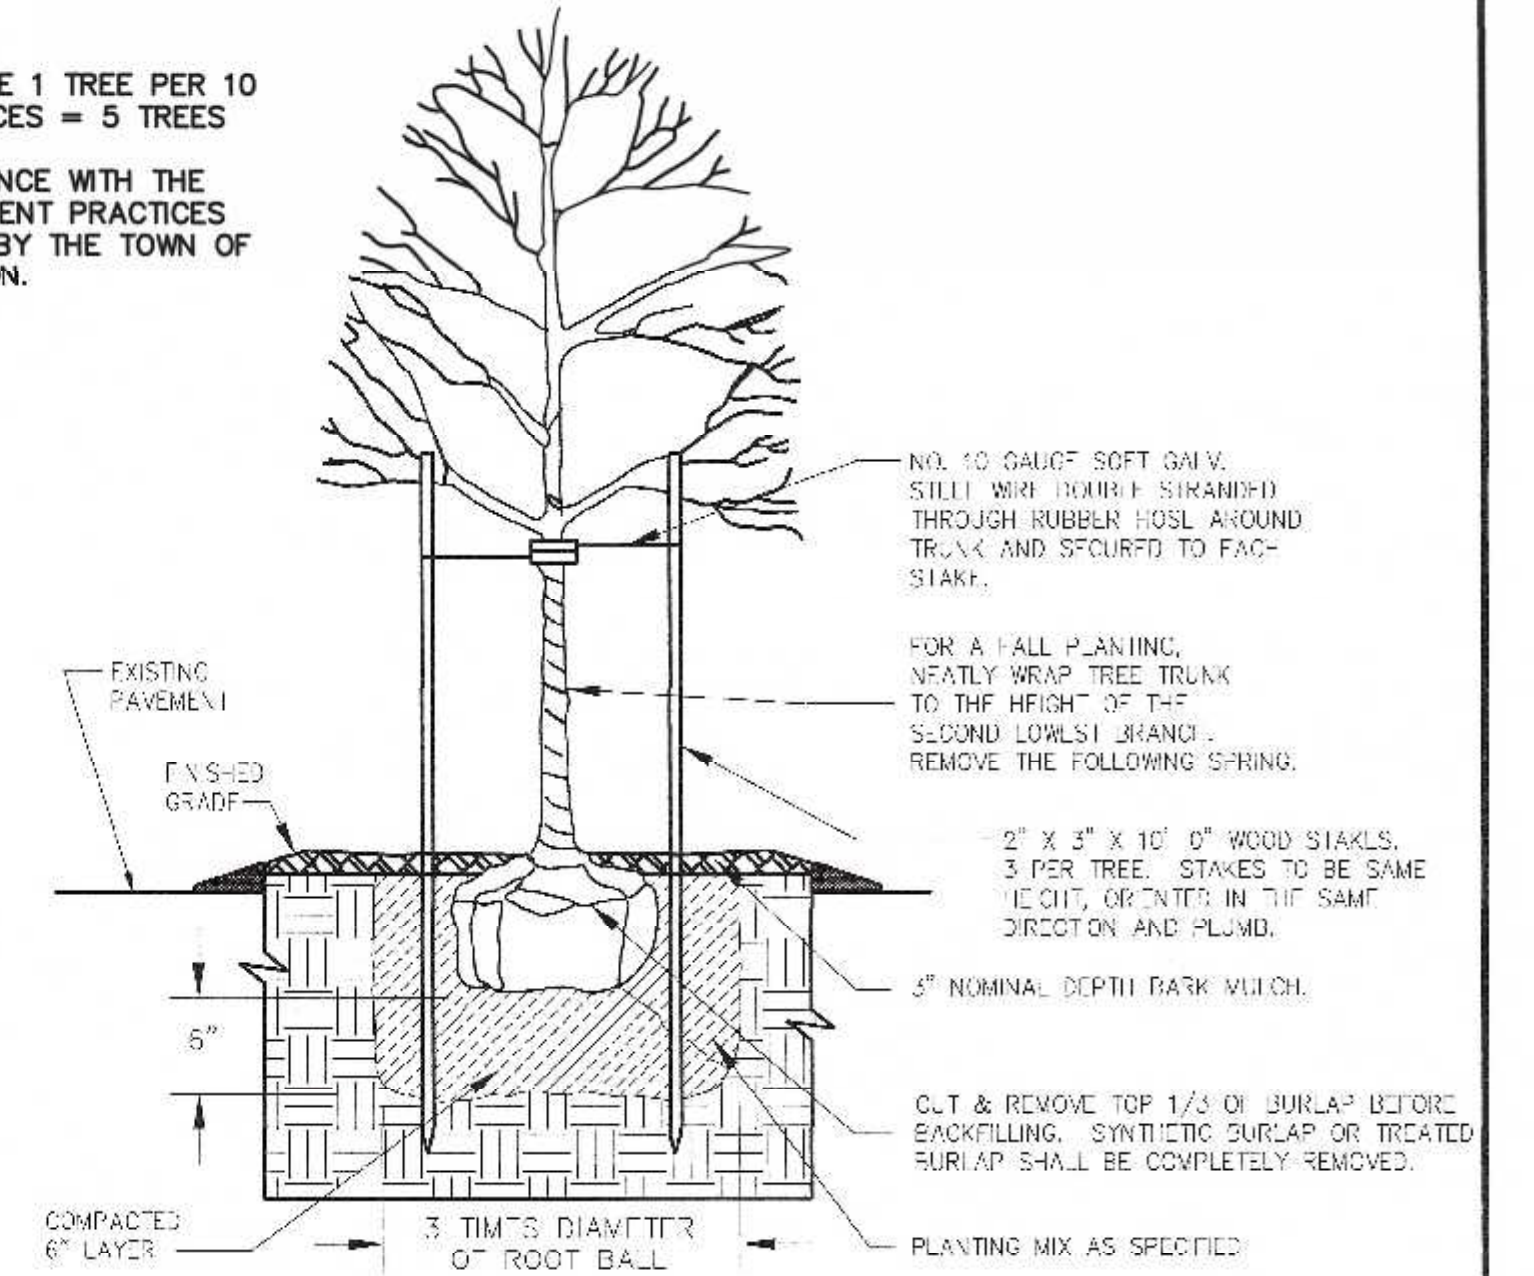

DECIDUOUS TREE PLANTING

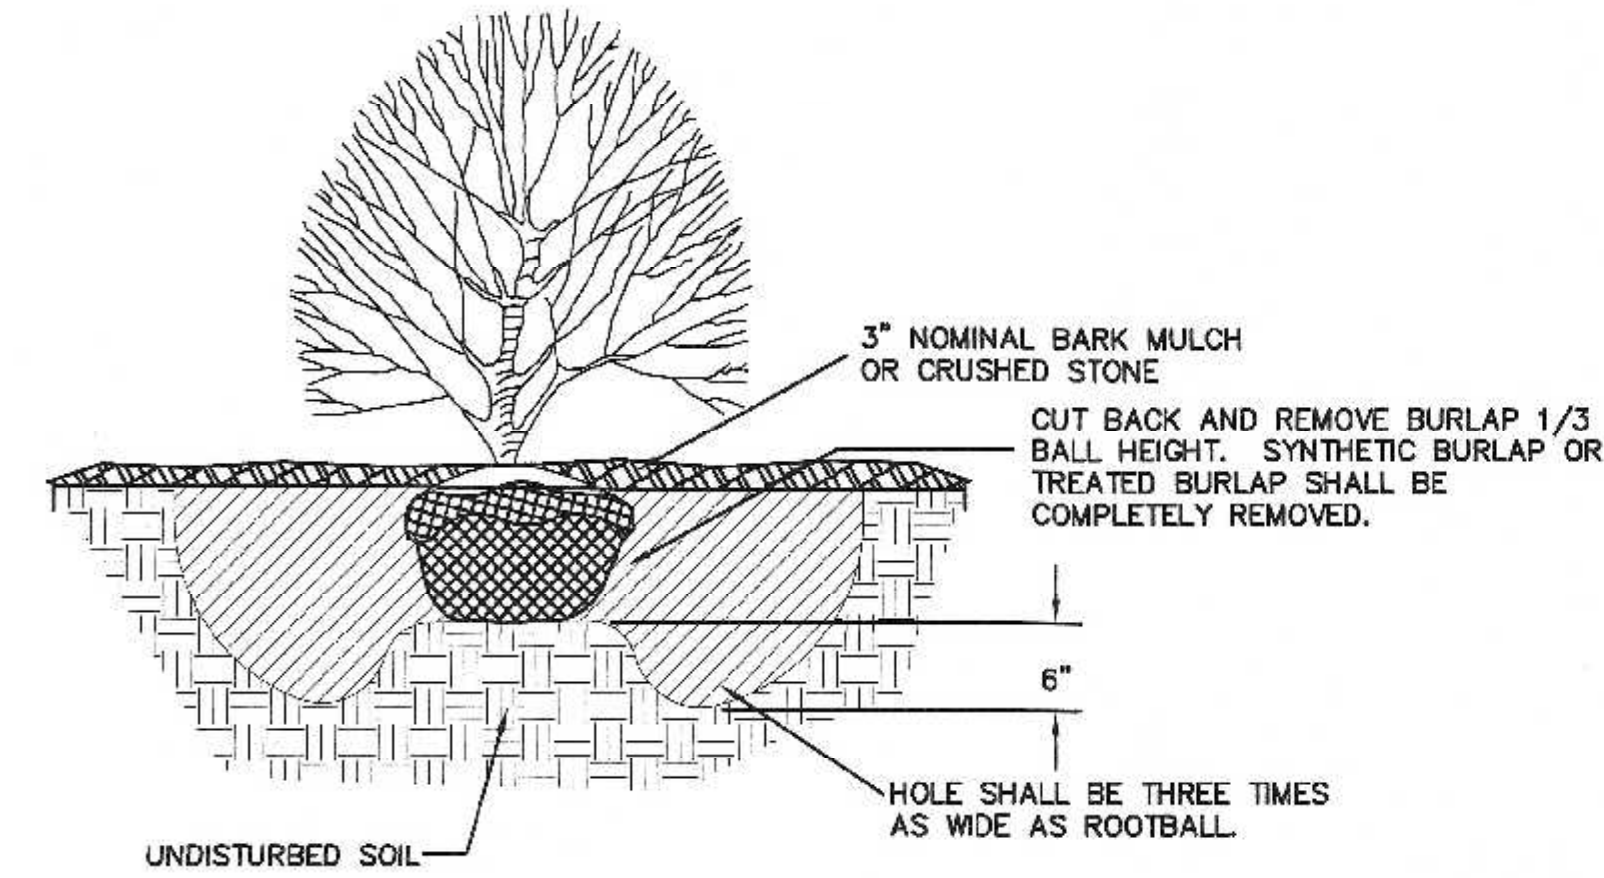


SHRUB PLANTING

NOTES:
 1. CONTRACTOR TO CONTACT DIGSAFE PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 2. CONTRACTOR TO VERIFY LOCATIONS OF EXISTING UTILITIES ANY REPORT ANY DISCREPANCIES TO UNITED CONSULTANTS, INC.
 3. ALL WORK SHALL CONFORM TO THE TOWN OF FRANKLIN DPW STANDARDS.
 4. MAINTAIN A MINIMUM OF 10' SEPARATION FROM THE WATER SERVICE TO THE SEWER SERVICE.

LEGEND:


- 297- EXISTING CONTOUR
- 297- PROPOSED CONTOUR
- x274.3 SPOT GRADE - PROPOSED
- x274.3EX. SPOT GRADE - EXISTING
- ⊕ 48M EXIST. TREE - DIAMETER - SPECIES
- UTILITY POLE
- OVERHEAD WIRES
- GAS GATE
- WATER CURB STOP
- WATER GATE
- FIRE HYDRANT
- DRAIN MANHOLE
- CATCH BASIN
- SEWER MANHOLE
- D DUMPSTER
- VCC VERTICAL CONCRETE CURBING (REINFORCED)
- VGC VERTICAL GRANITE CURBING
- ⊕ HANDICAP PARKING SPACE
- BUILDING MOUNTED LIGHT
- BOLLARD
- ⊙ MONITOR WELL

NOTE:
 ALL DISTURBED AREAS WITHIN THE BUFFER ZONE AND DOWNGRADE OF RETAINING WALL 6 SHALL BE SEEDED WITH A NEW CONSERVATION / WILDLIFE SEED MIX. OBTAIN FROM NEW ENGLAND WETLAND PLANTS, INC. AND APPLY PER THEIR RECOMMENDATIONS.

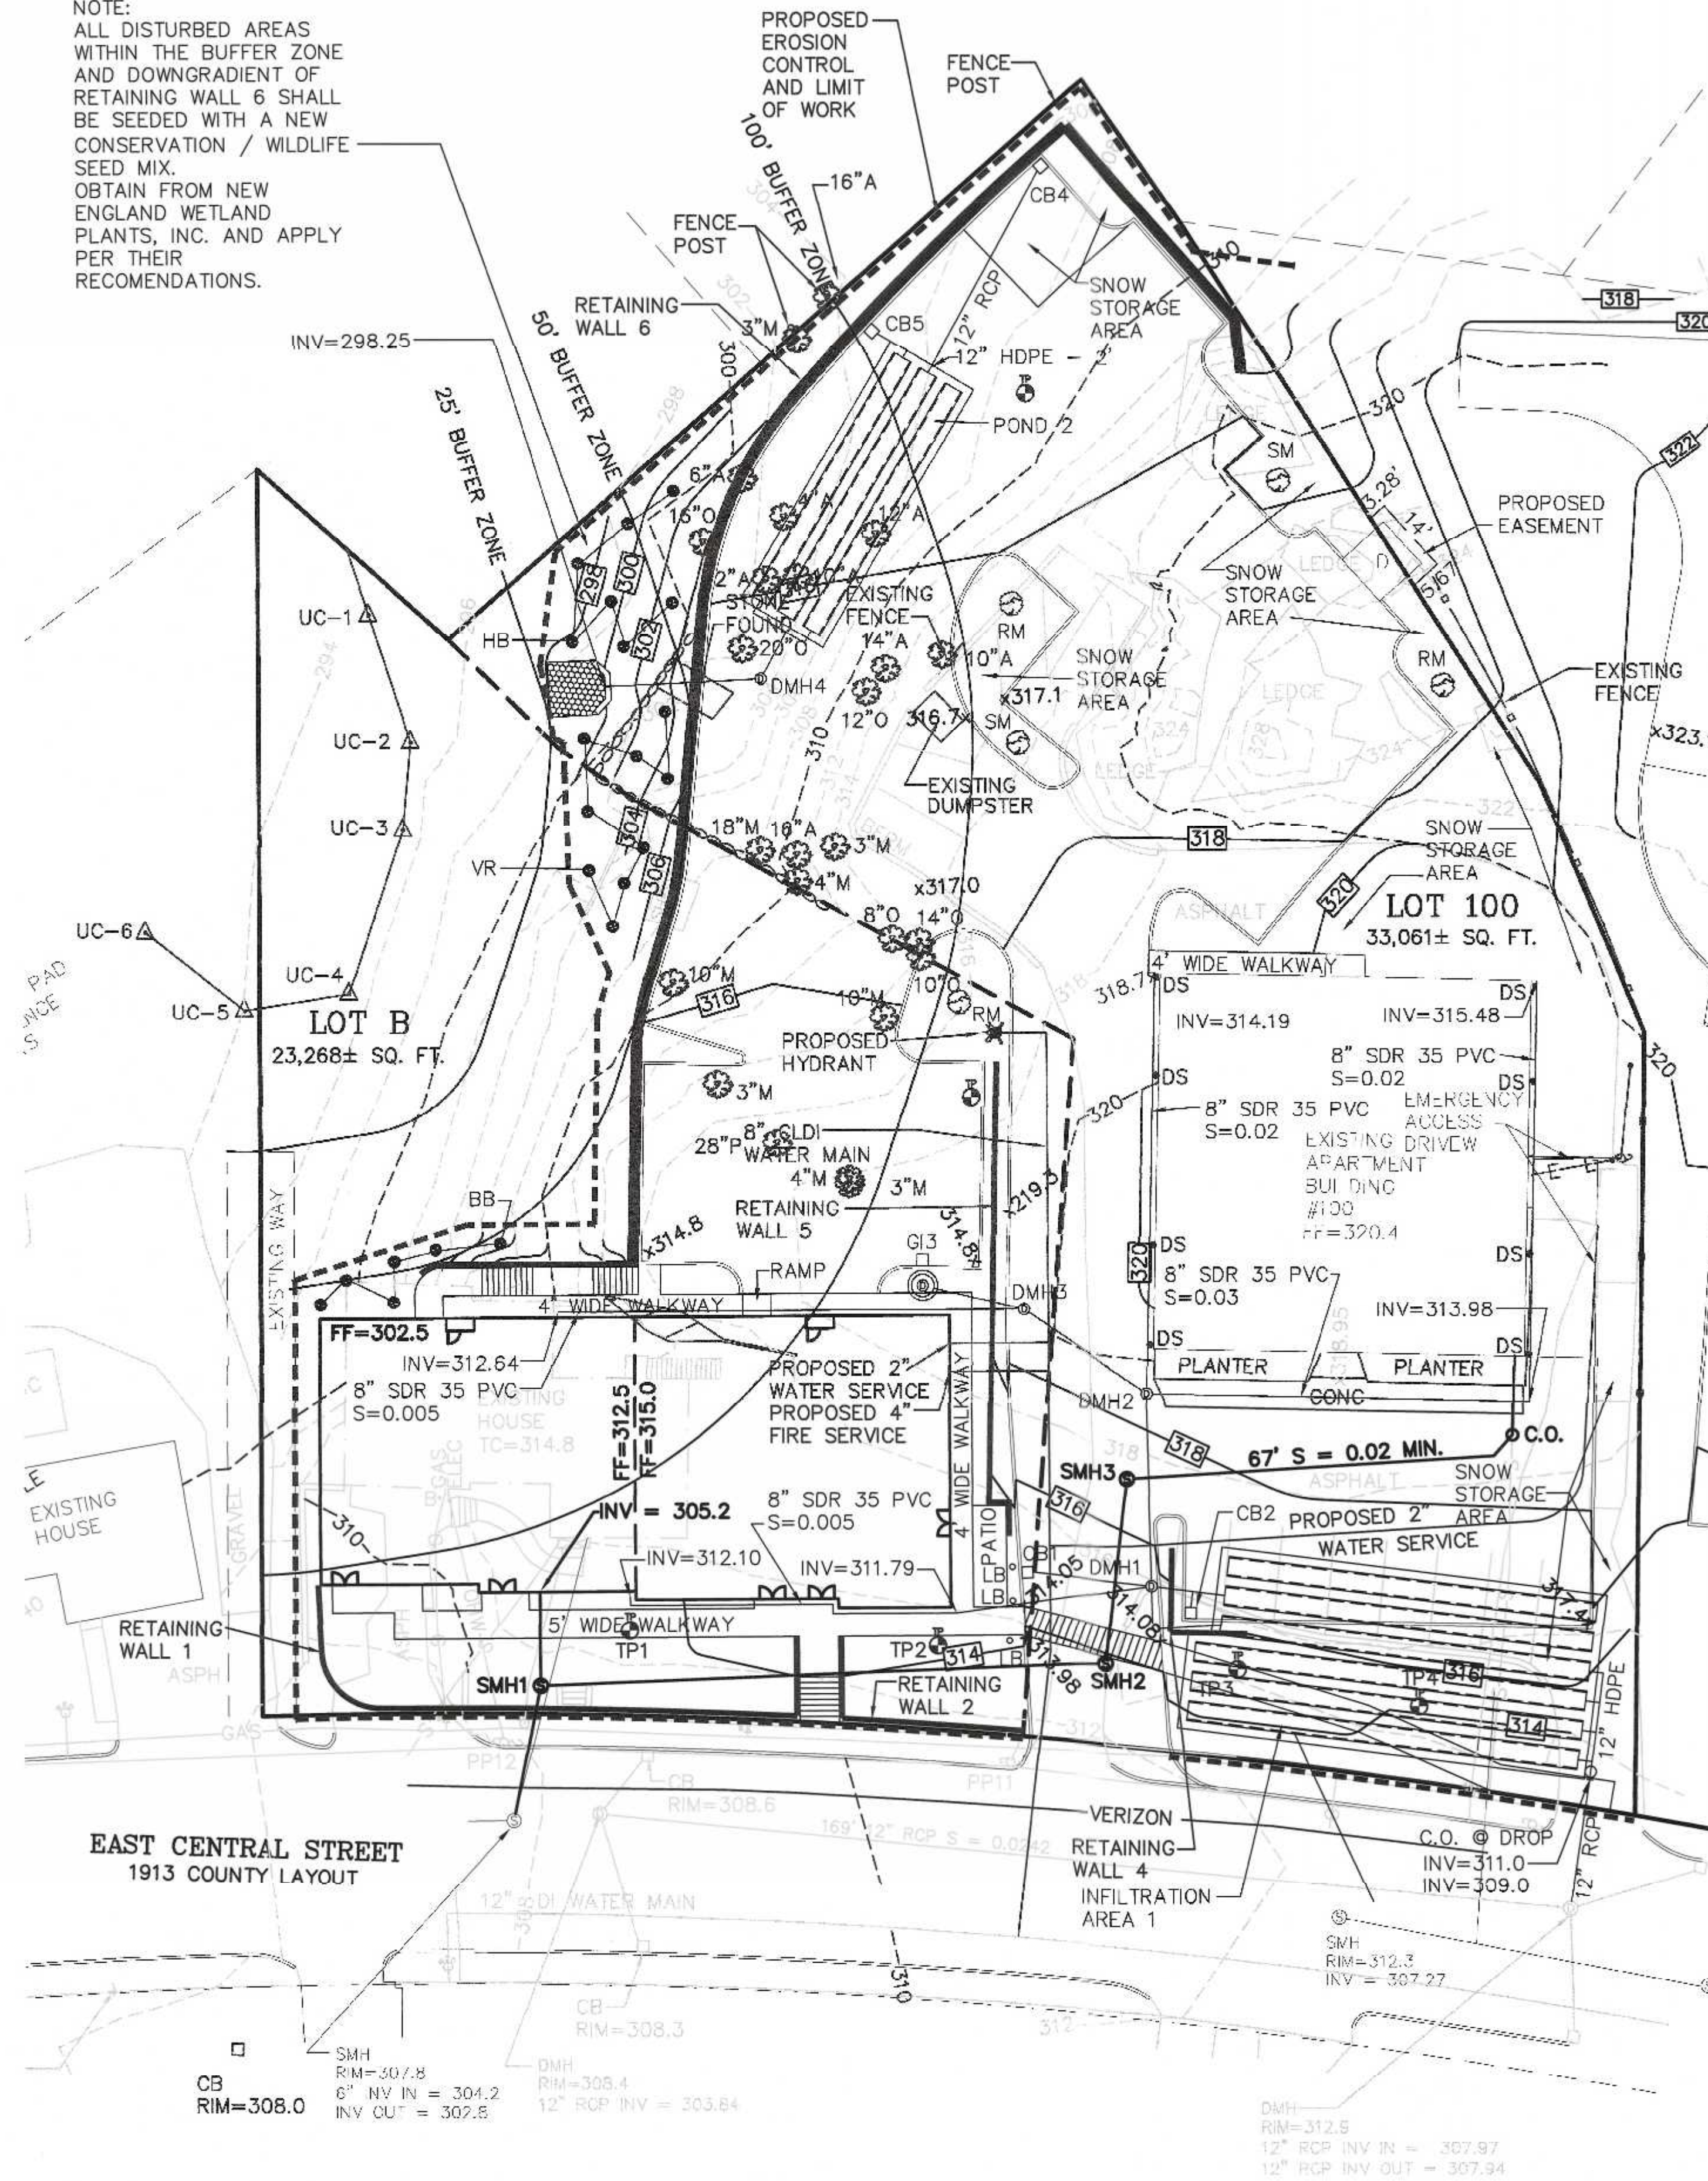


SITE PLAN APPROVAL REQUIRED
 FRANKLIN PLANNING BOARD

DATE

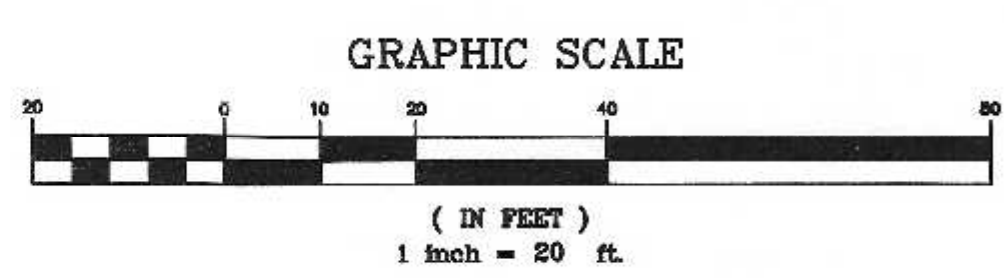

NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

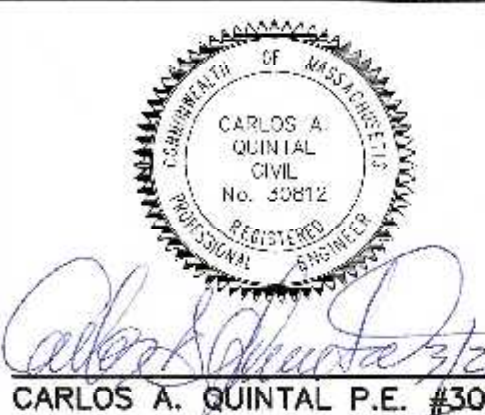

DATE	FIELD BY:	INT.
7/23	BL	
BK#	FIELD BOOK	PG#
1/24	RRG	
1/24	DESIGNED BY:	RRG
1/24	COMP	
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-384-6560 FAX 508-384-6566

DATE
JAN. 5, 2024
SCALE
1" = 20'
PROJECT
UC1587
SHEET
5 of 10

OPERATION AND MAINTENANCE PLAN

CONSTRUCTION PHASE

1. THE OWNERS REPRESENTATIVE, 110 EAST CENTRAL STREET RE, LLC 1-508-507-9020 SHALL BE THE RESPONSIBLE PARTY FOR THE STORMWATER MAINTENANCE PLAN.
2. THE SITE CONTRACTOR SHALL INSPECT ALL EROSION CONTROL MEASURES WEEKLY AND AFTER ALL RAIN EVENTS.
3. SEDIMENT SHALL BE REMOVED FROM COMPOST SOCK WHEN A MAXIMUM DEPTH OF 6" IS OBSERVED OR AS NEEDED.
4. CONSTRUCTION ENTRY MAT SHALL BE INSPECTED WEEKLY AND AFTER ALL RAIN EVENTS. SEE DETAIL FOR MAINTENANCE REQUIREMENTS.
5. DAMAGED OR DETERIORATED COMPOST SOCK AND/OR SILT FENCE AREAS SHALL BE REPLACED IMMEDIATELY.
6. EROSION CONTROL MEASURES SHALL REMAIN IN PLACE UNTIL CONSTRUCTION IS COMPLETED AND ALL DISTURBED AREAS ARE STABILIZED.
7. SILT SAKS SHALL BE INSTALLED AT ALL CATCH BASINS EXISTING AND PROPOSED AND SHALL BE INSPECTED WEEKLY AND AFTER ALL RAIN EVENTS.
8. CLEANING OF SILT SAKS SHALL BE COMPLETED AS NECESSARY.

INSPECTION AND MAINTENANCE SCHEDULE:

1. INSPECTIONS SHALL BE CONDUCTED BY THE APPLICANTS ENGINEER, CONTRACTOR AND / OR REPRESENTATIVES OF THE TOWN AS NECESSARY. AT A MINIMUM INSPECTIONS SHALL BE CONDUCTED ON A MONTHLY BASIS.
2. MONTHLY INSPECTIONS SHALL INCLUDE THE PARKING LOT SURFACE TO DETERMINE IF ACCUMULATED SEDIMENTS ARE TO BE REMOVED.
3. INSPECTION OF THE PROPOSED CATCH BASINS TO DETERMINE THE DEPTH OF SEDIMENT AND REQUIRED CLEANING.
4. INSPECTION OF PONDS 1 AND 2 TO DETERMINE IF CLEANING IS NECESSARY.
5. THE HEADWALL OUTLET RIPRAP SHALL BE INSPECTED WEEKLY AND ANY SEDIMENT OBSERVED SHALL BE IMMEDIATELY REMOVED.

OPERATION AND MAINTENANCE SCHEDULE

CONSTRUCTION PHASE:

1. THE EROSION CONTROL BARRIERS SHALL BE INSPECTED ON A WEEKLY BASIS AND AFTER ALL STORM EVENTS.
2. THE EXISTING PAVED PARKING AREAS AS WELL AS THE PROPOSED PARKING AREA ONCE PAVED WILL REQUIRE DAILY INSPECTIONS TO BE CONDUCTED TO DETERMINE THE NECESSITY TO REMOVE ANY ACCUMULATED SEDIMENT. THE REMOVAL OF THE ACCUMULATED SEDIMENT SHALL BE COMPLETED ON THE DAY THE DETERMINATION IS MADE.
3. SILT SAKS SHALL BE INSTALLED AT ALL CATCH BASINS. SILT SAKS, ONCE INSTALLED SHALL BE INSPECTED ON A WEEKLY BASIS AND CLEANED AS NECESSARY.
4. THE WATER QUALITY UNIT SHALL BE INSPECTED ON A WEEKLY BASIS AND CLEANED WHEN THE SEDIMENT DEPTH REACHES 8"
5. THE PONDS SHALL BE INSPECTED AFTER EACH STORM EVENT AND CLEANED WHEN 2" OF SEDIMENT HAS ACCUMULATED AT THE INLET. ANY TRASH OR CONSTRUCTION DEBRIS SHALL BE IMMEDIATELY REMOVED.
6. IMMEDIATELY UPON COMPLETION OF SITE GRADING ACTIVITIES OF PROPOSED LANDSCAPED AREA, THE AREAS SHALL HAVE LOAM APPLIED AND SHALL BE SEEDDED.
7. ALL MATERIAL STOCKPILES THAT ARE NOT BEING ACTIVELY USED FOR A PERIOD OF 2 WEEKS SHALL BE COVERED WITH A TARP(S) OR VEGETATED.

ADDITIONAL EROSION CONTROLS MAY BE REQUIRED DEPENDING ON ACTUAL FIELD CONDITIONS DURING CONSTRUCTION.

LONG TERM:

1. THE PARKING LOT SHALL BE SWEEPED FOUR TIMES PER YEAR WITH ONE BEING AFTER THE LAST WINTER SANDING.
2. THE CATCH SHALL BE INSPECTED 4 TIMES PER YEAR AND SEDIMENT REMOVED WHEN THE DEPTH REACHES 24 INCHES.
3. THE PONDS SHALL BE INSPECTED AND PREVENTIVE MAINTENANCE PERFORMED TWICE PER YEAR. THE PONDS SHALL BE INSPECTED AFTER EVERY STORM EVENT EXCEEDING 1 INCH OF RAINFALL FOR THE FIRST 3 MONTHS AND THEN TWICE PER YEAR THEREAFTER AND WHEN THERE ARE DISCHARGES THROUGH THE HIGH OUTLET.
4. DURING INSPECTIONS OF STORM-WATER FACILITIES ANY TRASH OR DEBRIS DISCOVERED SHALL BE IMMEDIATELY REMOVED.

EROSION CONTROL NOTES:


1. COMPOST SOCK AND SILT FENCE SHALL BE INSTALLED PRIOR TO TREE CLEARING OR SITE WORK COMMENCING.
2. COMPOST SOCK AND SILT FENCE TO REMAIN IN CONTACT WITH THE EARTH. REPAIR OR RESET AS NECESSARY.
3. REFER TO CONSTRUCTION SEQUENCE FOR SLOPE GREATER THAN 3' HORIZONTAL TO 1' VERTICAL.
4. CATCH BASINS, UNDERGROUND POND AND PARKING AREA TO BE CLEANED ONCE CONSTRUCTION IS COMPLETED.
5. ALL SEDIMENT COLLECTED DURING THE CONSTRUCTION PHASE OR POST CONSTRUCTION PHASE SHALL BE DISPOSED OF TO AN APPROVED LOCATION.
6. AFTER ALL DISTURBED AREAS HAVE BEEN STABILIZED THE EROSION CONTROL MEASURES SHALL BE REMOVED.
7. DAMAGED OR DETERIORATED EROSION CONTROL MEASURES SHALL BE REPAIRED OR REPLACED IMMEDIATELY AFTER THEY HAVE BEEN IDENTIFIED.
8. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INSPECTIONS.
9. DUST CONTROL WILL BE BY SPRAYING WATER AS NECESSARY. THE USE OF OILS, PETROLEUM PRODUCTS OR TOXIC LIQUIDS FOR DUST CONTROL IS PROHIBITED.
10. SILT FENCE TO BE REMOVED AT THE APPROVAL OF THE CONSERVATION AGENT, PRIOR TO THE ISSUANCE OF A CERTIFICATE OF COMPLIANCE.

LEGEND:

- 297-- EXISTING CONTOUR
- 297- PROPOSED CONTOUR
- x274.3 SPOT GRADE - PROPOSED
- x274.3EX. SPOT GRADE - EXISTING
- 48M EXIST. TREE - DIAMETER - SPECIES
- UTILITY POLE
- OVERHEAD WIRES
- GAS GATE
- WATER CURB STOP
- WATER GATE
- FIRE HYDRANT
- DRAIN MANHOLE
- CATCH BASIN
- SEWER MANHOLE
- D DUMPSTER
- VCC VERTICAL CONCRETE CURBING (REINFORCED)
- VGC VERTICAL GRANITE CURBING
- ⊕ HANDICAP PARKING SPACE
- BUILDING MOUNTED LIGHT
- BOLLARD
- M MONITOR WELL

CONSTRUCTION SEQUENCE:

1. INSTALL EROSION CONTROL AND SIGN.
2. COMPLETE THE CLEARING, STUMP REMOVAL AND REMOVE LOAM AND SUBSOIL.
3. REMOVE EXISTING UTILITIES AND RAZE THE EXISTING 110 EAST CENTRAL STREET BUILDING.
4. EXCAVATE THE FOUNDATION HOLE, FORM AND POUR THE FOUNDATION AND THEN BACKFILL FOUNDATION.
5. INSTALL SITE UTILITIES. THE STORMWATER SYSTEM SHALL BE INSTALLED WITH EXCESS MATERIAL BEING REMOVED FROM THE SITE AND NECESSARY CONSTRUCTION MATERIALS DELIVERED TO THE SITE. MINIMIZE THE USE OF MATERIAL STOCKPILE AREA.
6. CONSTRUCT RETAINING WALLS. IF NECESSARY, POND 2 MAY NEED TO BE INSTALLED CONCURRENTLY WITH THE CONSTRUCTION OF RETAINING WALL 6.
7. BRING THE SITE TO SUBGRADE.
8. INSTALL A BINDER COURSE OF PAVEMENT. CONSTRUCT THE SITE WALKWAYS.
9. CURBING SHALL BE INSTALLED.
10. LANDSCAPING SHALL BE PLANTED AND ALL DISTURBED AREAS SHALL BE LOAMED AND SEEDDED. (THE AREA BETWEEN THE RETAINING WALL AND THE LIMIT OF WORK SHALL BE PLANTED WITH A CONSERVATION AND WILDLIFE MIX).

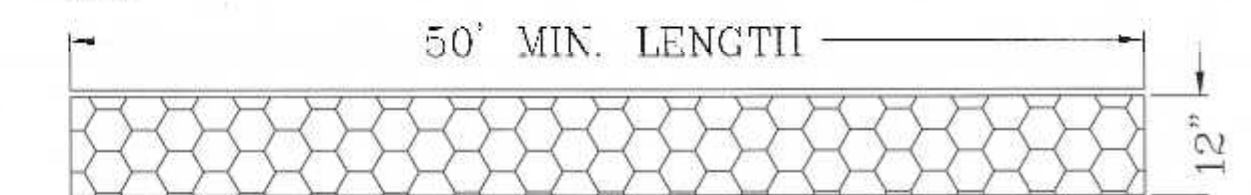

ENTRY SEDIMENTATION CONTROL MAT SECTION N.T.S.

NOTES:

1. PAD SHALL BE A MINIMUM OF 20 FEET IN WIDTH. EXISTING ASPHALT DRIVE TO REMAIN IN PLACE UNTIL FINAL PAVEMENT IS TO BE INSTALLED.
2. PAD SHALL CONSIST OF 4" STONE 8" MIN. DEPTH AND THEN TOP DRESSED WITH 4" OF 1" - 2" WASHED STONE.

SITE PLAN
EROSION CONTROL PLAN
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'



UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-884-8560 FAX 508-884-8566

DATE	JAN. 5, 2024
SCALE	1" = 20'
PROJECT	UC1587
SHEET	6 of 10

DATE	7/23	FIELD BY:	BL
BK#	1/24	FIELD BOOK PG#	
	1/24	CALCS BY:	RRG
	1/24	DESIGNED BY:	RRG
	1/24	DRAWN BY:	COMP
	1/24	CHECKED BY:	CAQ


CARLOS A. QUINTAL P.E. #30812

NO.	DATE	REVIEW COMMENTS	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG
		DESCRIPTION	

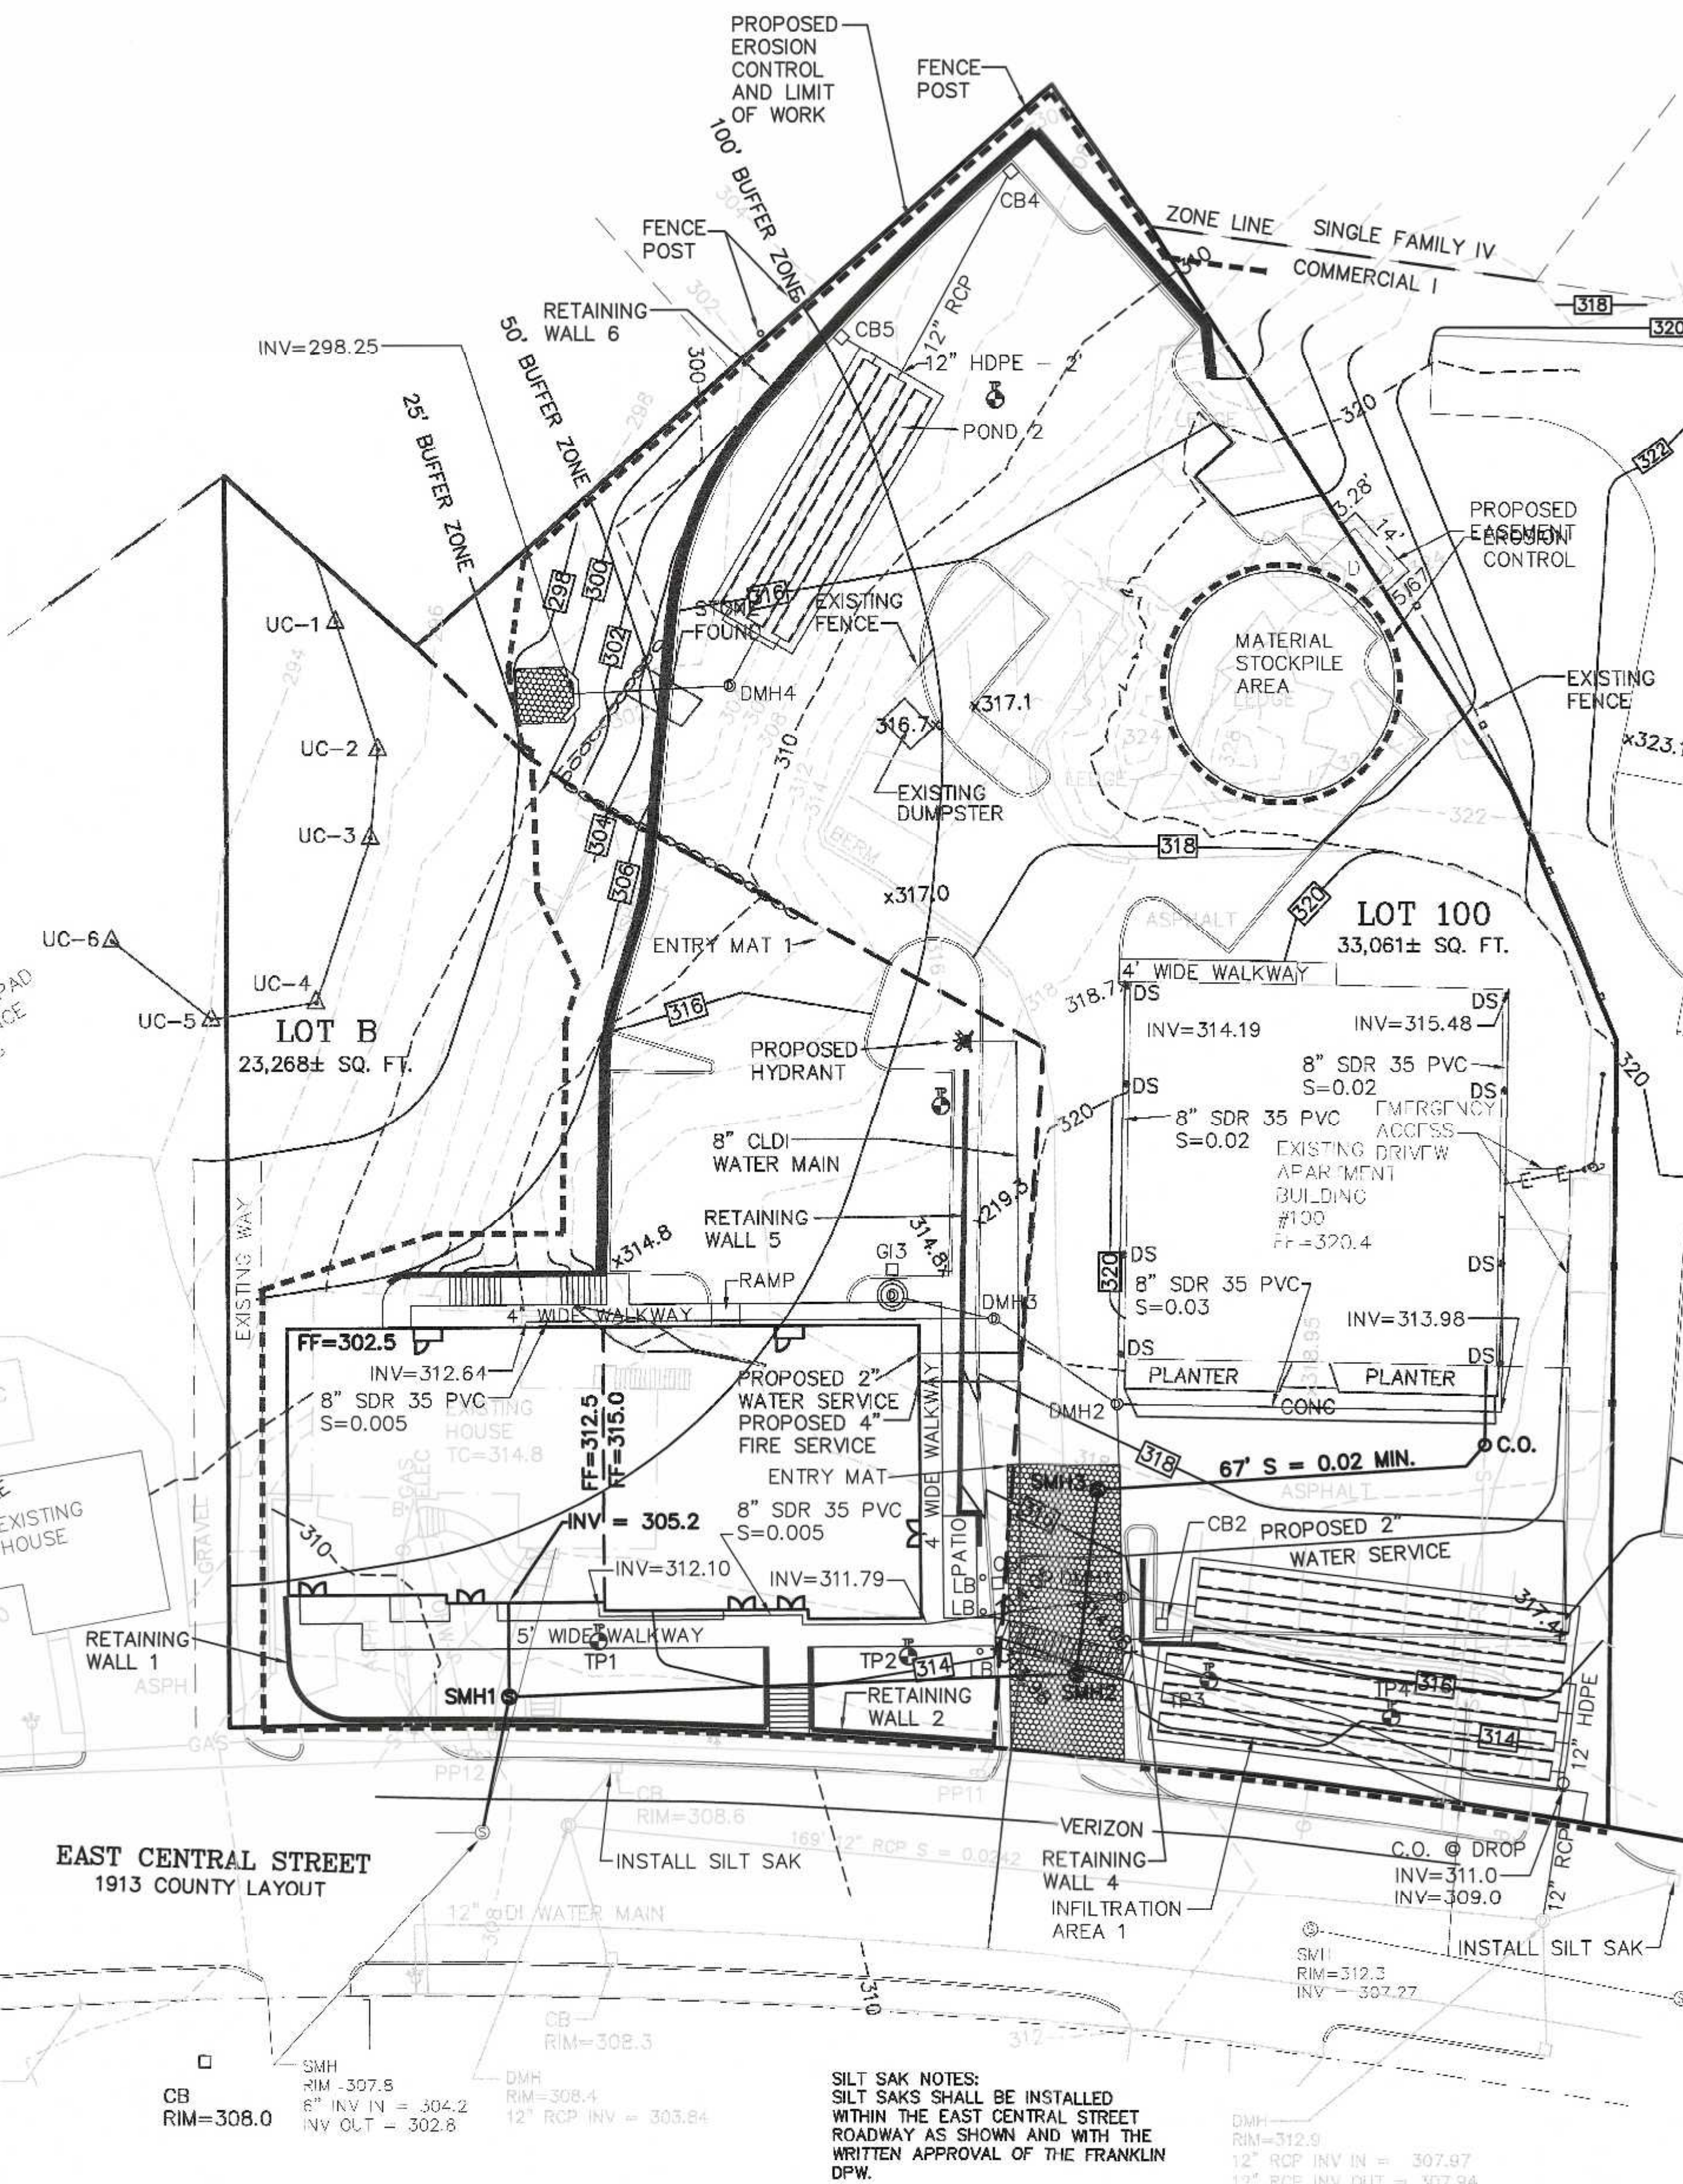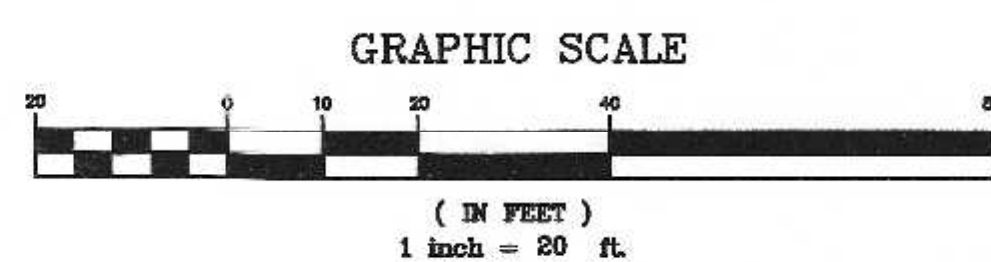


SILT SAK NOTES:
 SILT SAKS SHALL BE INSTALLED WITHIN THE EAST CENTRAL STREET ROADWAY AS SHOWN AND WITH THE WRITTEN APPROVAL OF THE FRANKLIN DPW.


SITE PLAN APPROVAL REQUIRED
FRANKLIN PLANNING BOARD
 DATE _____

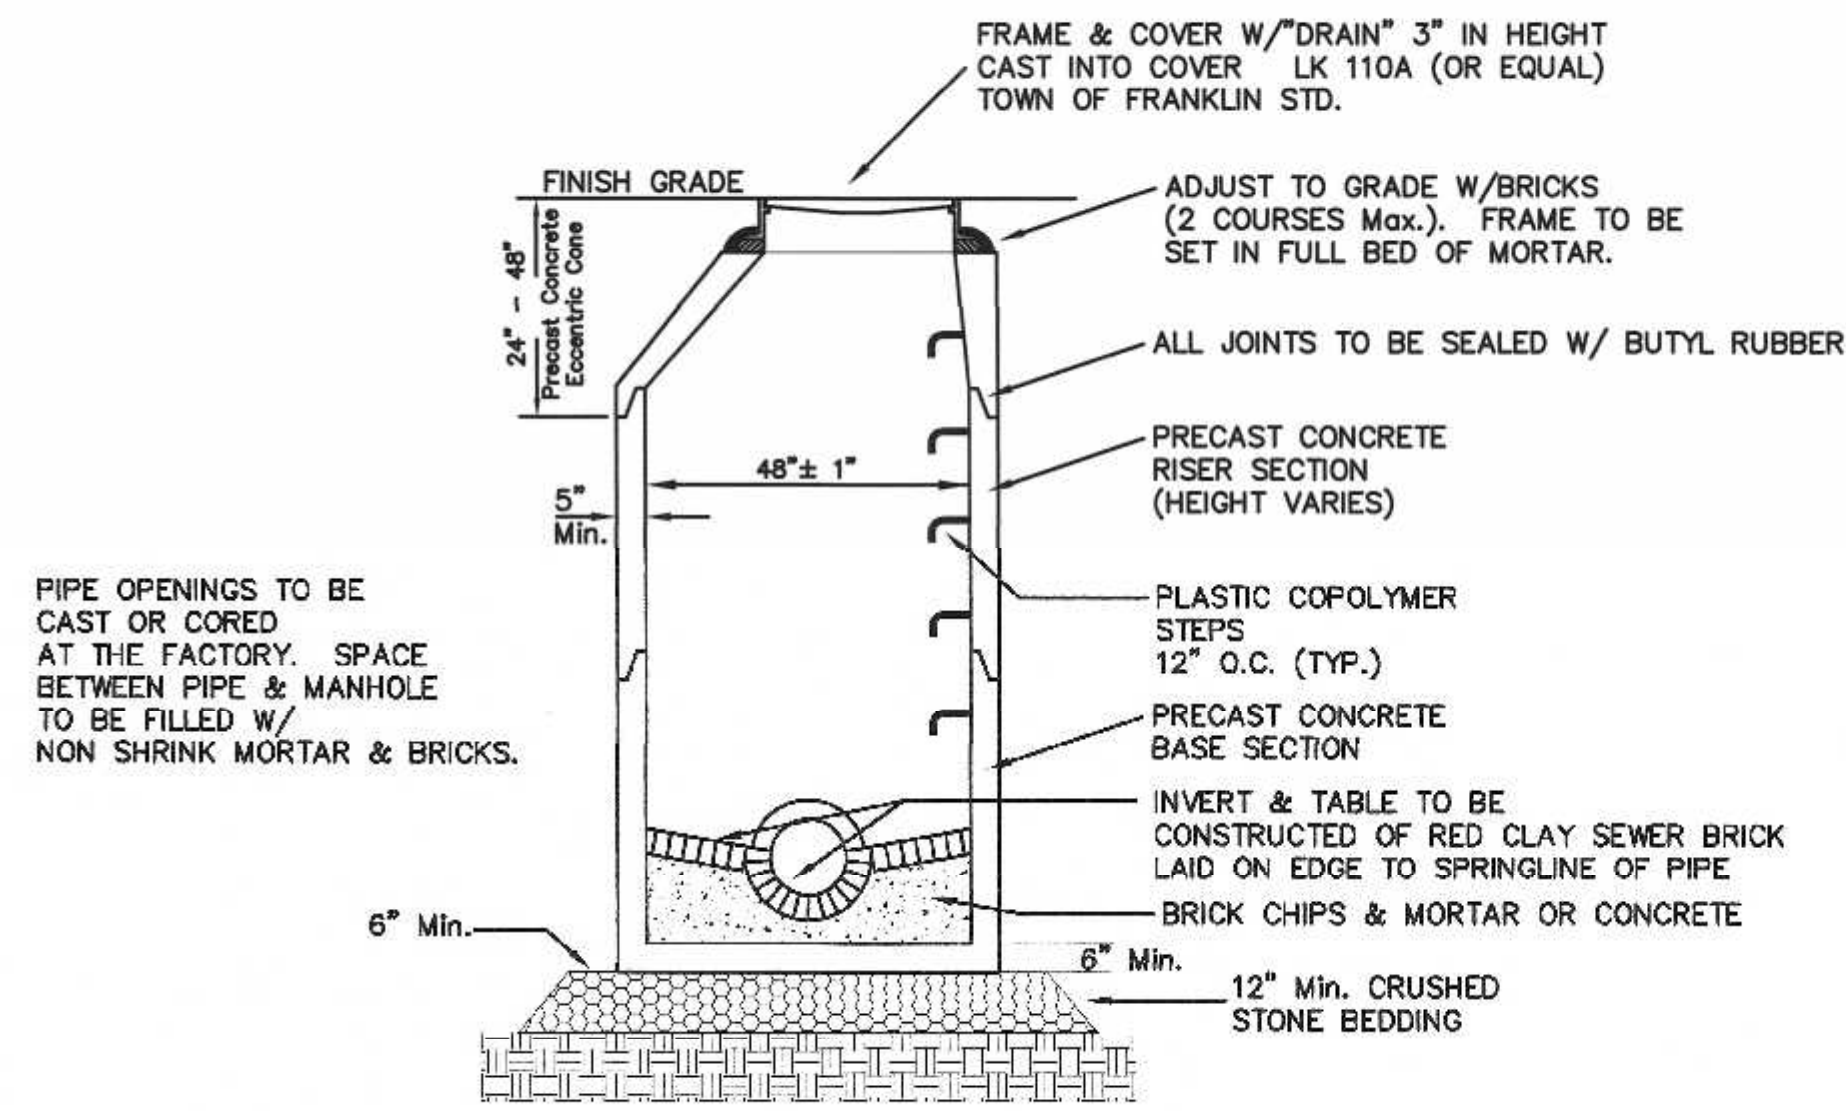


PRECAST DRAIN MANHOLE

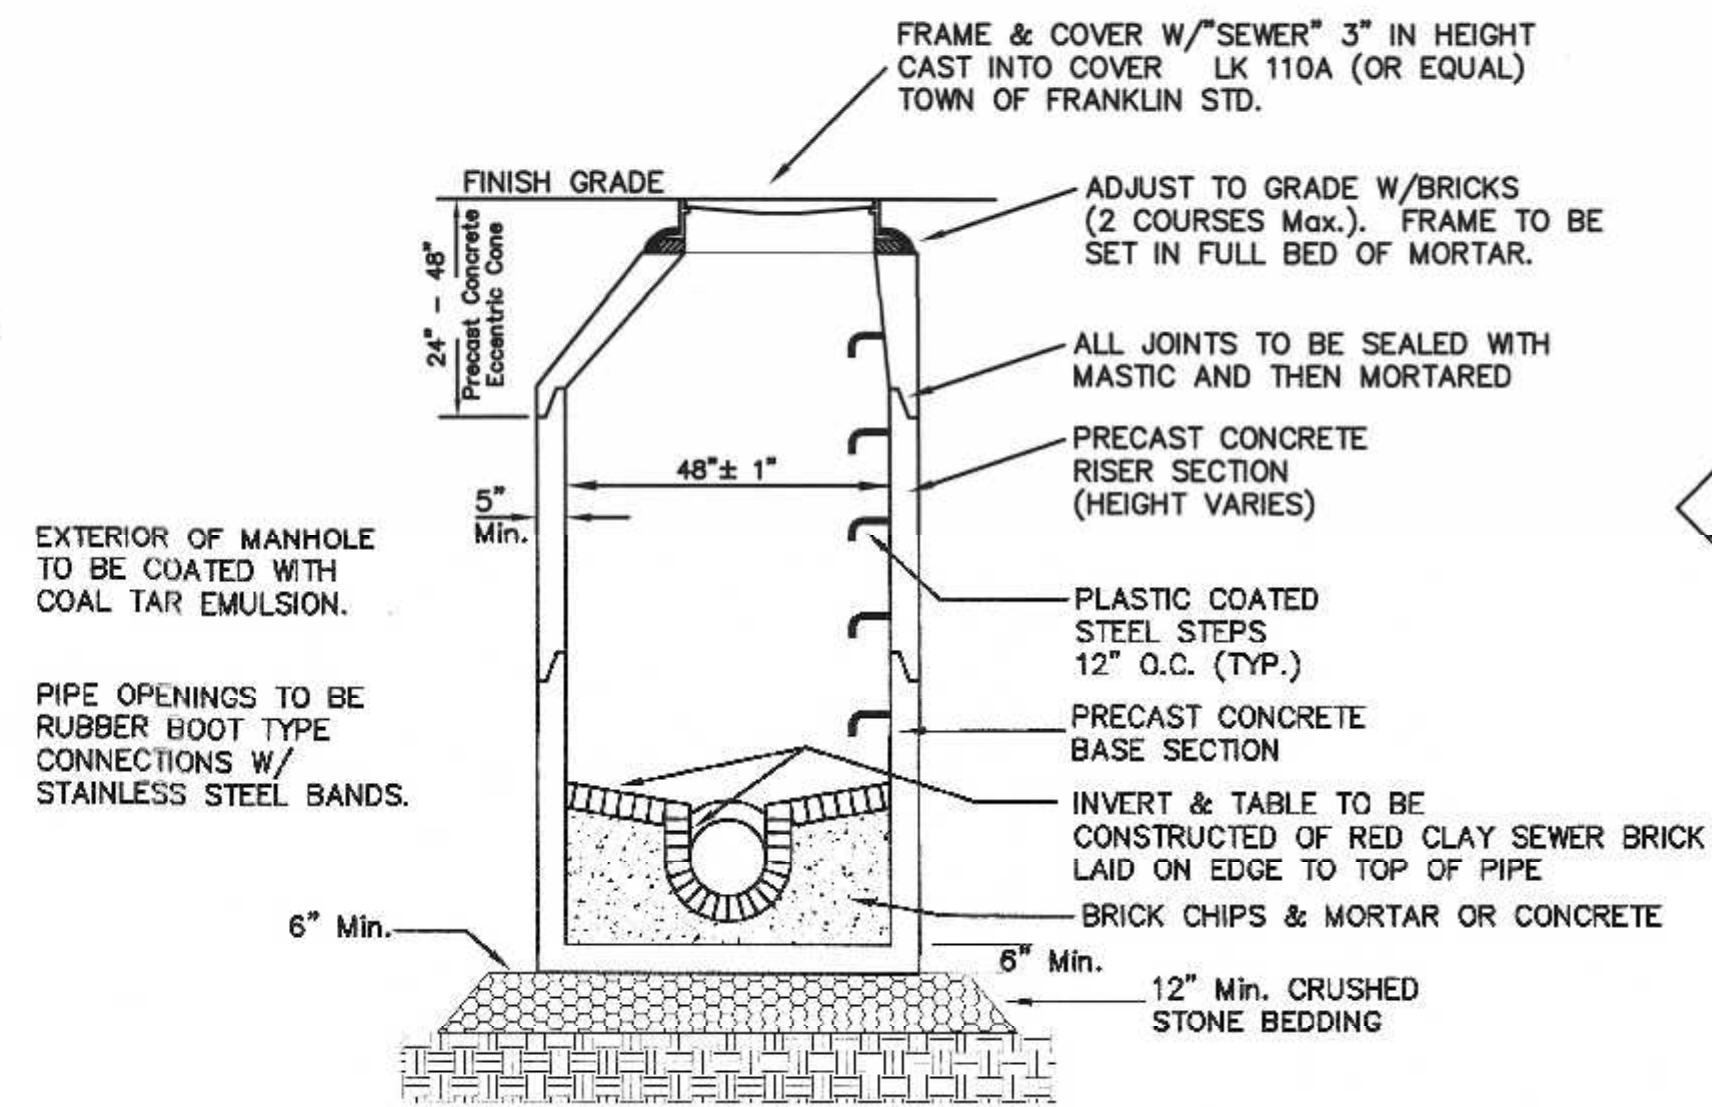

PRECAST SEWER MANHOLE

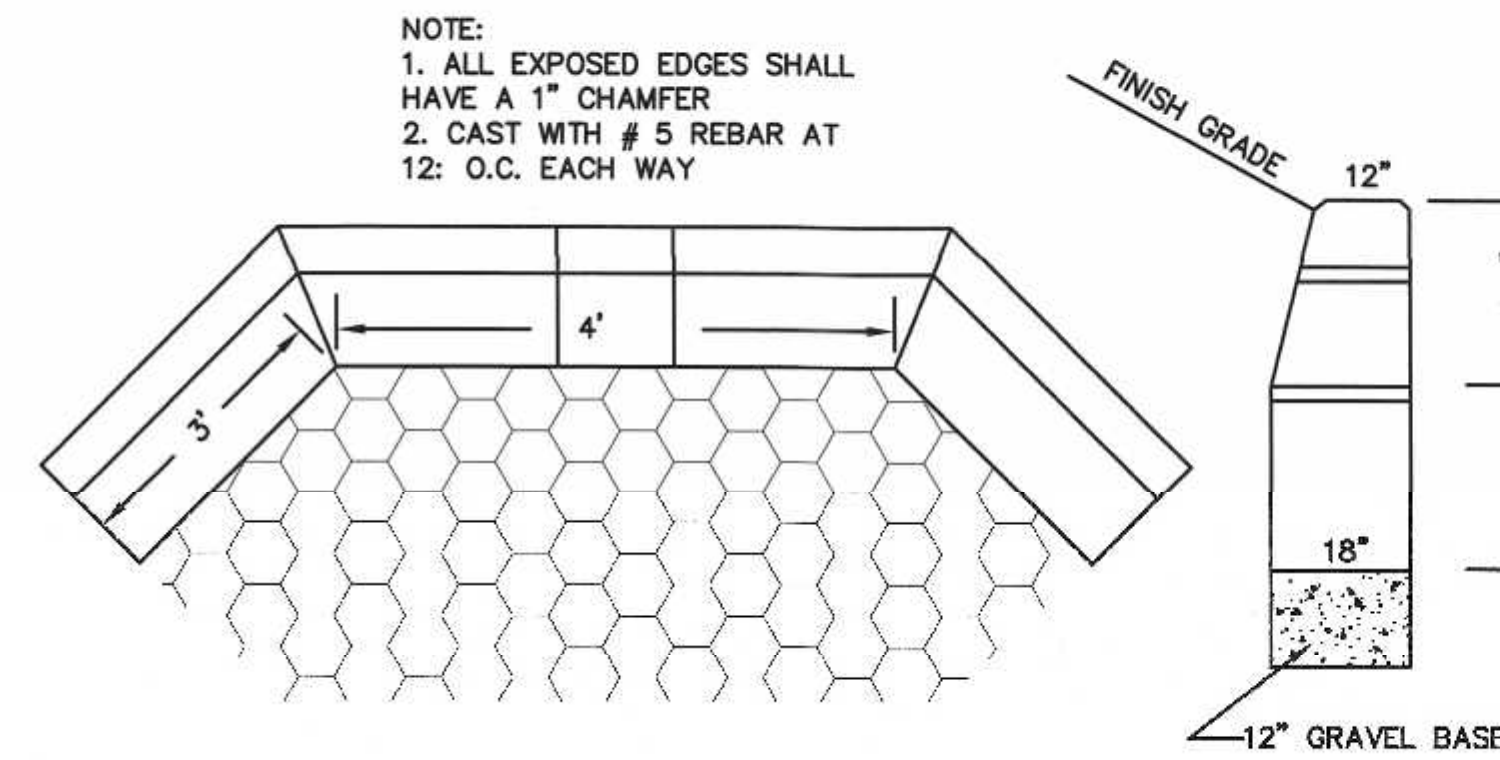


PRECAST HEADWALL
SITUATE COMPANIES OR APPROVED EQUAL

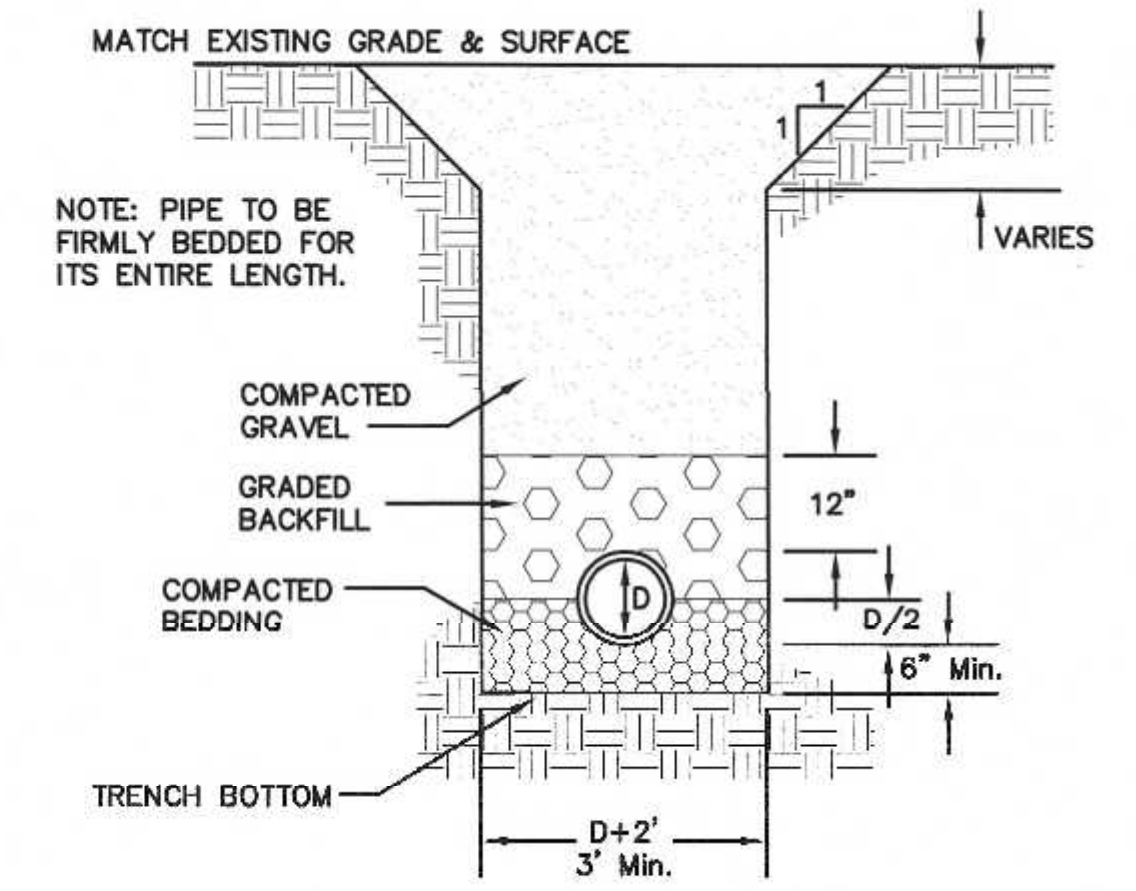

TYPE OF PIPE	RCP DRAIN	GLDI WATER	PVC SEWER	D.I. SEWER
BEDDING MATERIAL	PROC. GRAVEL	SAND	3/4" STONE	3/8" STONE
BACKFILL MATERIAL	ORD. FILL	SAND	3/4" STONE	3/8" STONE

UTILITY TRENCH DETAIL

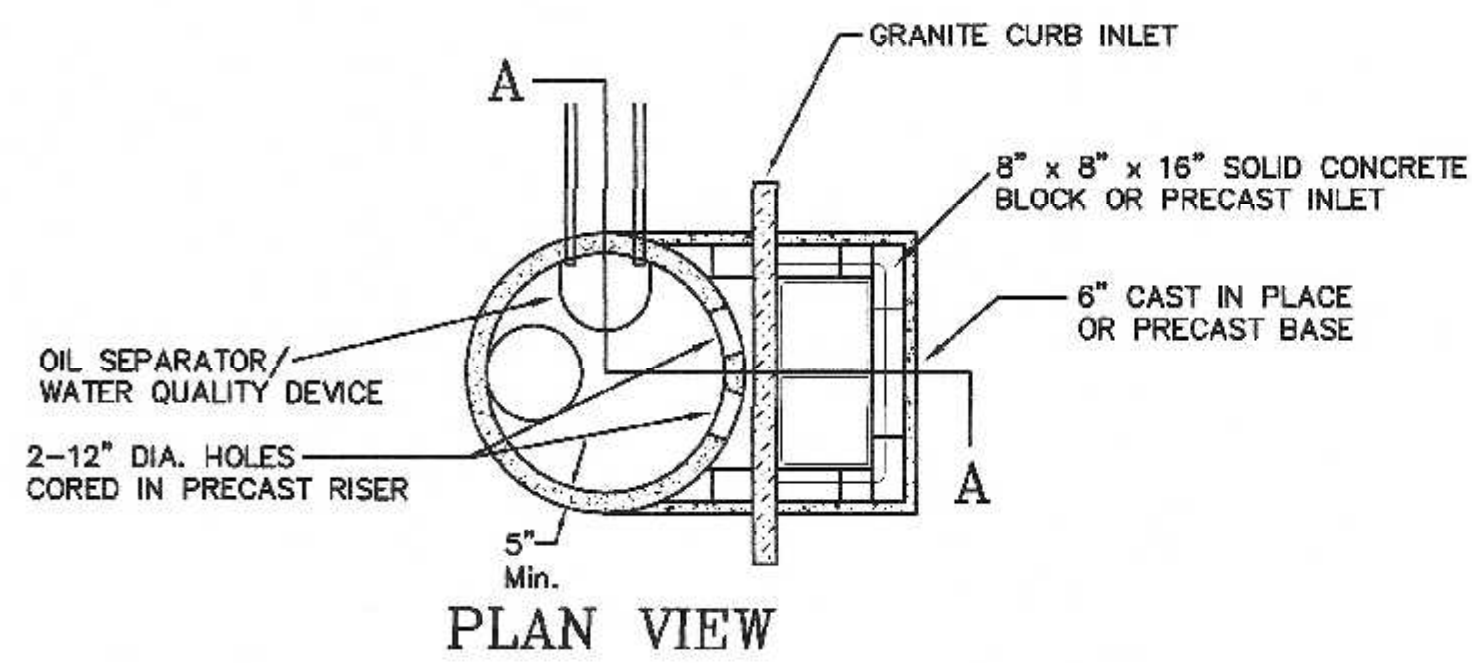


PLAN VIEW


CONSTRUCTION NOTES:
 1. RIP RAP TO BE MAXIMUM OF 14" AVERAGE OF 9" AND MINIMUM OF 6"
 2. RIP RAP TO BE PLACED OVER A FILTER FABRIC.
 3. RIP RAP MINIMUM DEPTH SHALL BE 18"

REFERENCE TECHNICAL SUPPLEMENT 14C - US BUREAU OF RECLIMATION METHOD.


$$D50 = 0.0122 \times 7.31^{2.06} = 0.73$$

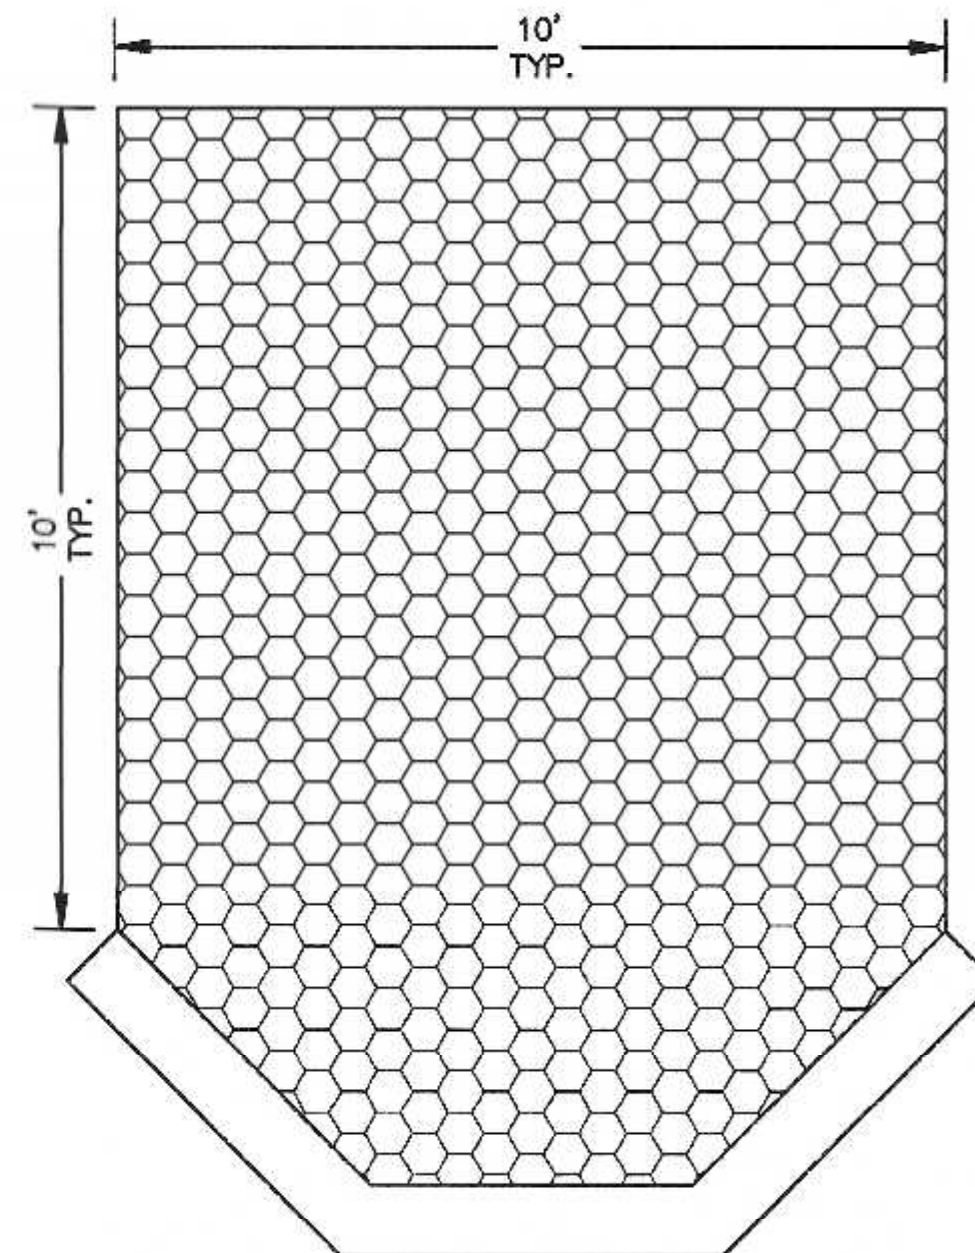


RIP RAP AT HEADWALL
N.T.S.

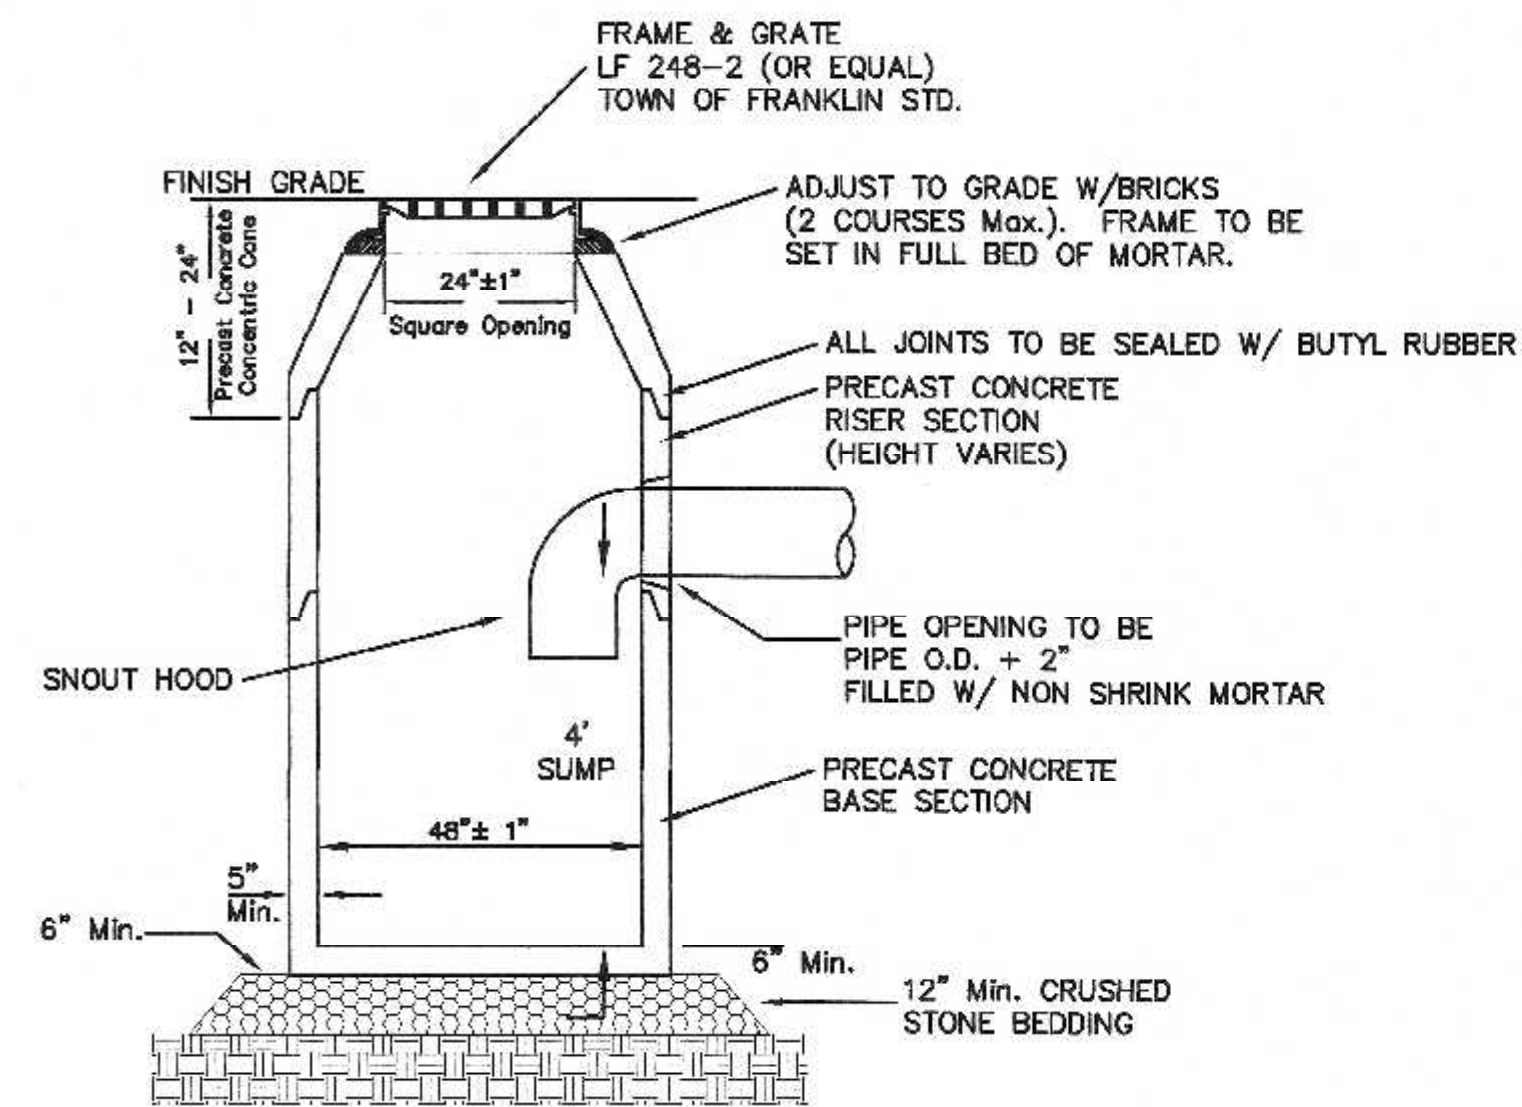


PRECAST CATCH BASIN
CB - 1, 2, 4 and 5

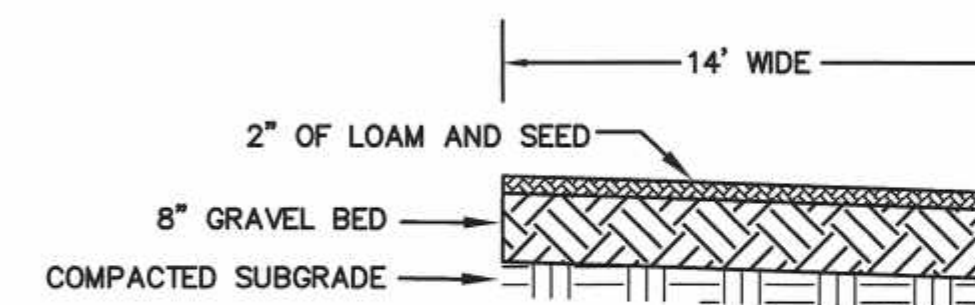

EMERGENCY ACCESS DRIVE

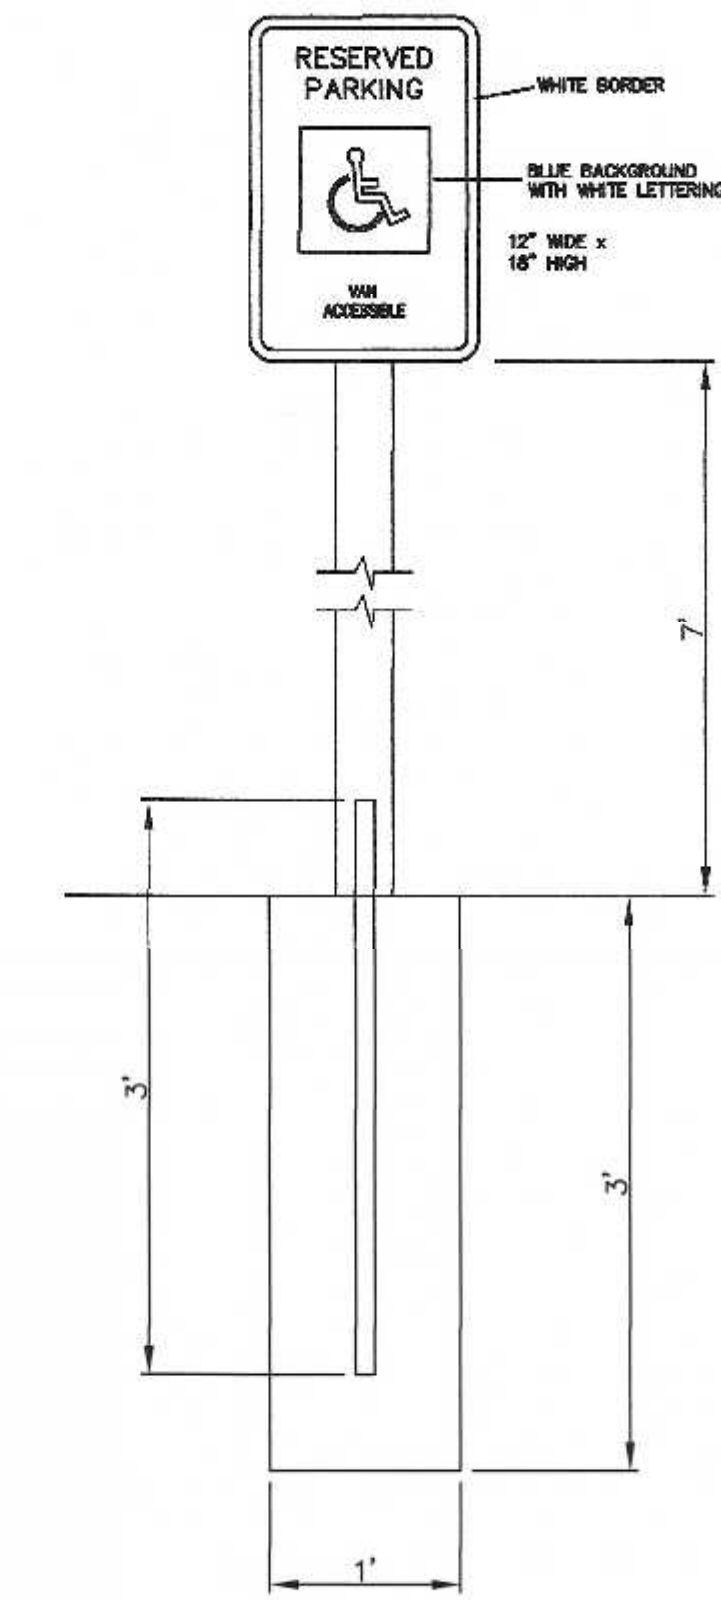

VAN ACCESSIBLE HANDICAP SIGN DETAIL
N.T.S.

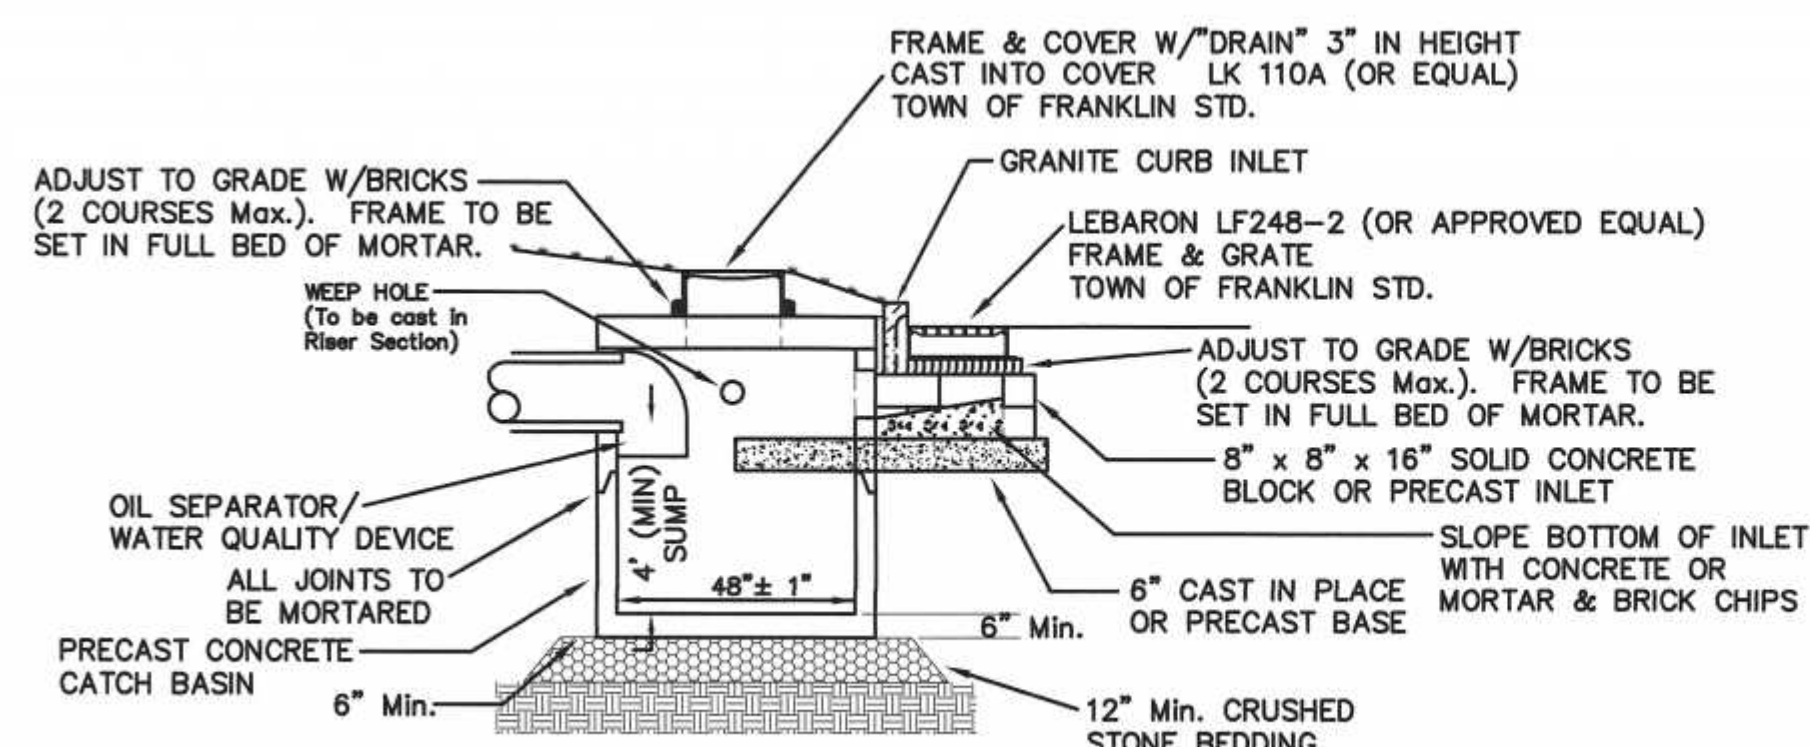

SECTION A-A


DOUBLE GRATE PRECAST GUTTER INLET W/ DEEP SUMP
CB - 3

NOTES:
 1. CONTRACTOR TO CONTACT DIGSAFE PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 2. CONTRACTOR TO VERIFY LOCATIONS OF EXISTING UTILITIES ANY REPORT ANY DISCREPANCIES TO UNITED CONSULTANTS, INC.
 3. ALL WORK SHALL CONFORM TO THE TOWN OF FRANKLIN DPW STANDARDS.
 4. MAINTAIN A MINIMUM OF 10' SEPARATION FROM THE WATER SERVICE TO THE SEWER SERVICE.

SITE PLAN
 CONSTRUCTION DETAILS - 1
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'

SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

DATE

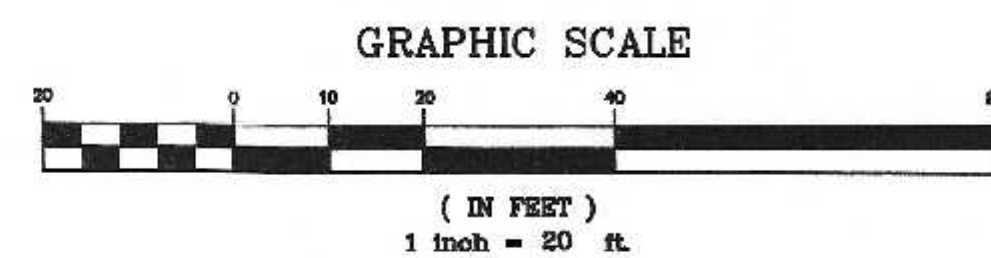


NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG




DATE	FIELD BY:	INT.
7/23	FIELD BOOK	BL
1/24	CALCS BY:	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-384-8580 FAX 508-384-8586


DATE	JAN. 5, 2024
SCALE	1" = 20'
PROJECT	UC1587
SHEET	7 of 10

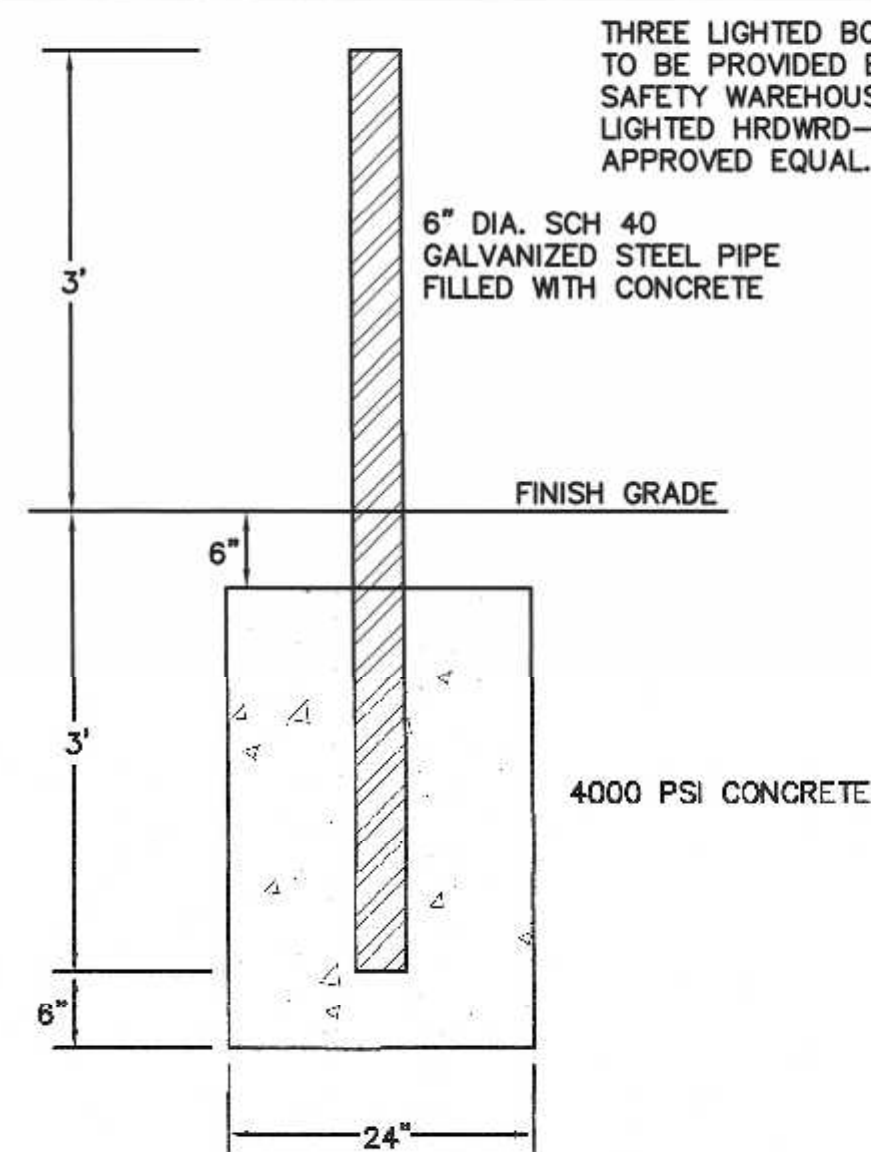


BOLLARD DETAIL

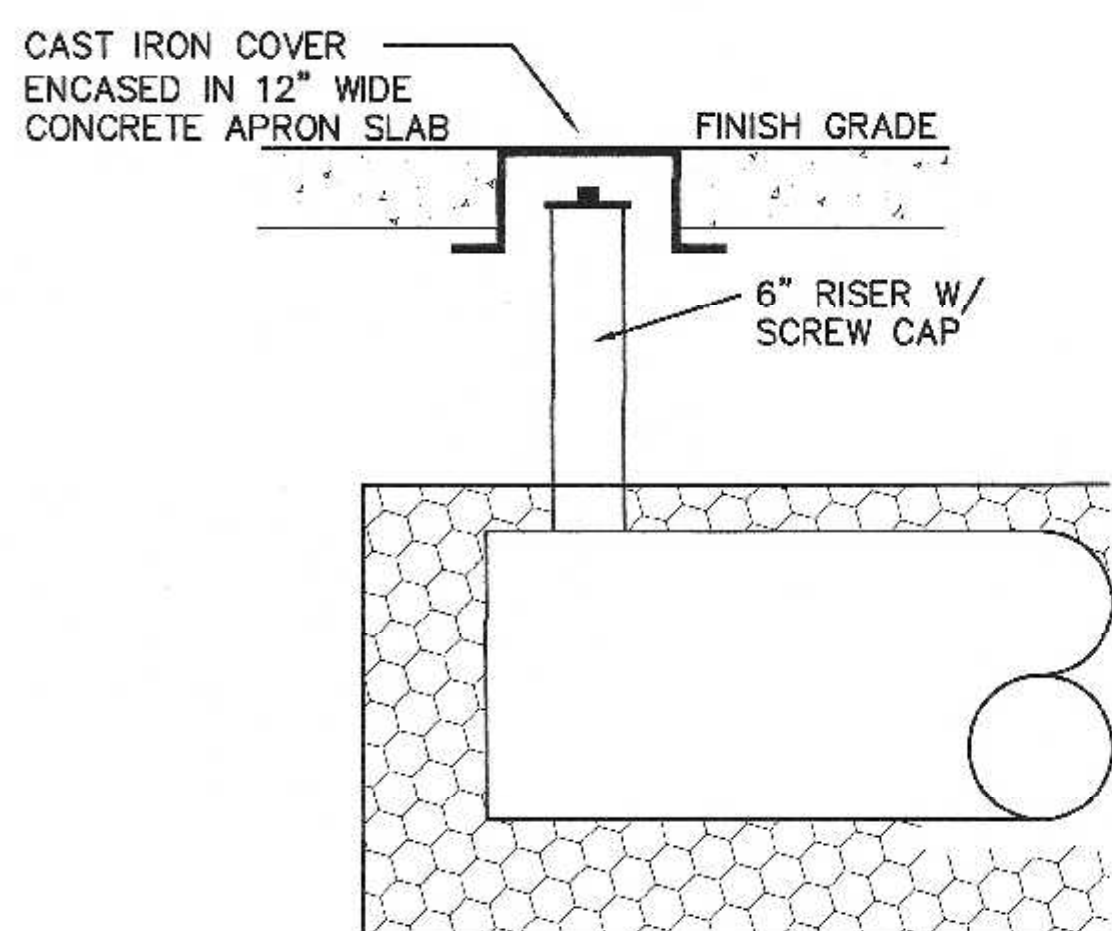


INSPECTION PORT DETAIL
DRAINAGE INFILTRATION AREAS
N.T.S.

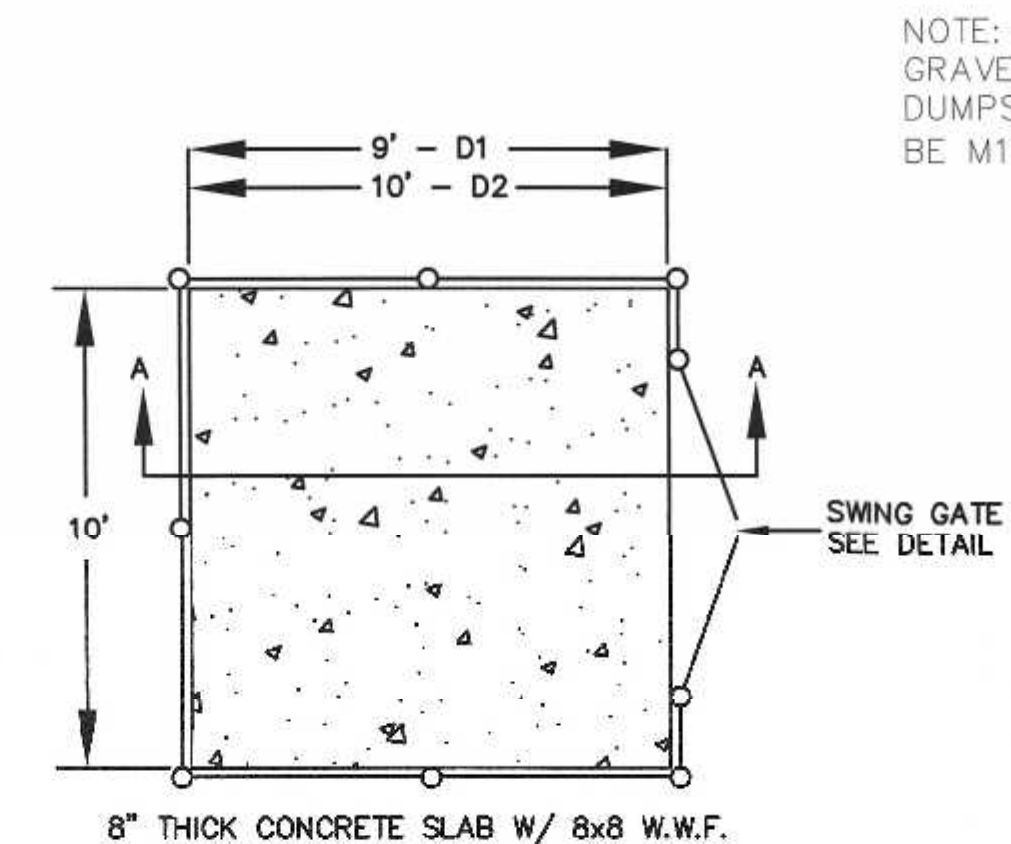


CONCRETE DUMPSTER PAD

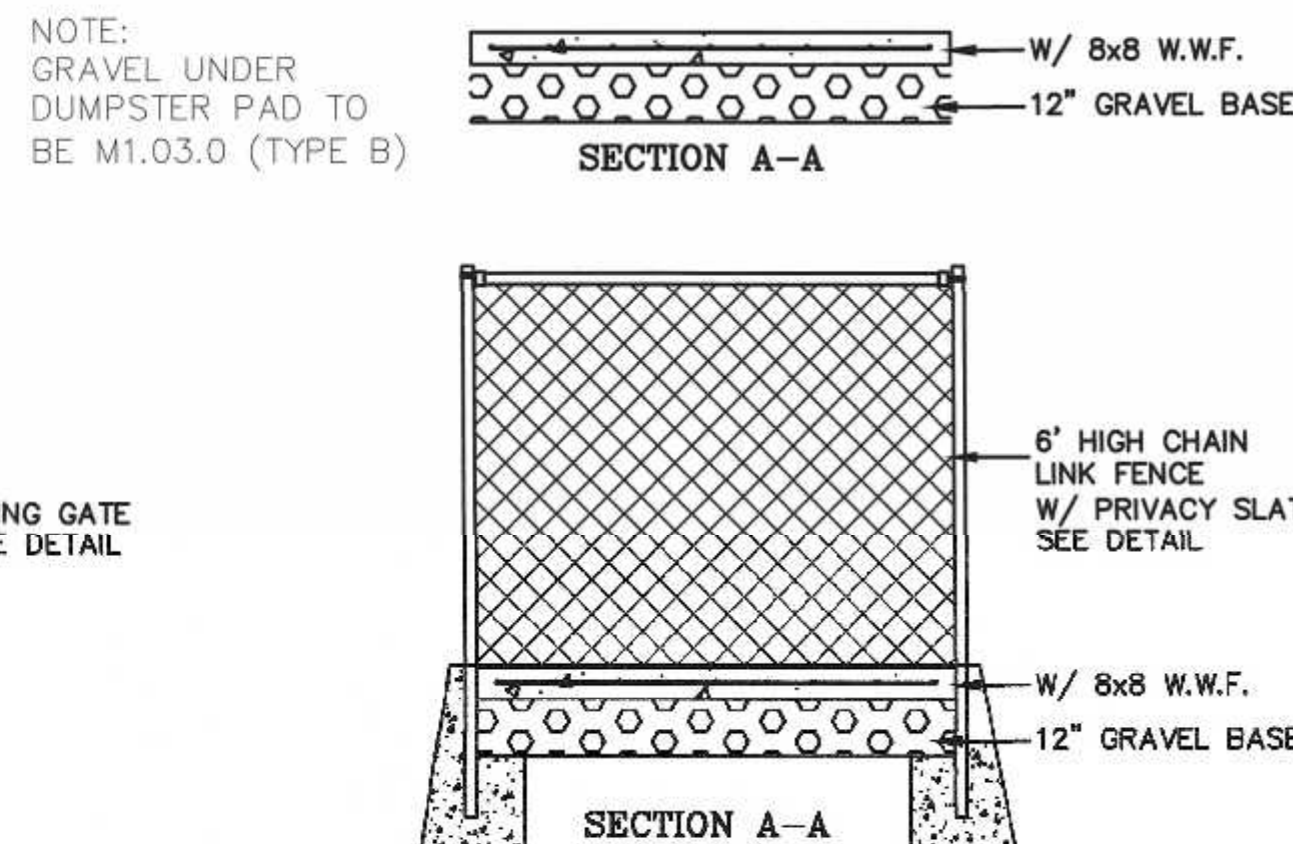

DUMPSTER AREA FENCE

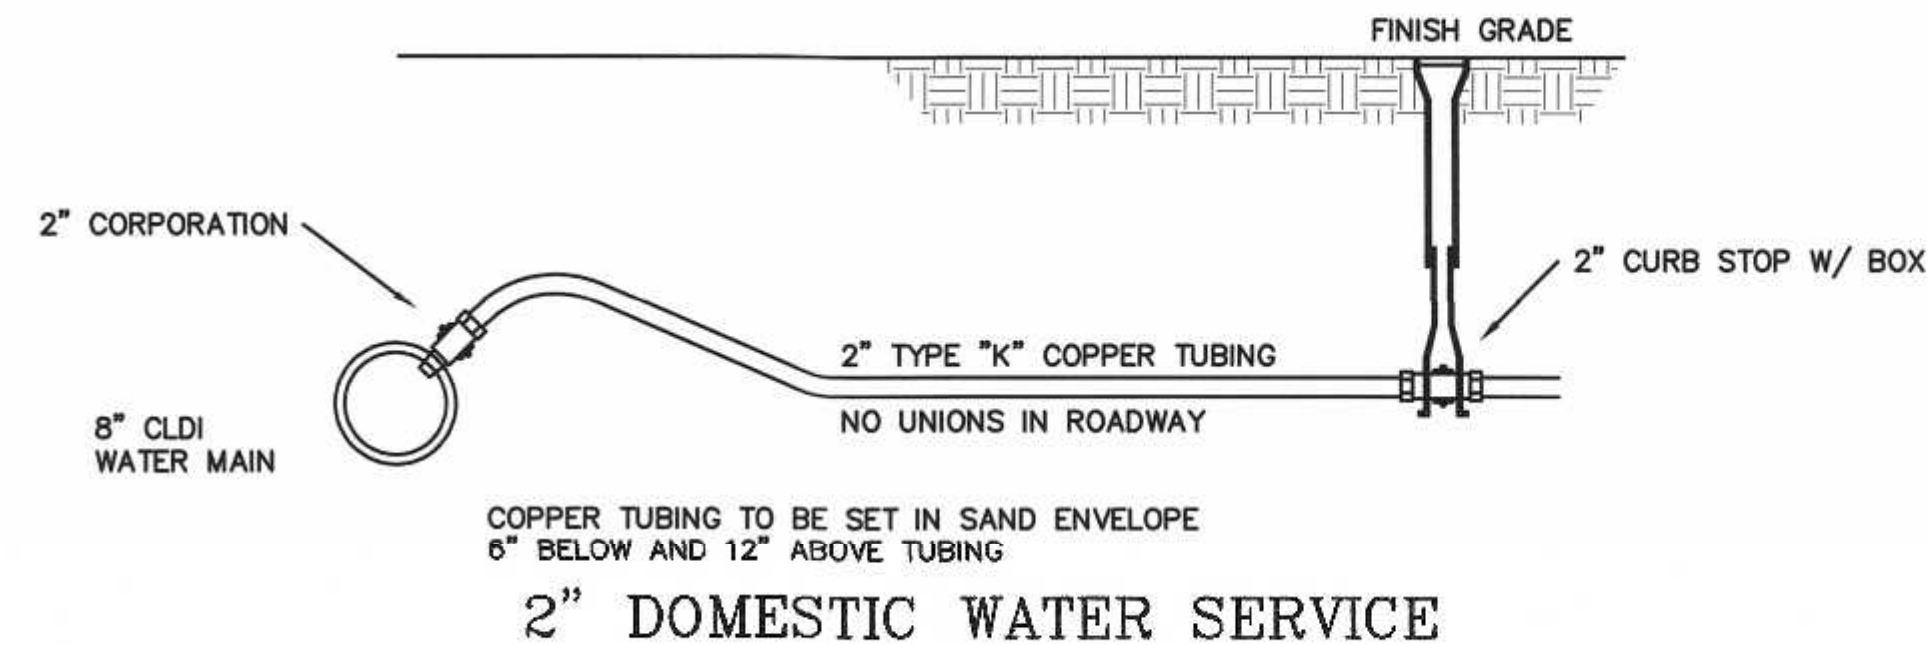

2" DOMESTIC WATER SERVICE

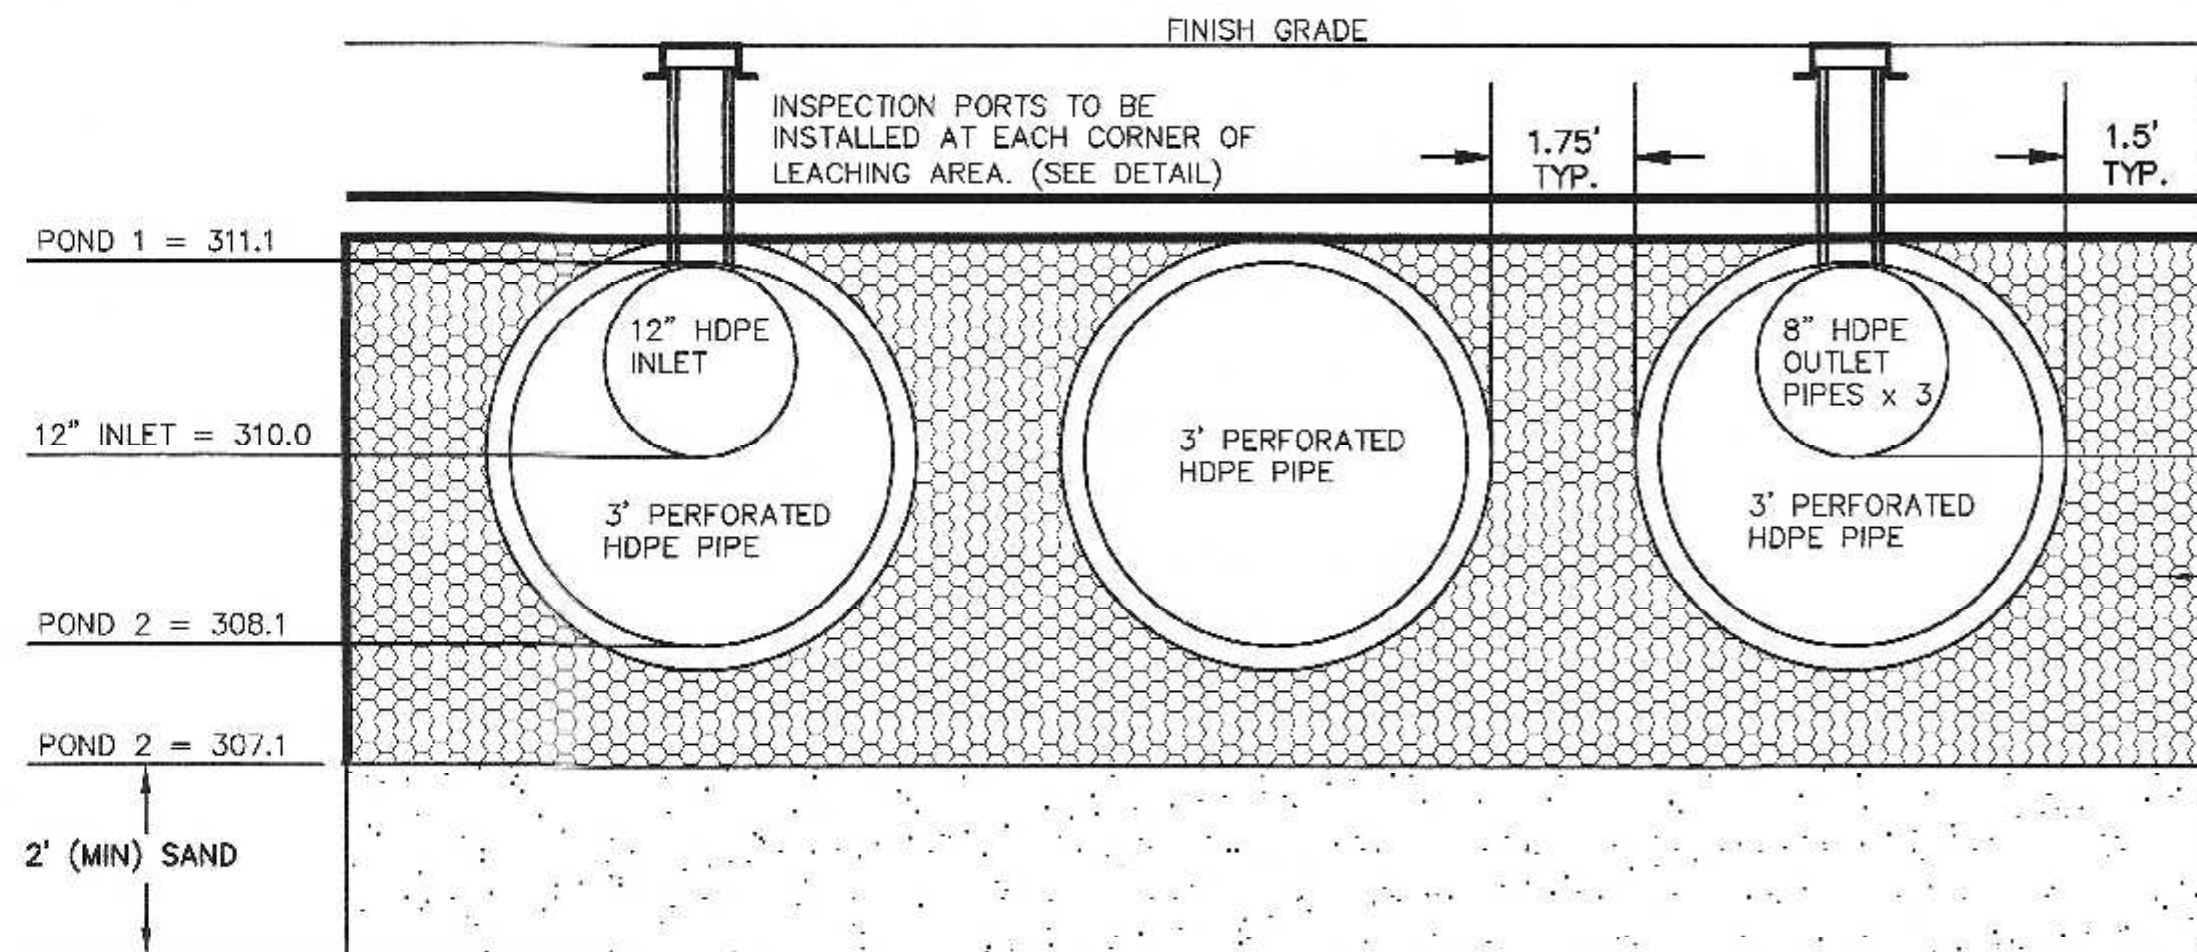

POND - 2

NOTE:
POND CONSISTS OF
3 ROWS OF 3' DIAMETER PERFORATED HDPE PIPE
AT 40' IN LENGTH.
STONE EXTENTS 17.0' x 43'


THE DESIGN ENGINEER
SHALL INSPECT THE
EXCAVATION OF THE
SOIL INFILTRATION AREA
PRIOR TO ANY FILL
BEING PLACED.

Fill material for pond 2 and if necessary infiltration pond 1 in fill shall consist of imported soil material. The fill shall be comprised of clean granular sand, free from organic matter and deleterious substances. Mixtures and layers of different classes of soil shall not be used. The fill shall not contain any material larger than two inches. A sieve analysis, using a #4 sieve, shall be performed on a representative sample of the fill. Up to 45% by weight of the fill sample may be retained on the #4 sieve. Sieve analyses also shall be performed on the fraction of the fill sample passing the #4 sieve, such analyses must demonstrate that the material meets each of the following specifications:


SEIVE SIZE	EFFECTIVE PARTICLE SIZE	% THAT MUST PASS SEIVE
# 4	4.75 mm	100%
# 50	0.30 mm	10% - 100%
#100	0.15 mm	0% - 20%
#200	0.075 mm	0% - 5%

If required by the local approving authority, a minimum of one representative sample may be taken from the in-place fill and tested for compliance with the grain size distribution specification. Where fill is required to replace unsuitable or impermeable soils, the excavation of the unsuitable material shall extend a minimum of five feet laterally in all directions beyond the outer perimeter of the pond to the depth of naturally occurring pervious material and replaced with fill material meeting the specifications of 310 CMR 15.255(3).

Prior to placement of the fill, the bottom surface of the excavation shall be scarified and relatively dry. Fill shall not be placed during rain or snow storms. If the water table elevation is above the elevation of the bottom of the excavation, the excavation shall be dewatered as necessary.

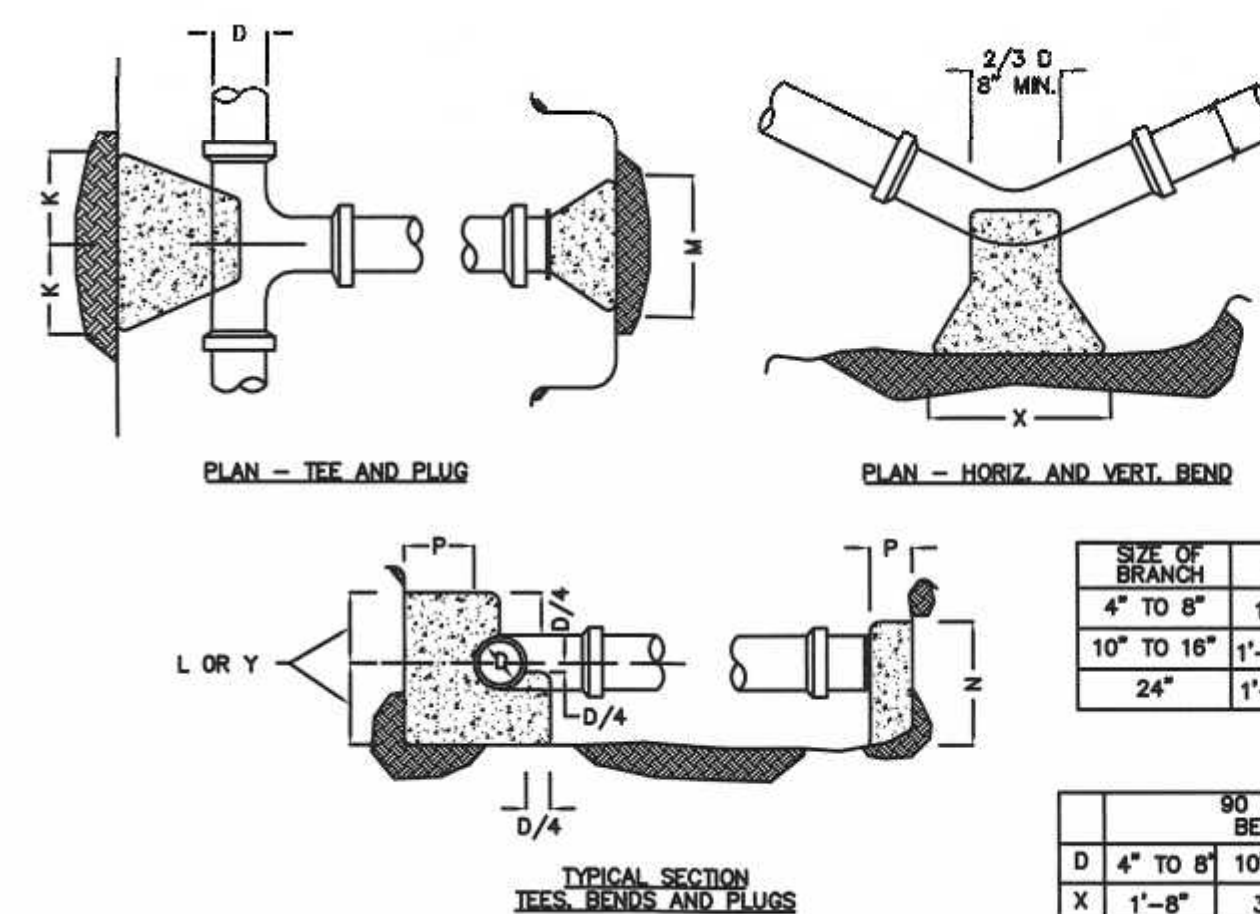

THRUST BLOCK DETAILS

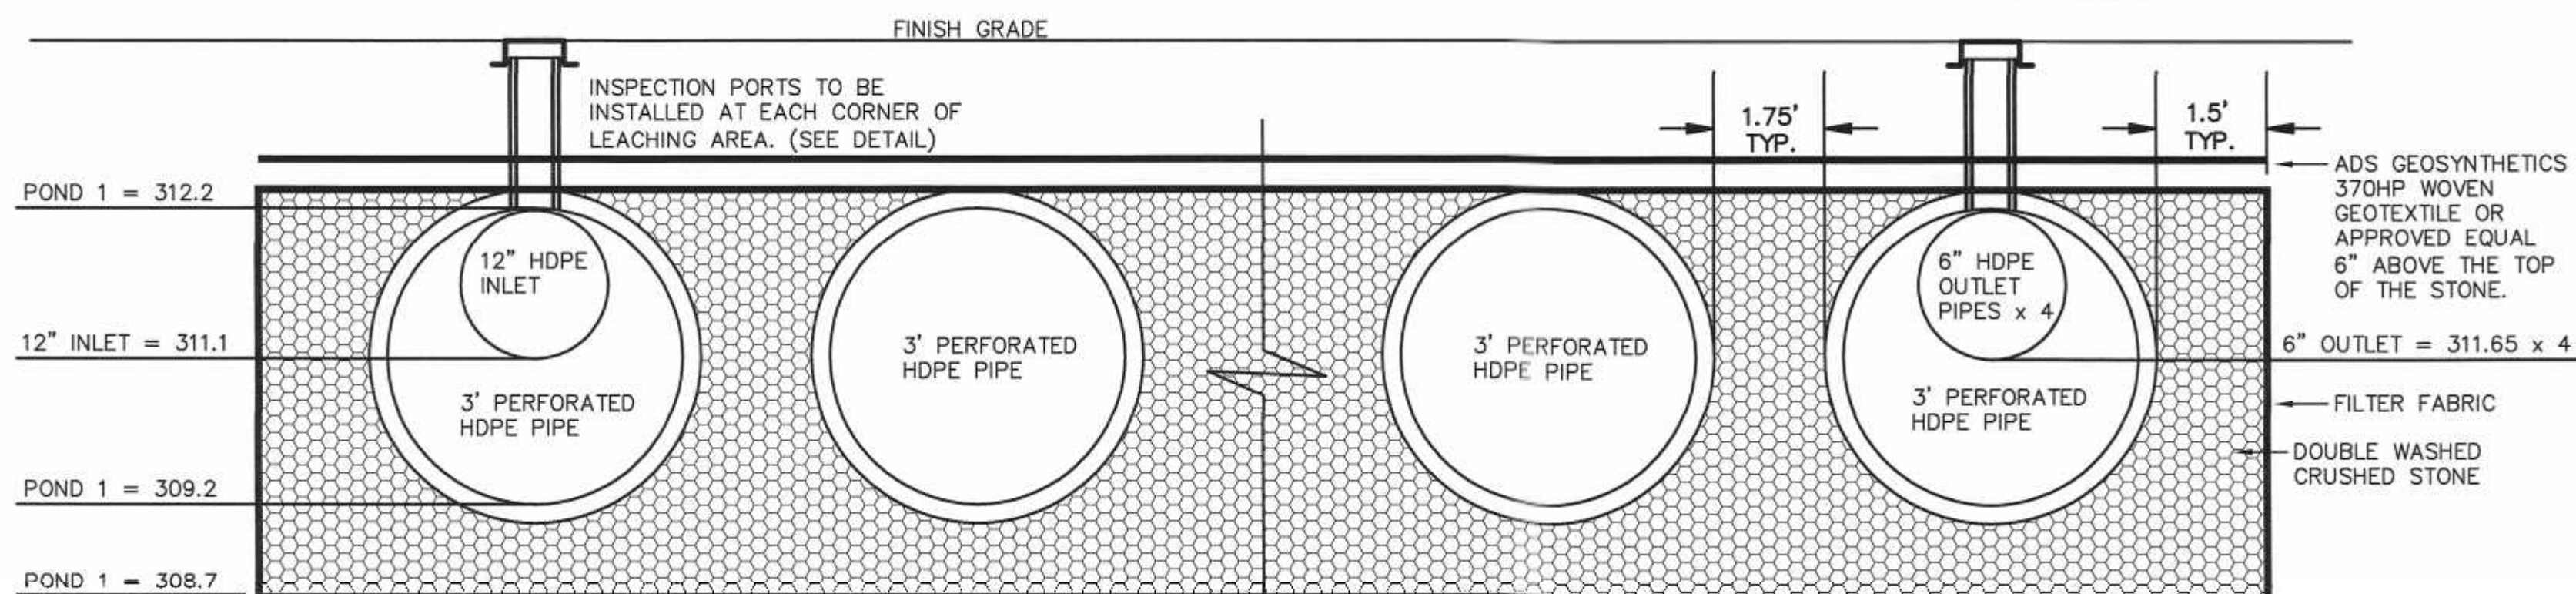


DRAINAGE INFILTRATION AREA - 1

NOTE:
INFILTRATION POND 1 CONSISTS OF
6 ROWS OF 3' DIAMETER PERFORATED HDPE PIPE.
3 ROWS AT 66' IN LENGTH.
3 ROWS AT 70' IN LENGTH.
STONE EXTENTS 32.75' x 69' TO 73' (SEE PLAN)

THE DESIGN ENGINEER SHALL INSPECT THE EXCAVATION OF THE SOIL INFILTRATION AREA PRIOR TO ANY FILL BEING PLACED.

- NOTES:
- CONTRACTOR TO CONTACT DIGSAFE PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - CONTRACTOR TO VERIFY LOCATIONS OF EXISTING UTILITIES ANY REPORT ANY DISCREPANCIES TO UNITED CONSULTANTS, INC.
 - ALL WORK SHALL CONFORM TO THE TOWN OF FRANKLIN DPW STANDARDS.
 - MAINTAIN A MINIMUM OF 10' SEPARATION FROM THE WATER SERVICE TO THE SEWER SERVICE.

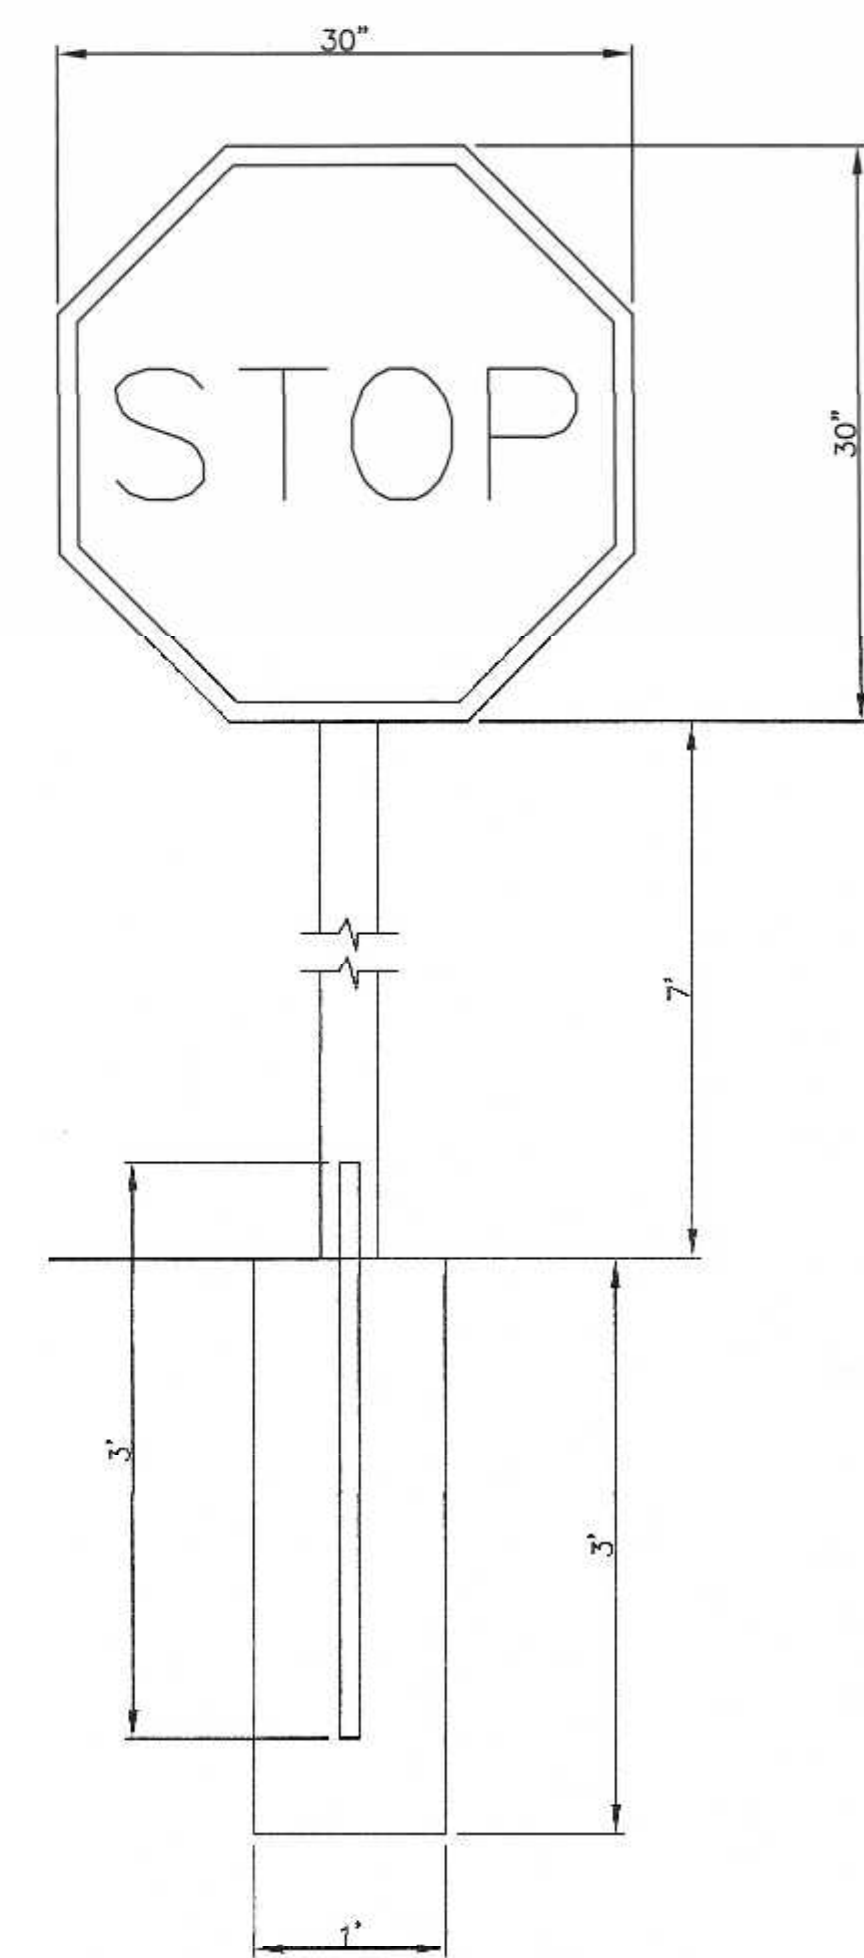


STOP SIGN DETAIL
N.T.S.

SITE PLAN
CONSTRUCTION DETAILS - 2
100 & 110 EAST CENTRAL STREET
FRANKLIN, MASSACHUSETTS
PREPARED FOR
110 EAST CENTRAL STREET RE, LLC
37 EAST CENTRAL STREET
FRANKLIN, MASSACHUSETTS
JANUARY 5, 2024
SCALE: 1" = 100'


SITE PLAN APPROVAL
REQUIRED
FRANKLIN PLANNING BOARD

DATE

GRAPHIC SCALE

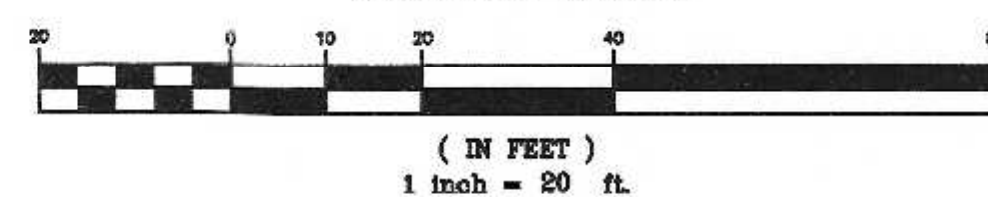


NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

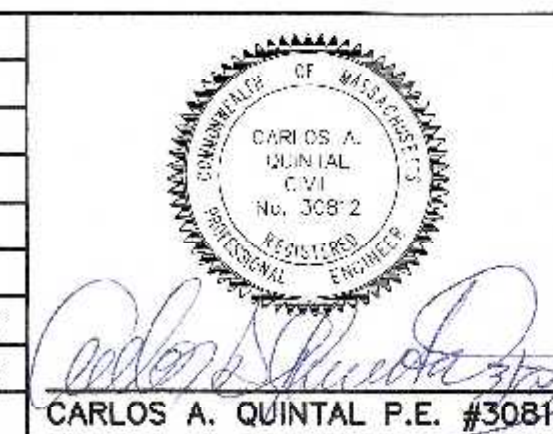


DATE	FIELD BY:	INT.
7/23	BL	
1/24	FIELD BOOK	PG#
1/24	CALCS BY:	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED
CONSULTANTS
INC.
850 FRANKLIN STREET SUITE 11D
WRENTHAM, MASSACHUSETTS 02093
508-384-6660 FAX 508-384-6566


DATE	SCALE	PROJECT	SHEET
JAN. 5, 2024	1" = 20'	UC1587	8 of 10

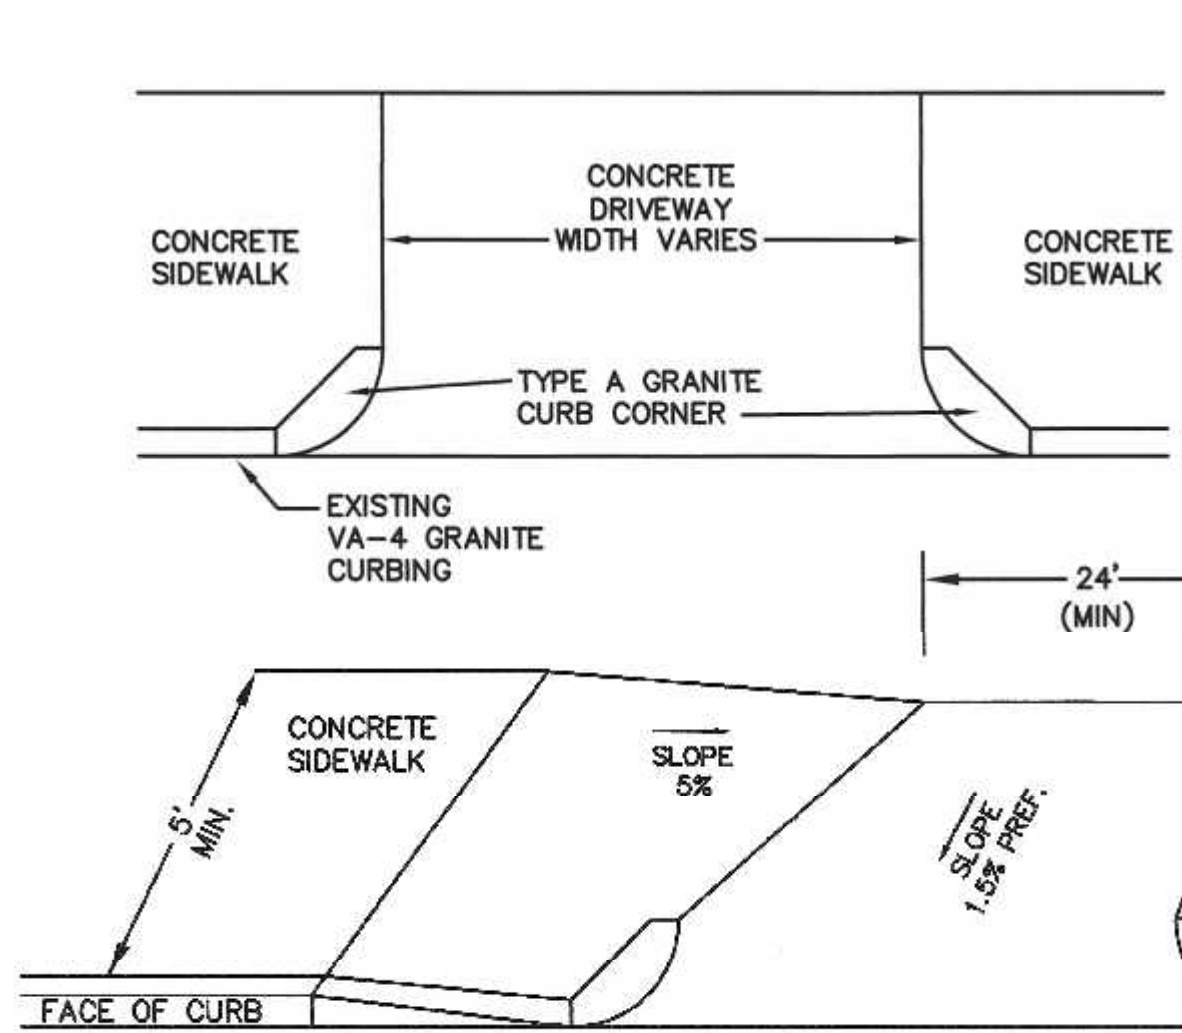


DRIVEWAY APRON

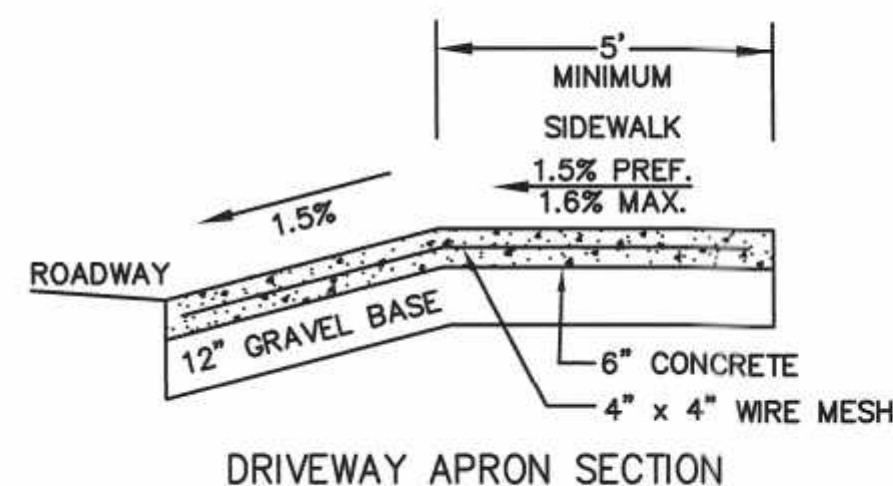

NOTES:
 1. CROSS SLOPE ON ANY RAMP, LANDING OR ACCESSIBLE ROUTE SHALL NOT EXCEED 3/16" PER FOOT.
 2. THE SIDEWALKS ARE 5' MINIMUM IN WIDTH.
 3. ALL SIDEWALKS SHALL BE 4,000 PSI CONCRETE.
 4. GRAVEL UNDER SIDEWALK TO BE M1.03.0 (TYPE B)

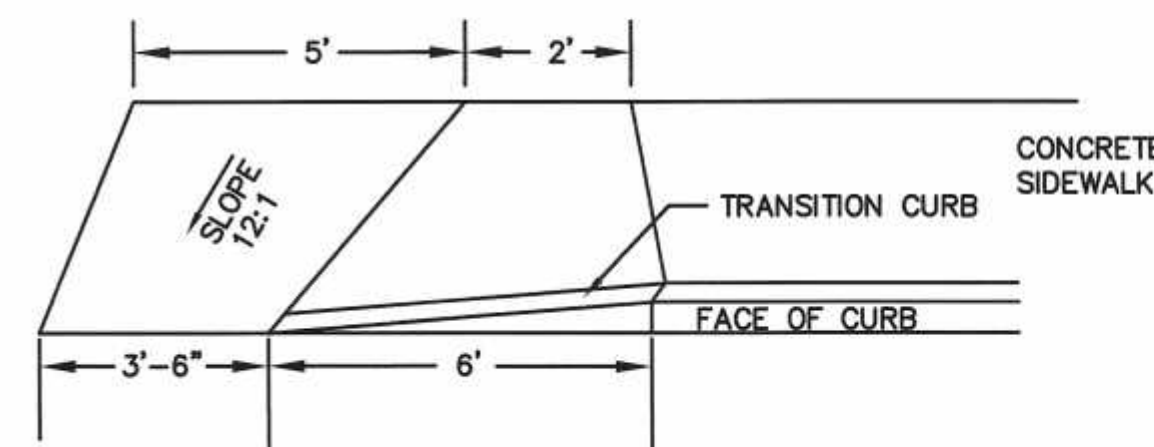


WHEELCHAIR RAMP

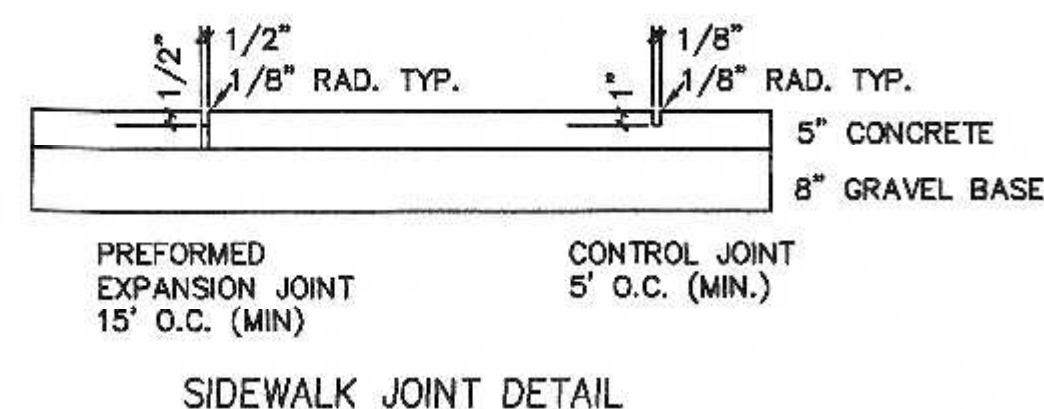


SIDEWALK JOINT DETAIL


NOTES:
 GRAVEL UNDER PAVEMENT AND SIDEWALKS TO BE M1.03.0 (TYPE B)

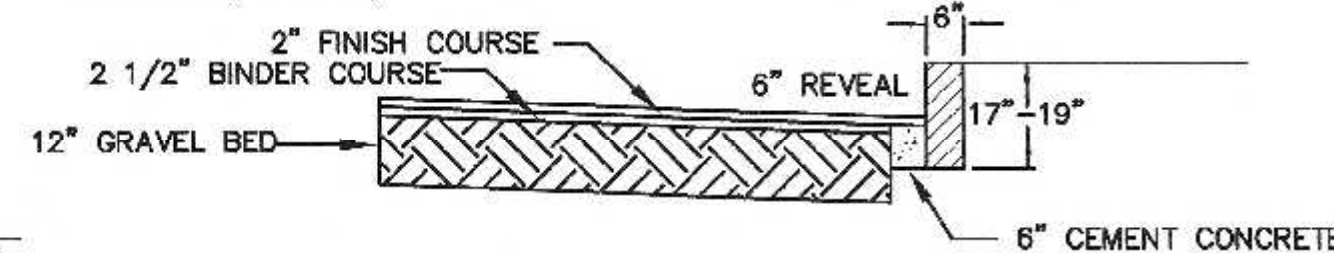


PAVEMENT AND VA-4 VERTICAL GRANITE CURBING

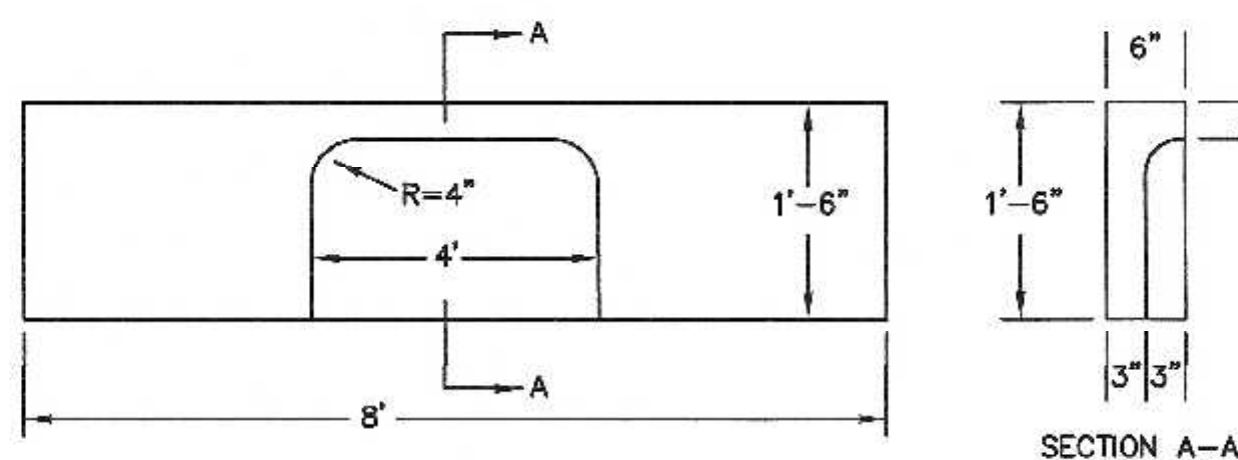

GRANITE CURB INLET DETAIL


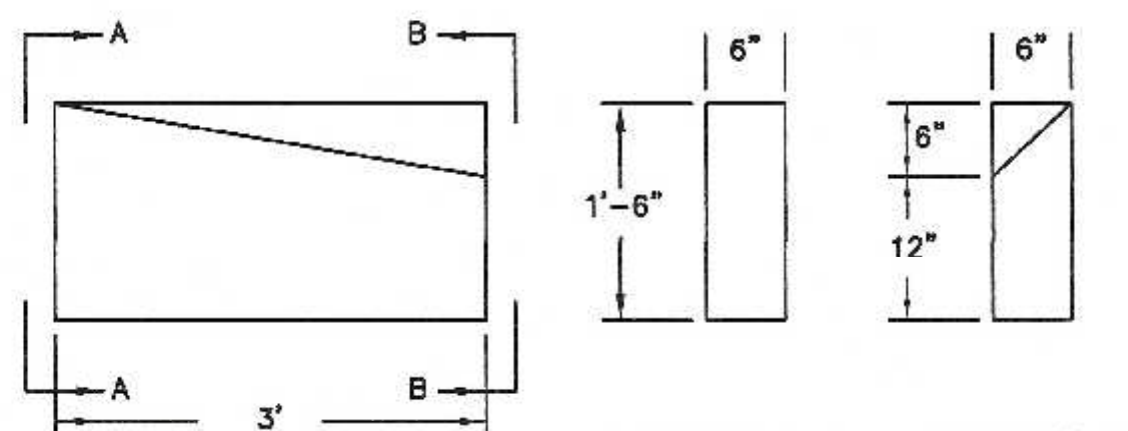


GRANITE CURB TRANSITION DETAIL

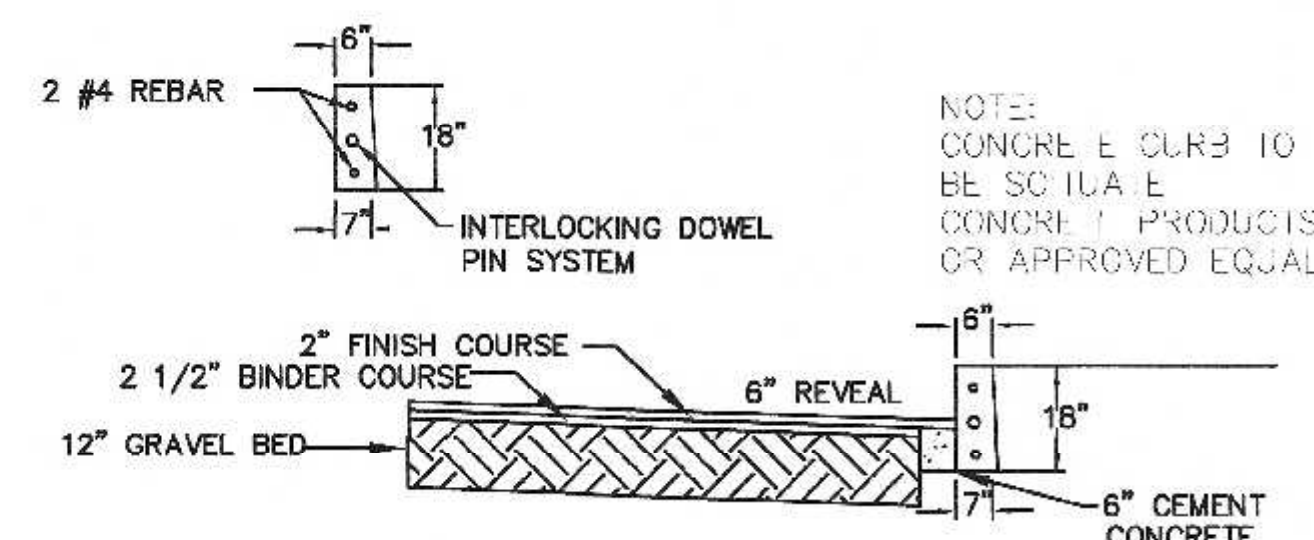

PAVEMENT AND VERTICAL CONCRETE CURBING

Typical Siltsack® Construction - Type B

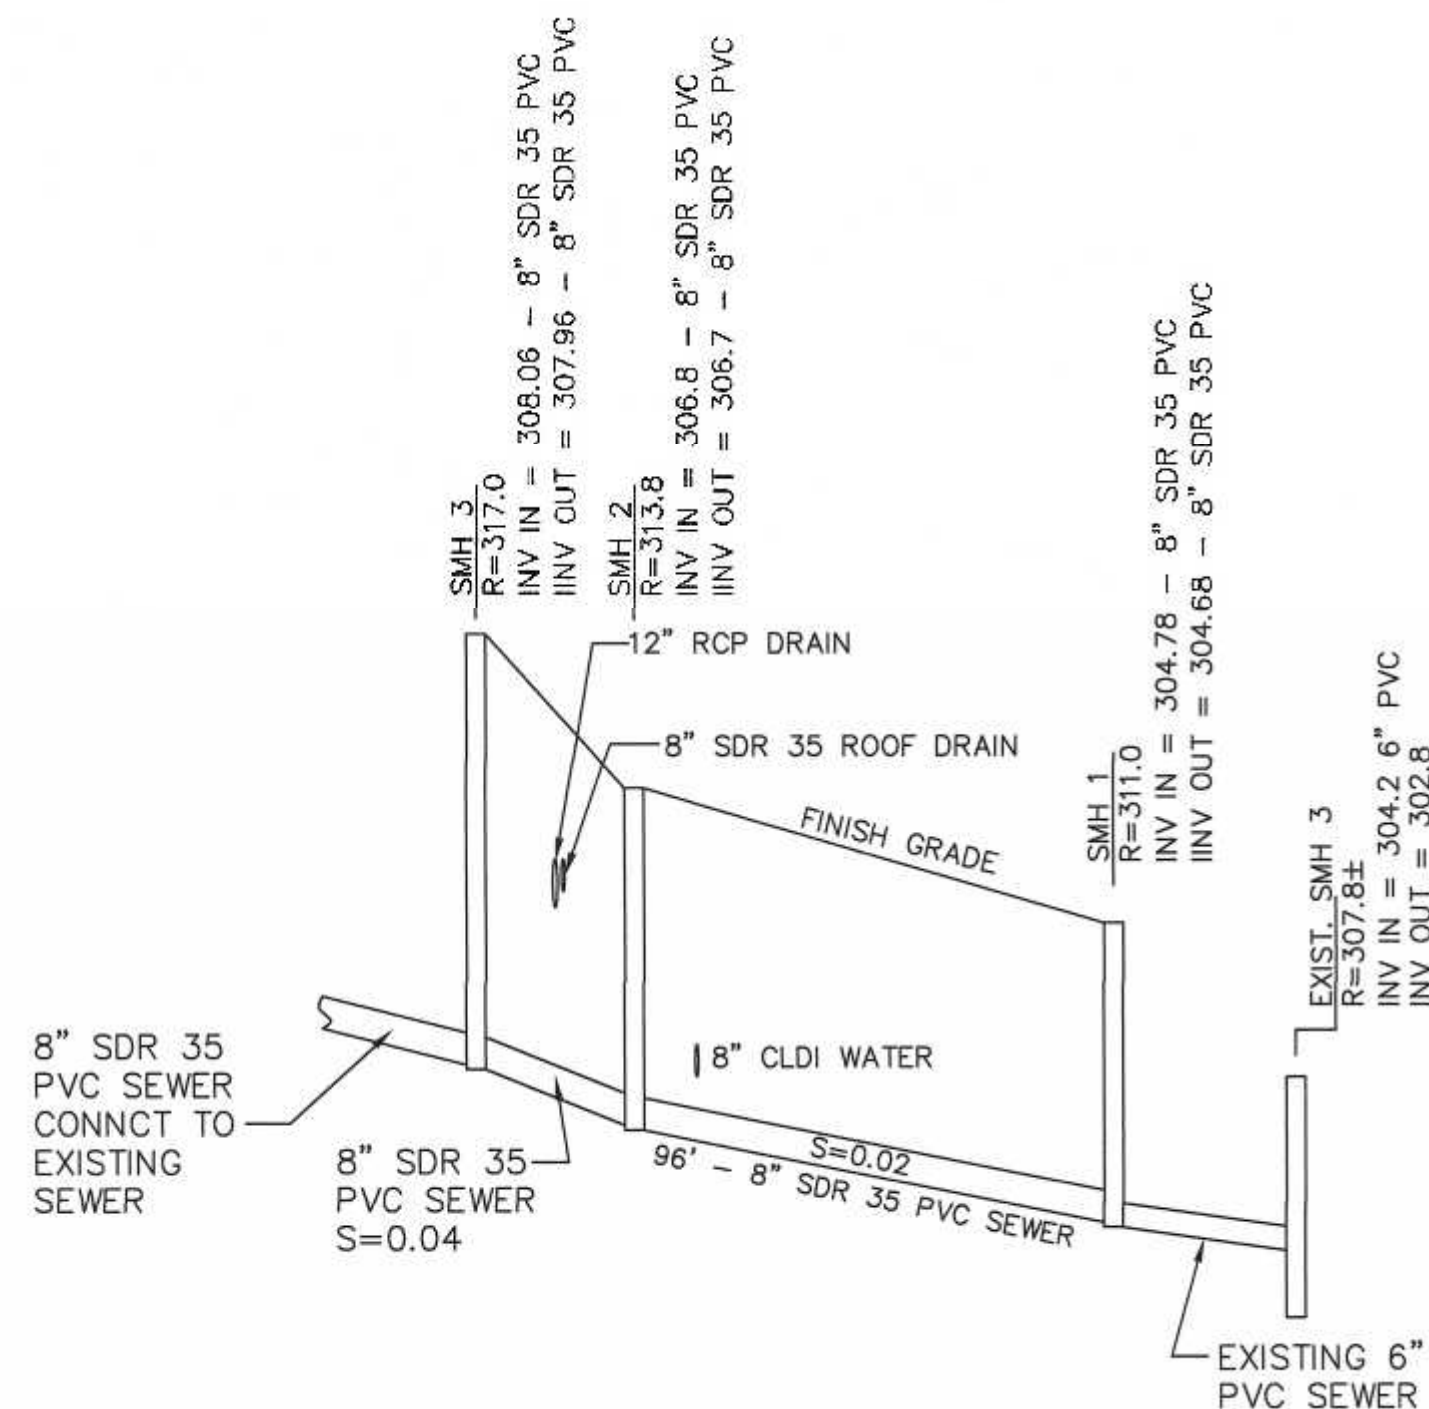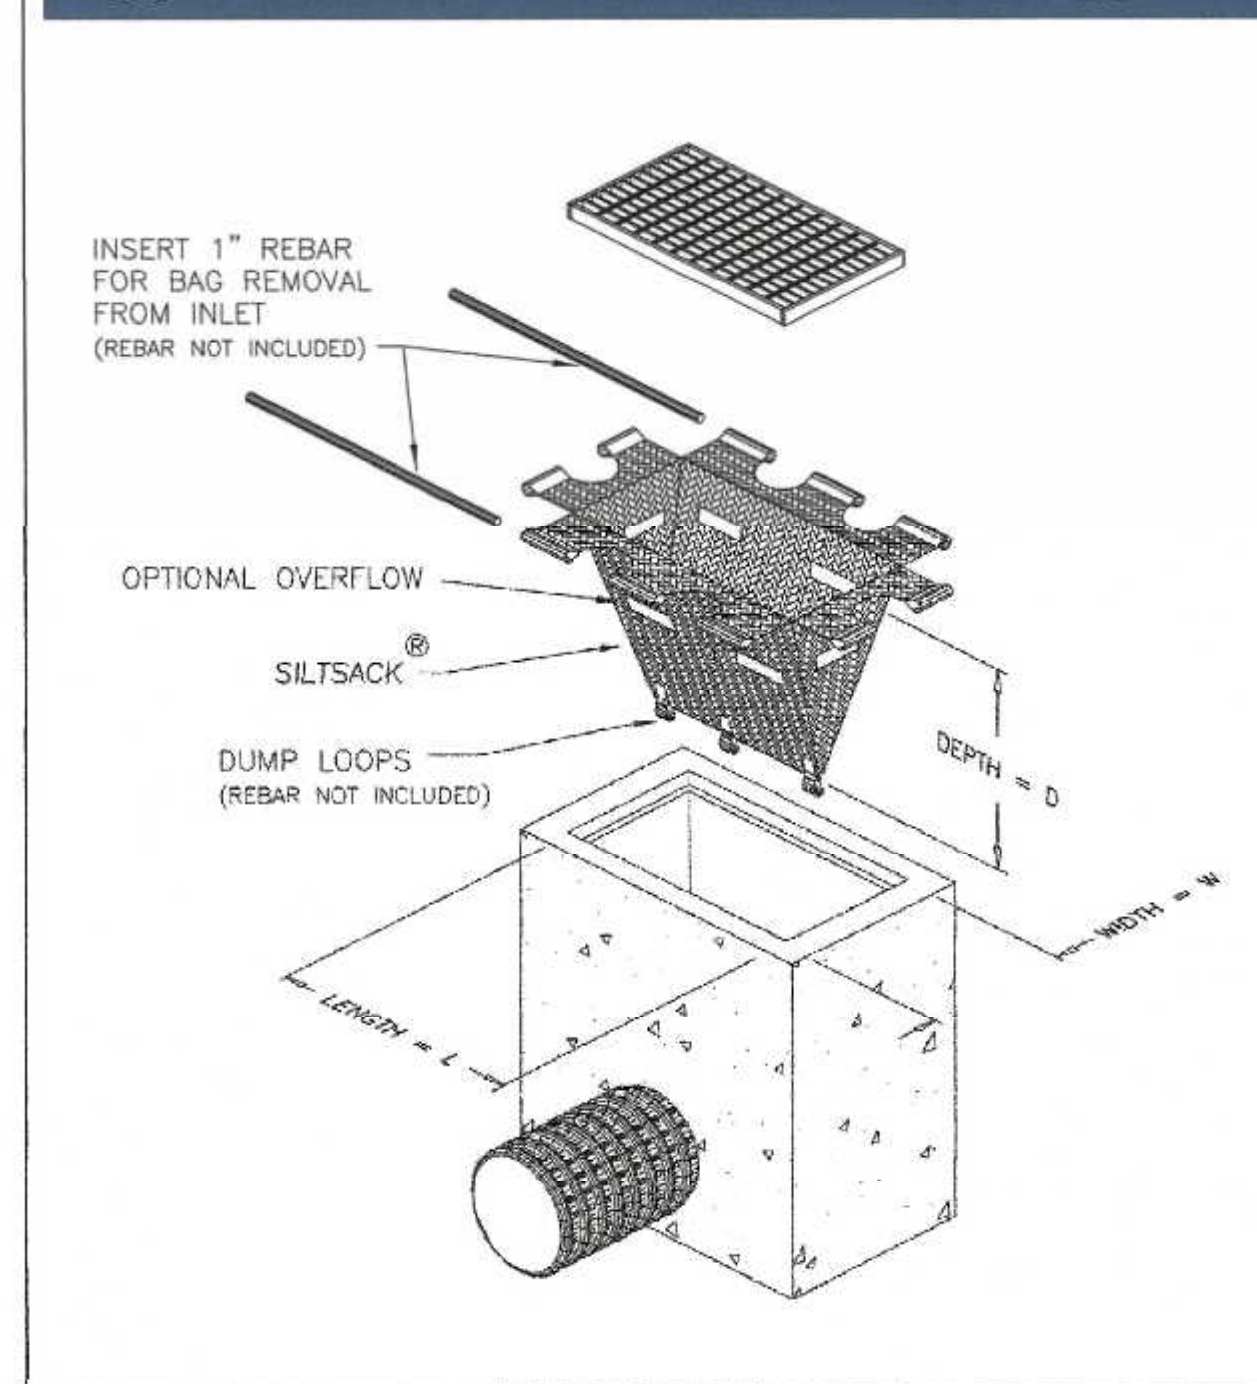


SEWER PROFILE

SCALE: H - 1" = 40'
 V - 1" = 4'


CONTRACTOR TO CONFIRM EXISTING ELEVATIONS AT CONNECTION POINT AND NOTIFY THE DESIGN ENGINEER.

SEWER PIPE TO BE 8" SDR 35. SEWER PIPE SIZE AND TYPE WITHIN 10 FEET OF THE BUILDING SHALL BE PROVIDED BY THE PLUMBING ENGINEER.

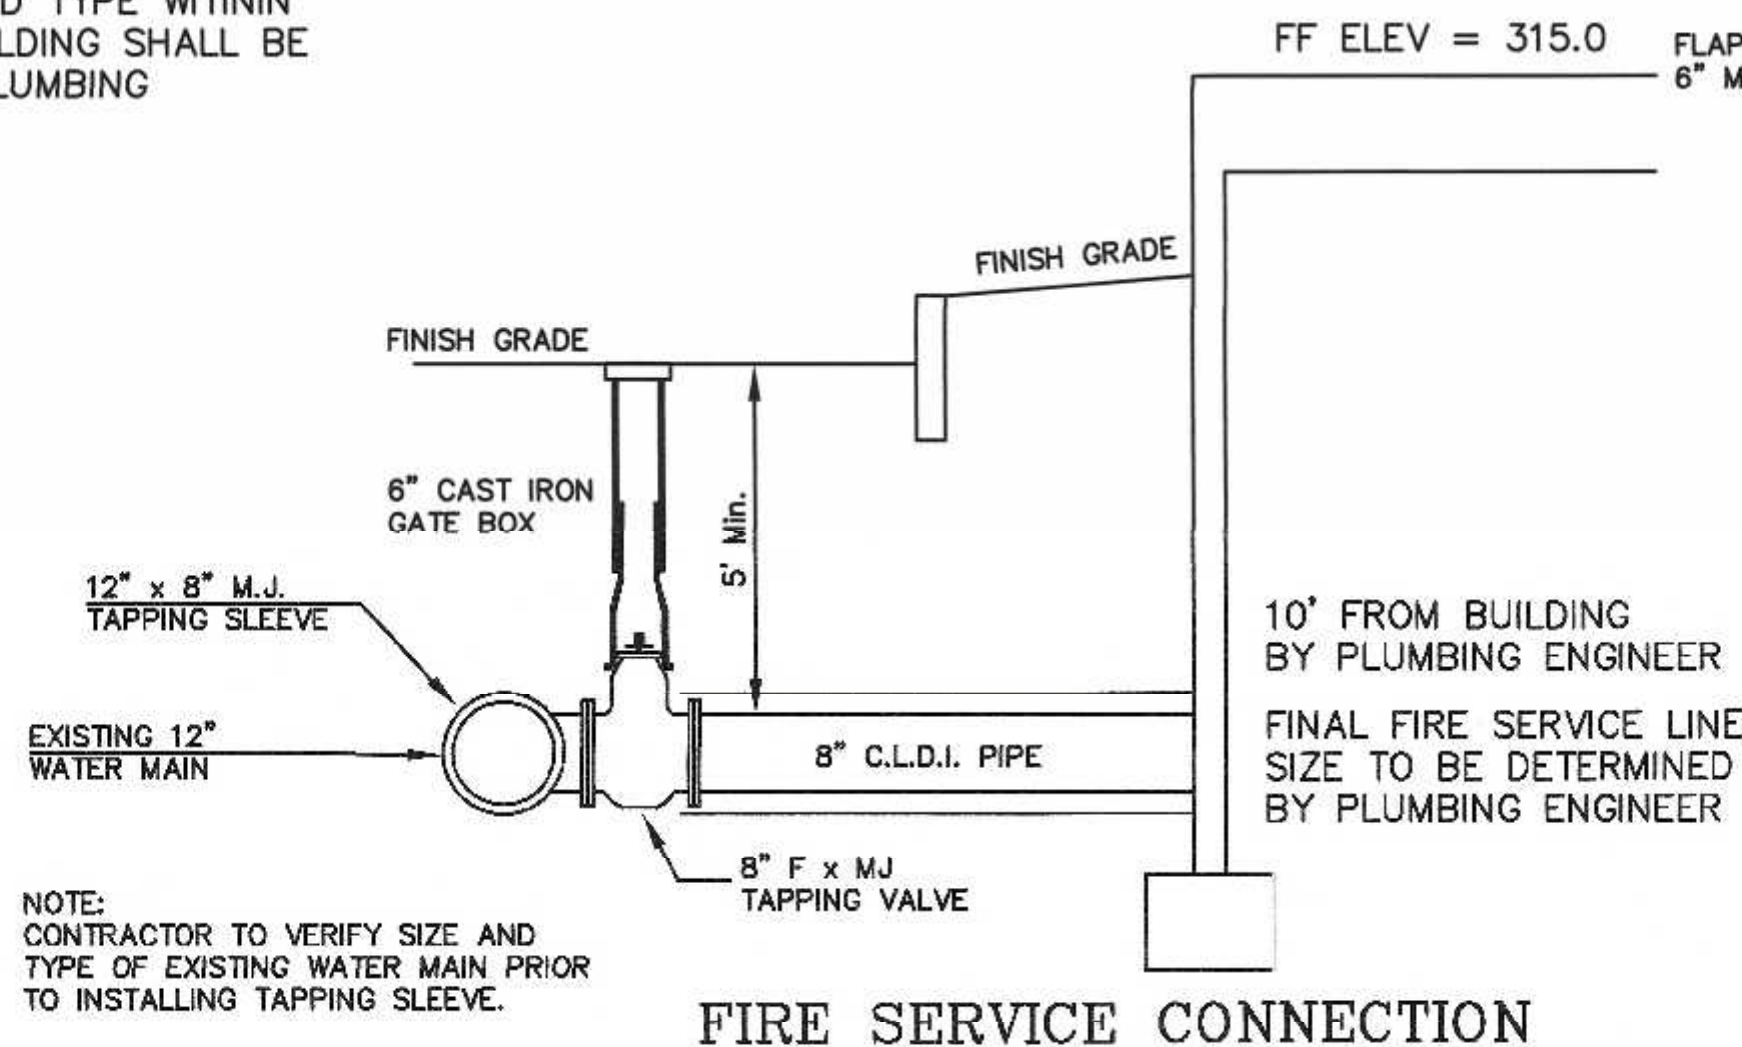


FIRE SERVICE CONNECTION

NOTE:
 CONTRACTOR TO VERIFY SIZE AND TYPE OF EXISTING WATER MAIN PRIOR TO INSTALLING TAPPING SLEEVE.

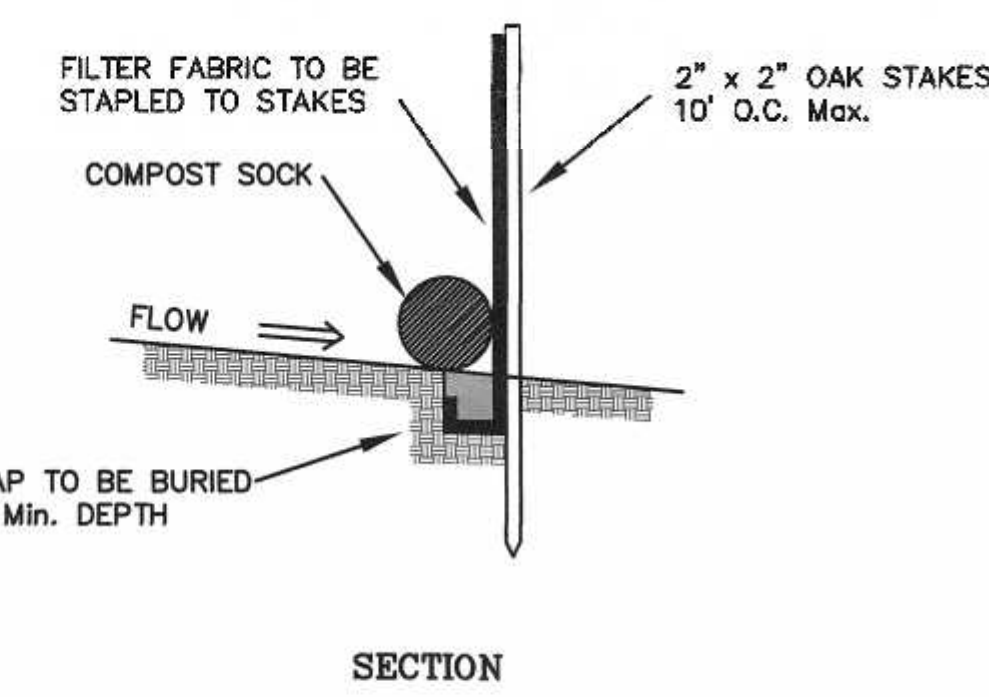


EROSION CONTROL DETAIL

LOAM STOCKPILE:
 ALL STRIPPED LOAM SHALL BE STOCKPILED AND SEEDING WITH RYE GRASS, WATERED AND CONTAINED WITH SILT FENCE AND COMPOST SOCK

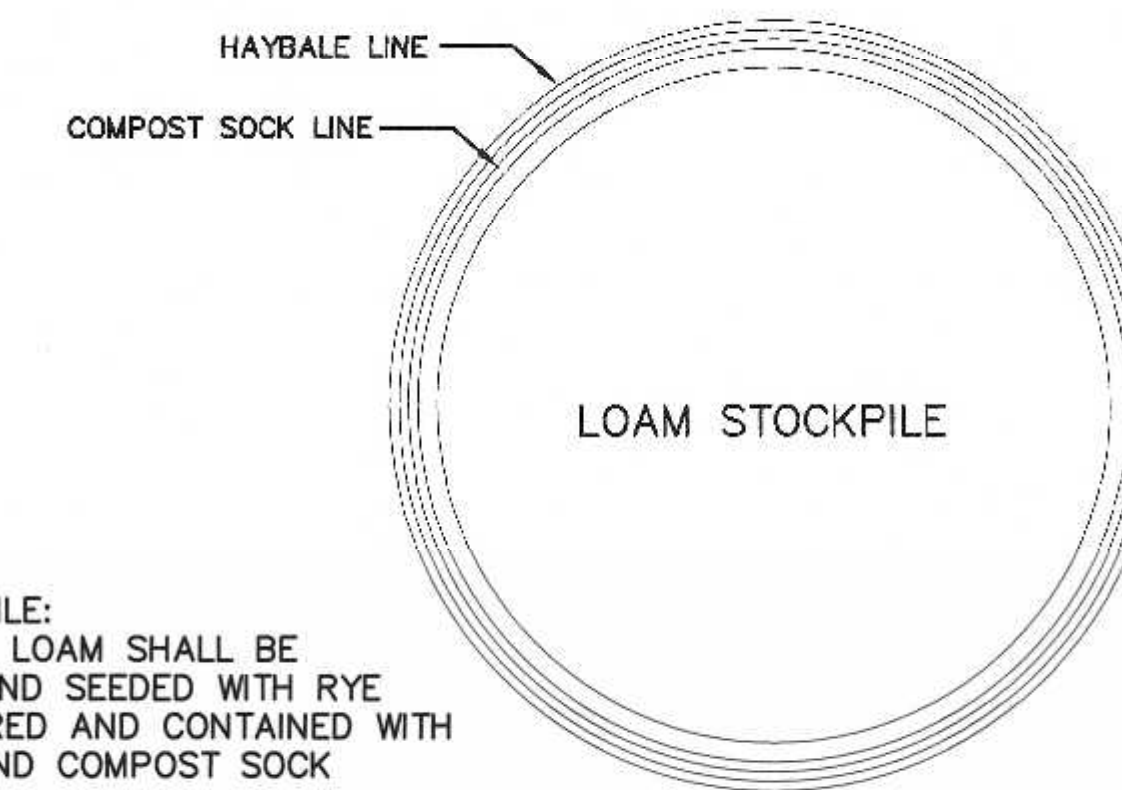

STOCKPILE DETAIL

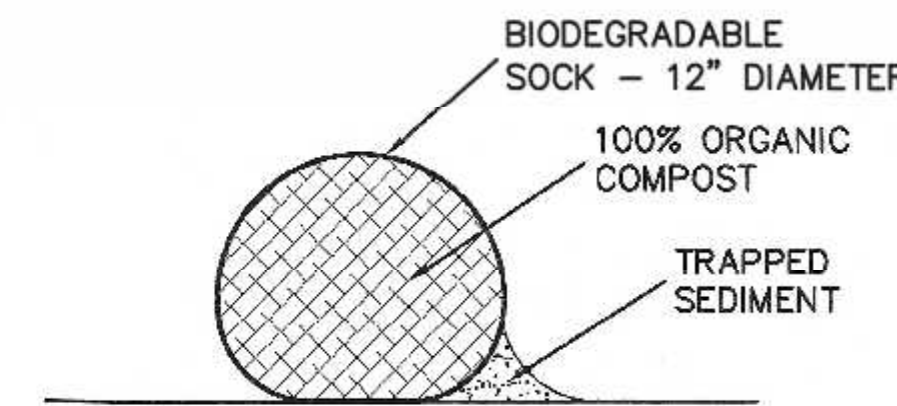


COMPOST SOCK DETAIL

SITE PLAN
 CONSTRUCTION DETAILS - 3
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'


SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

DATE

GRAPHIC SCALE

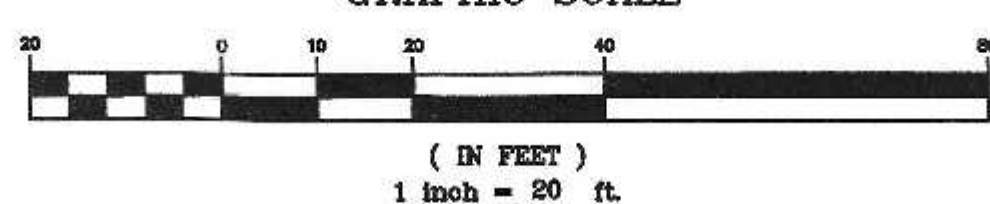


NO.	DATE	DESCRIPTION	BY
2	3/26/24	REVIEW COMMENTS	RRG
1	2/26/24	REVIEW COMMENTS	RRG

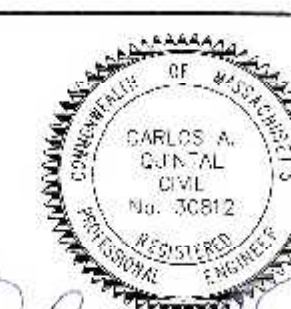

DATE	FIELD BY:	INT.
7/23	BL	BL
1/24	FIELD BOOK	PG#
1/24	CALCS BY:	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-384-8560 FAX 508-384-8566


DATE	SCALE	PROJECT	SHEET
JAN. 5, 2024	1" = 20'	UC1587	9 of 10

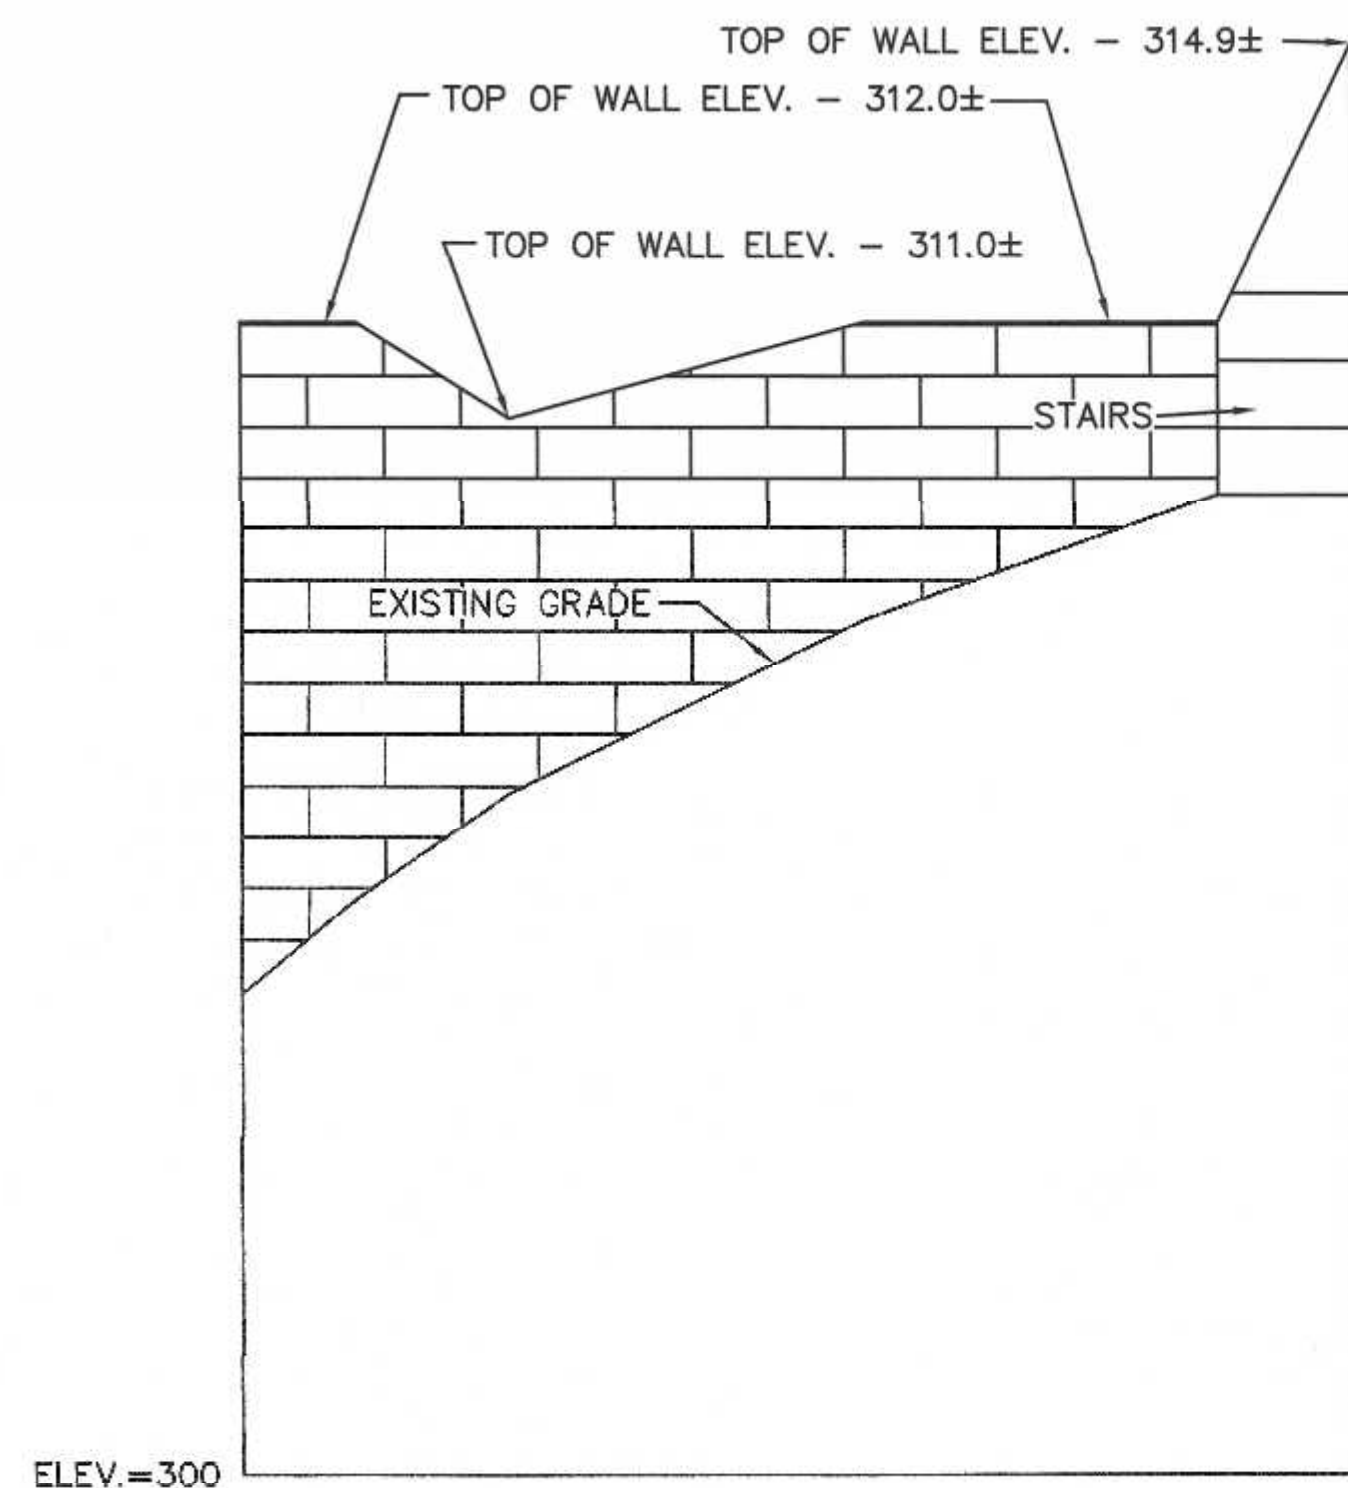

RETAINING WALL 1


SCALE: H- 1" = 20'
V- 1" = 2'

- RETAINING WALL NOTES:
 1. RETAINING WALLS 1, 2, 4 AND 5 SHALL BE CONSTRUCTED OF STONE.
 2. RETAINING WALL 6 SHALL BE A REDIROCK PRECAST GRAVITY WALL BY J&R PRECAST. (LIMESTONE QUARRY)
 3. ALL WALLS REQUIRING A BUILDING PERMIT SHALL BE DESIGNED BY A STRUCTURAL ENGINEER.
 4. ALL WALLS THAT EXCEED FOUR FEET IN HEIGHT SHALL HAVE A NON-CLIMBABLE FENCE.
 5. GUARDRAILS SHALL BE PROVIDED AT RETAINING WALLS 4, 5 AND 6 AND SHALL BE DESIGNED BY THE WALL STRUCTURAL ENGINEER.

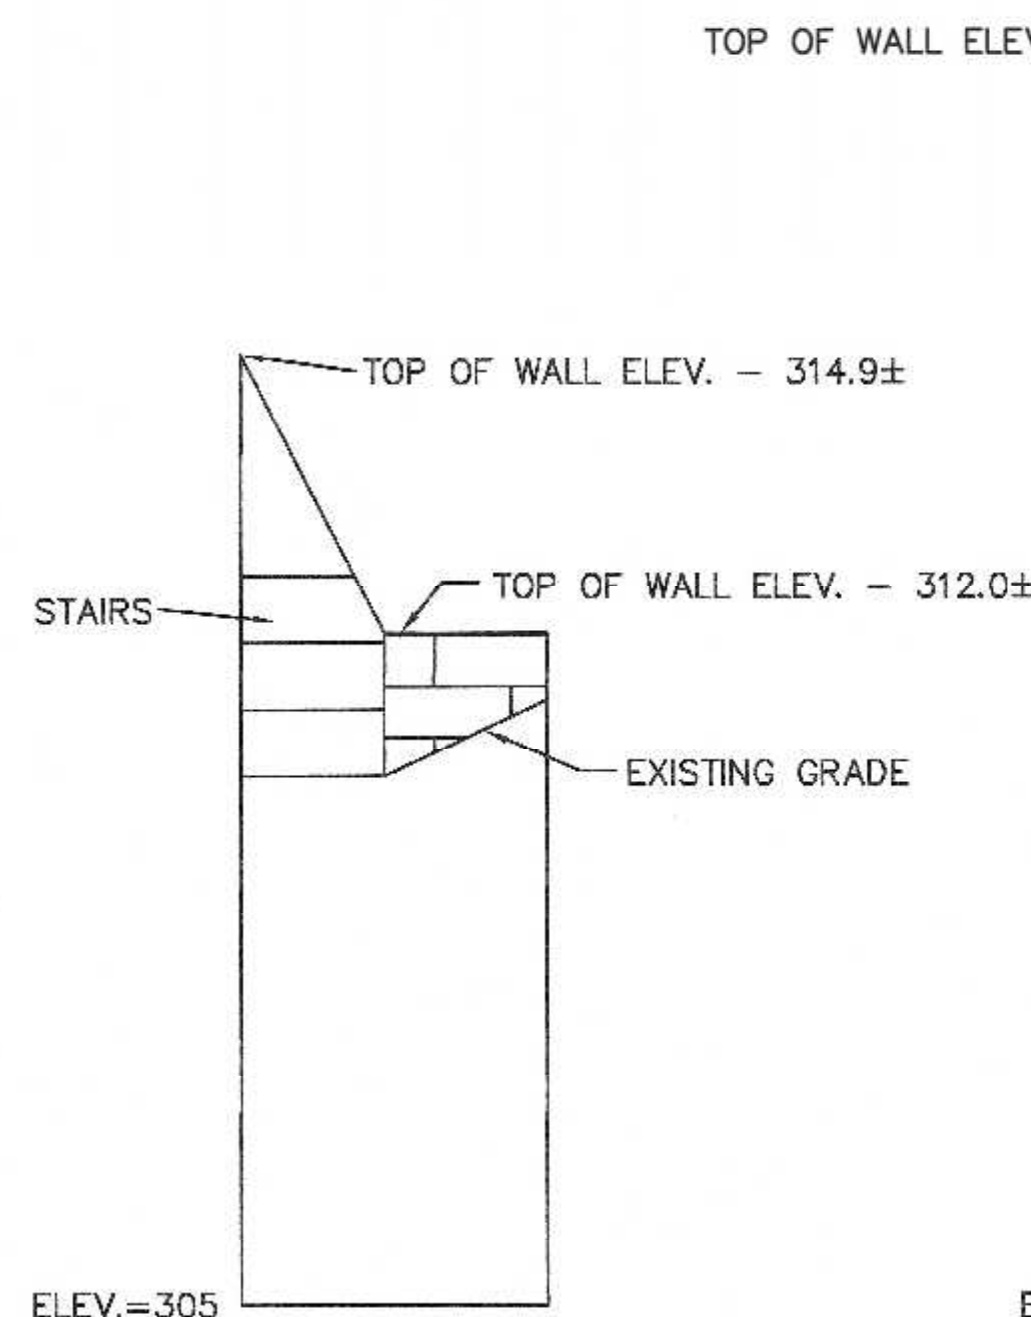


RETAINING WALL 2

SCALE: H- 1" = 20'
V- 1" = 2'

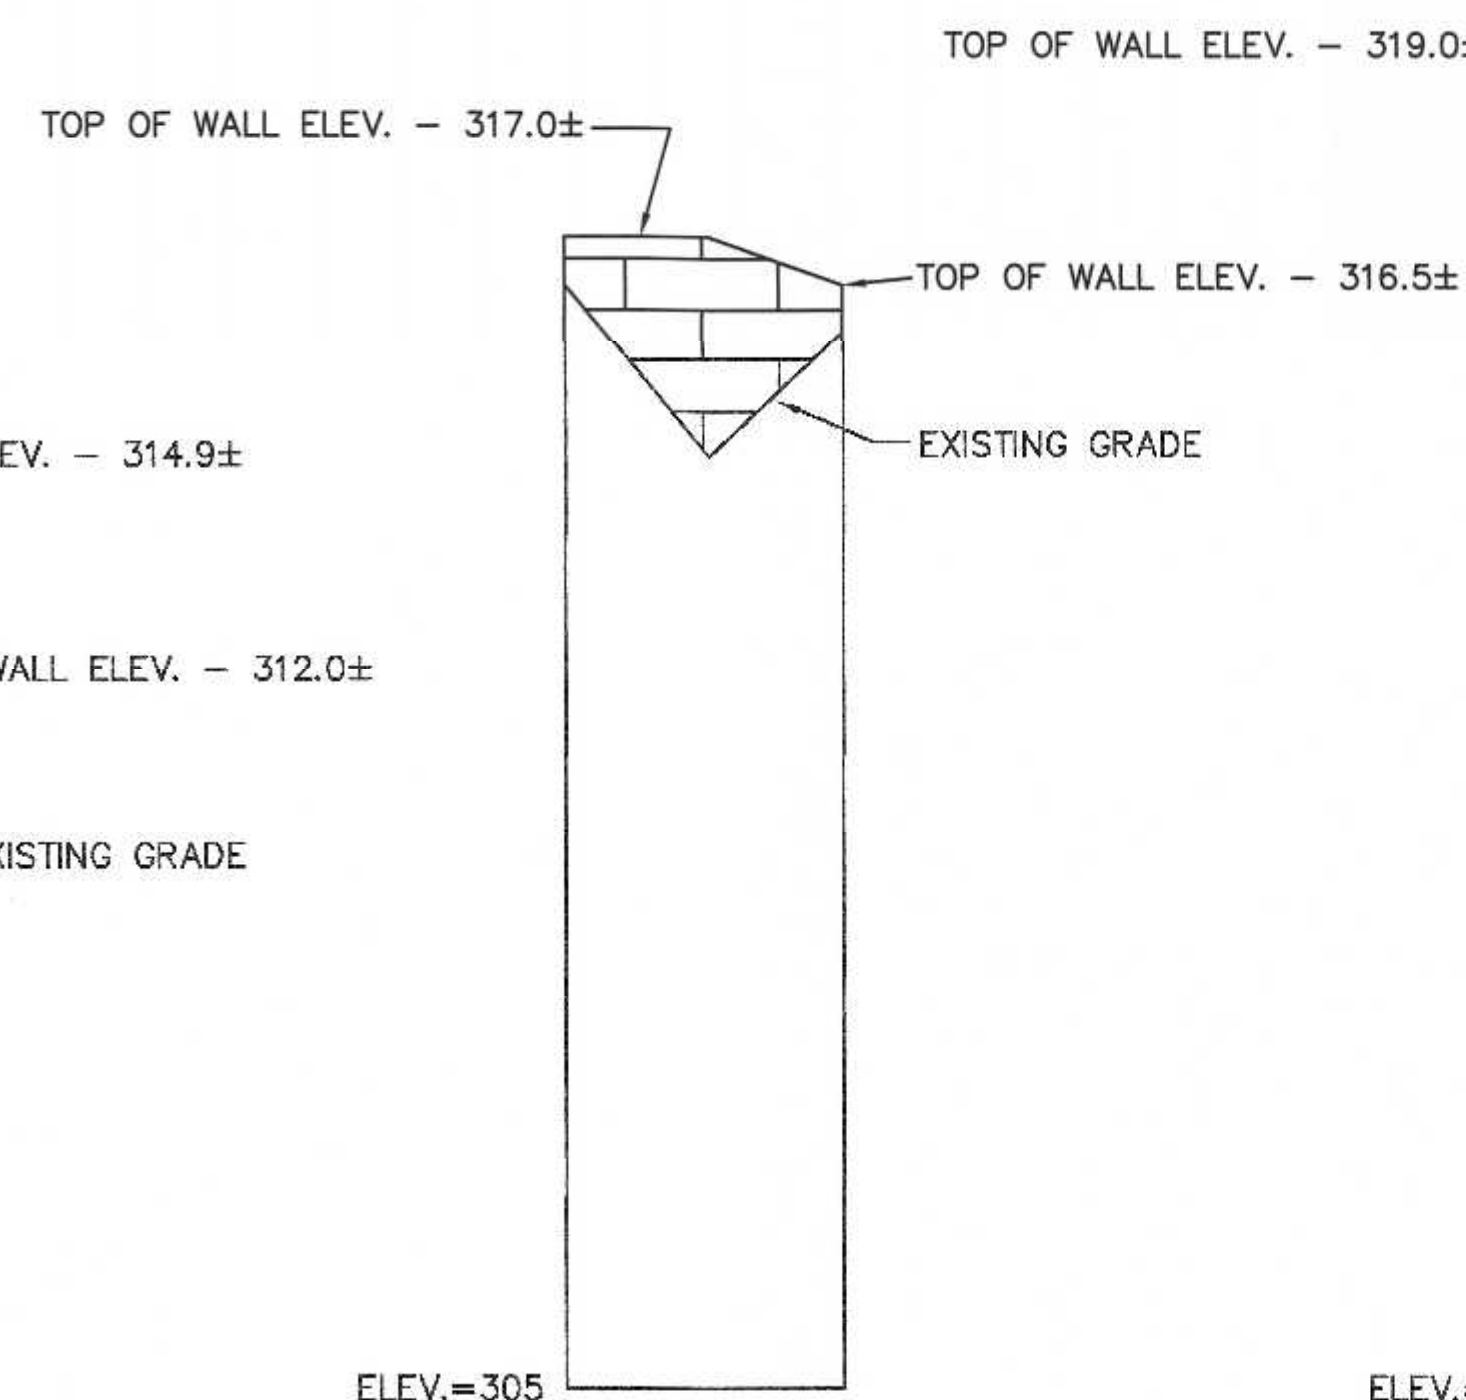


RETAINING WALL 4

SCALE: H- 1" = 20'
V- 1" = 2'

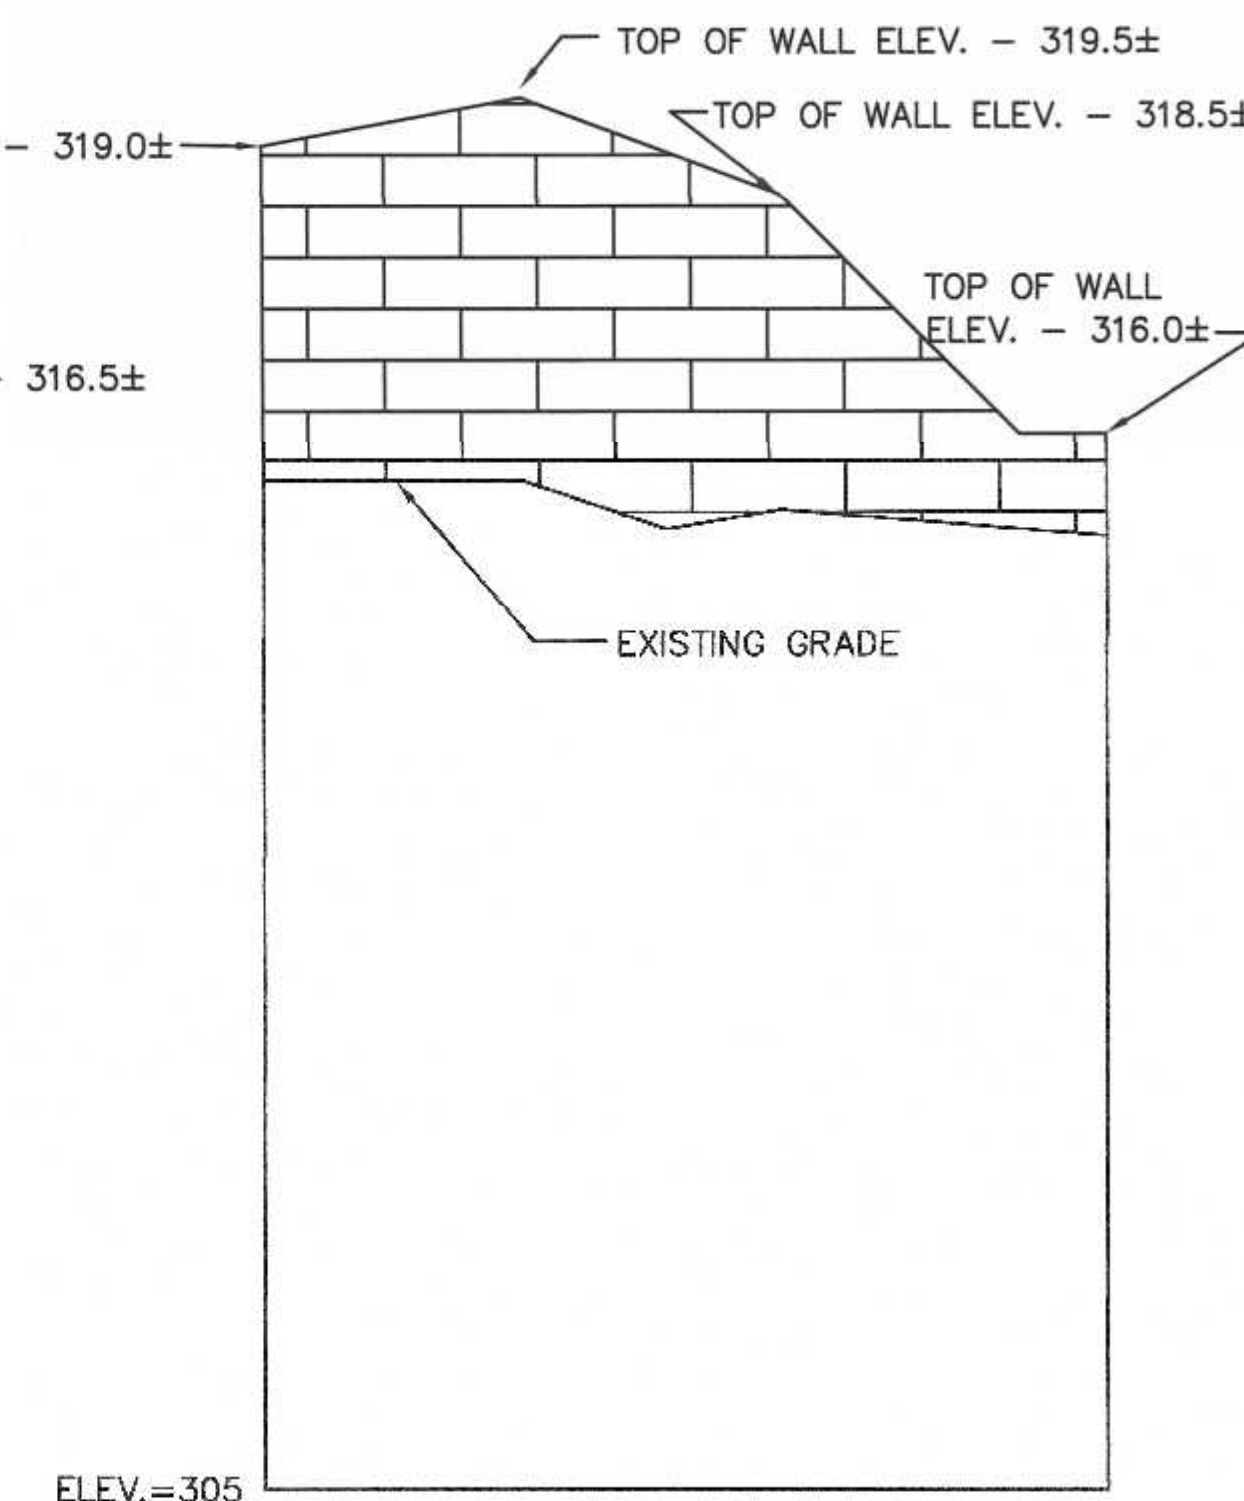


RETAINING WALL 5

SCALE: H- 1" = 20'
V- 1" = 2'

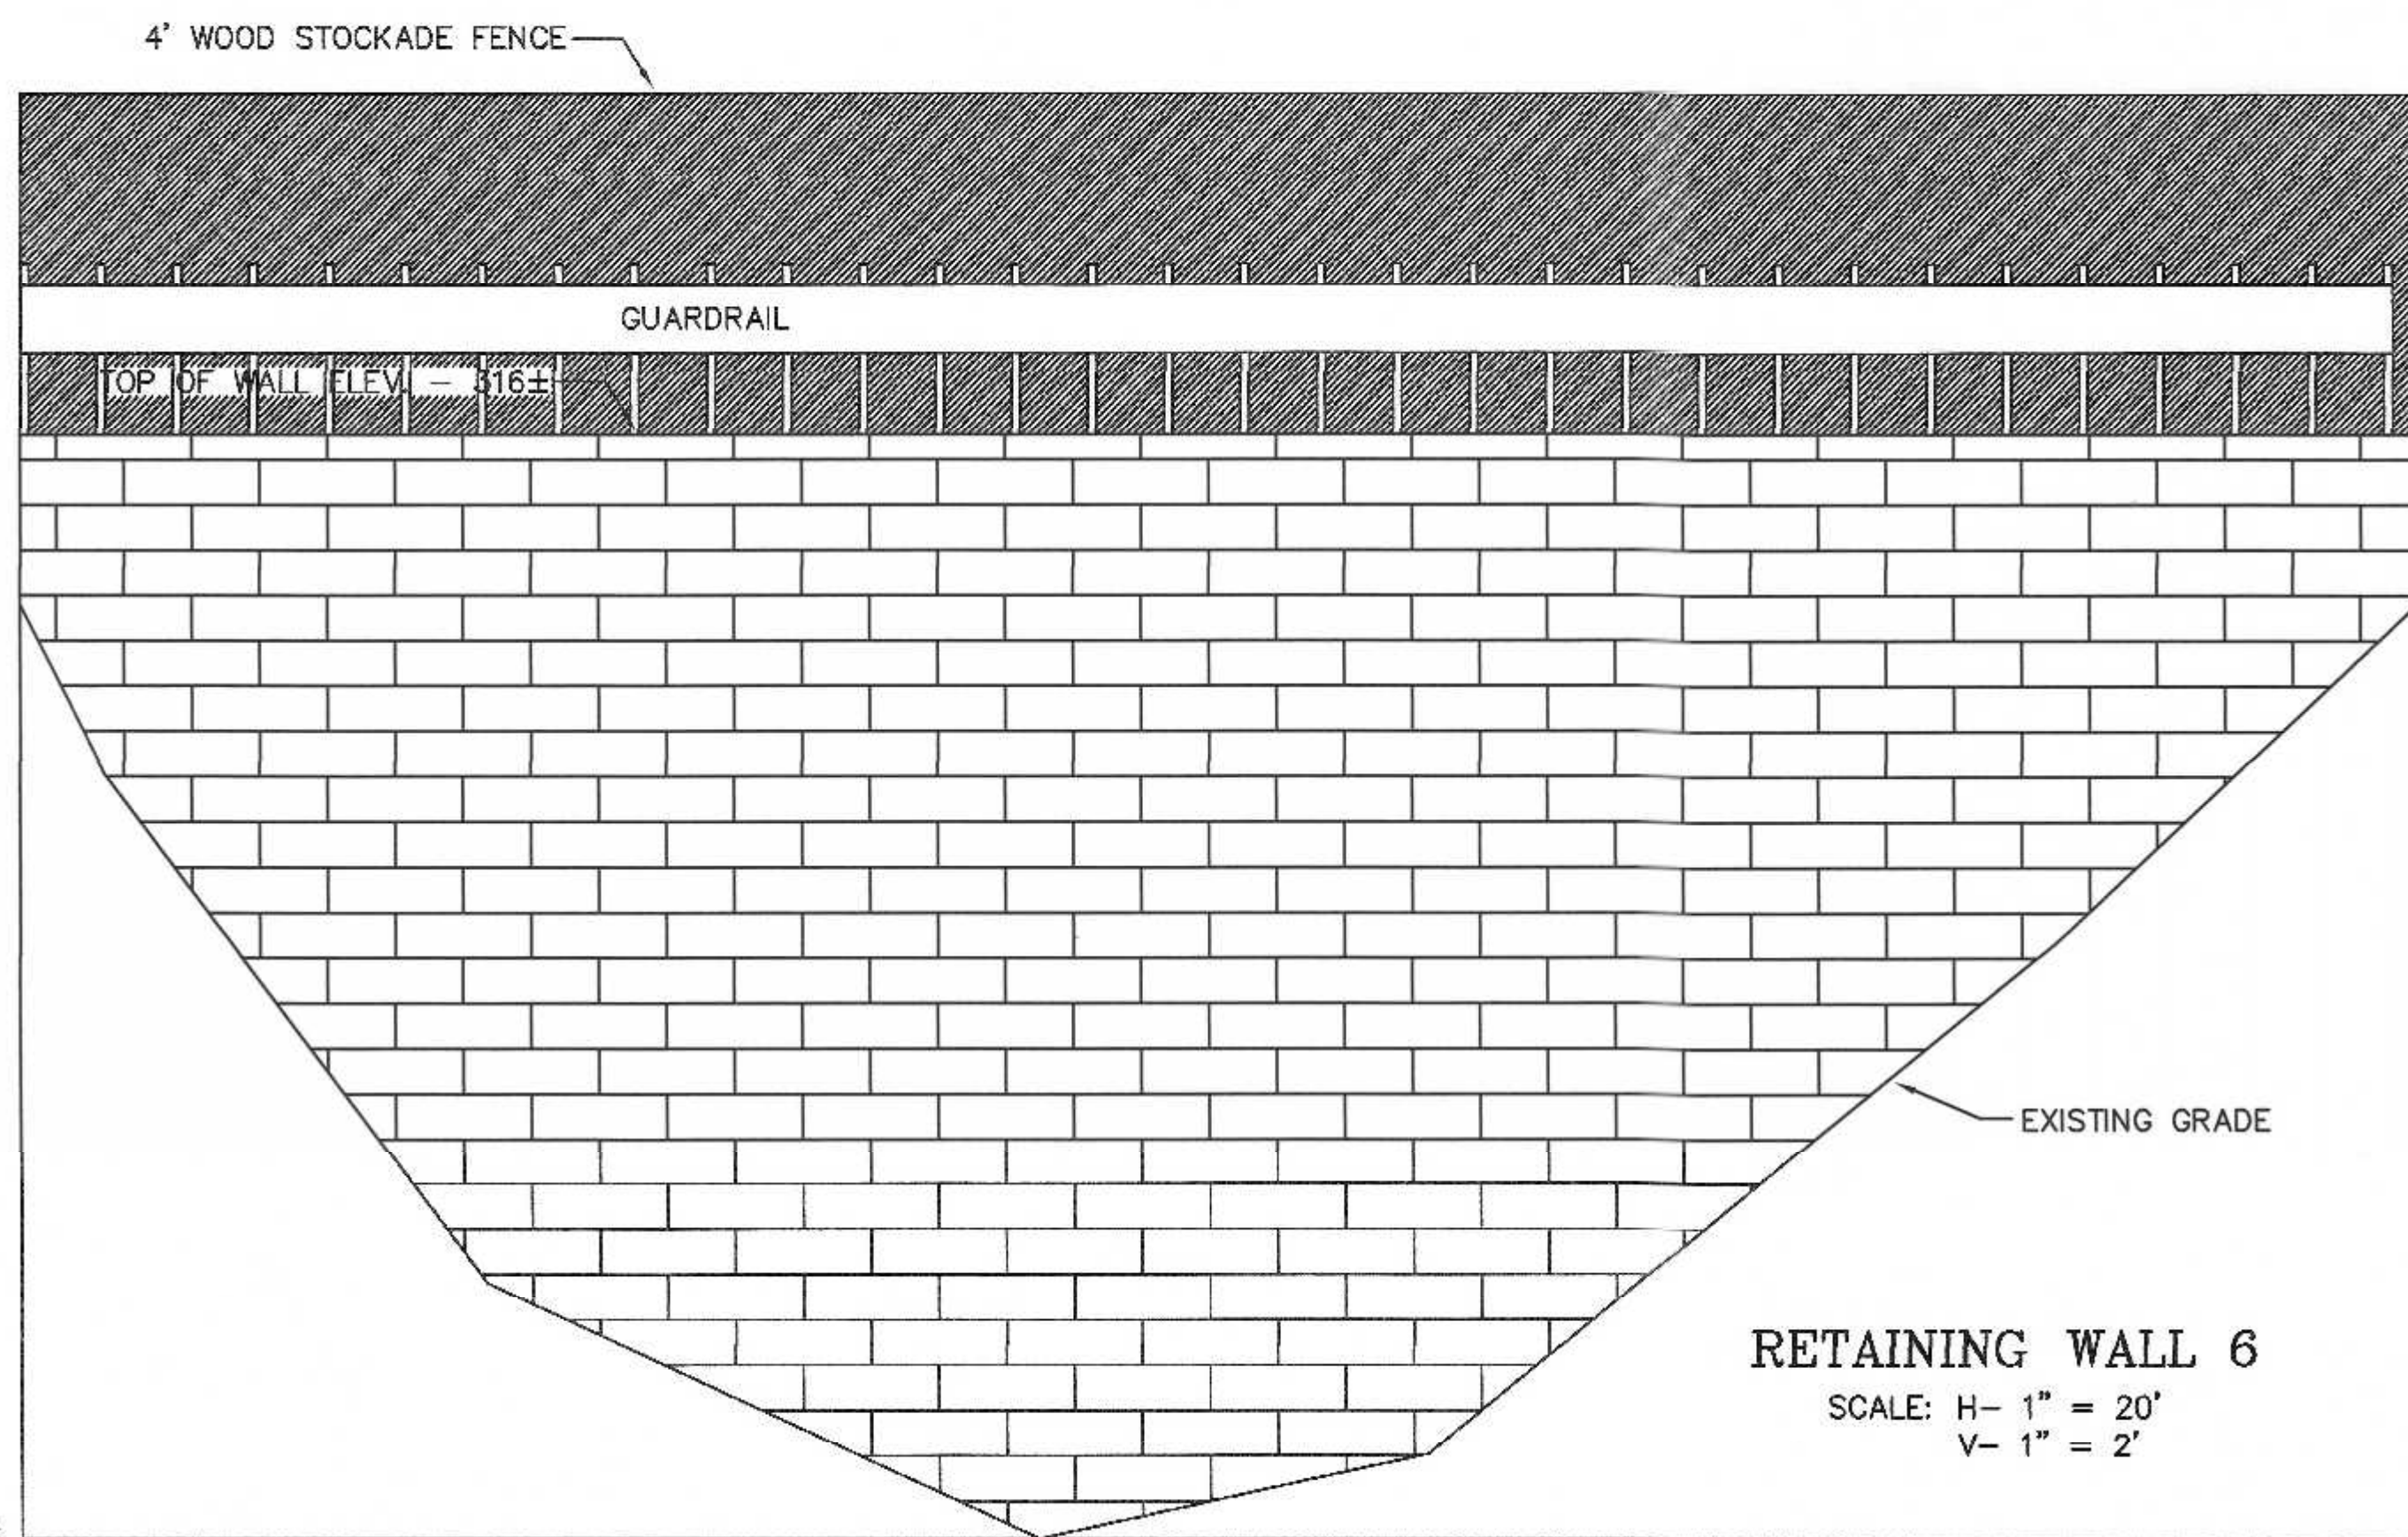

RETAINING WALL 6

SCALE: H- 1" = 20'
V- 1" = 2'

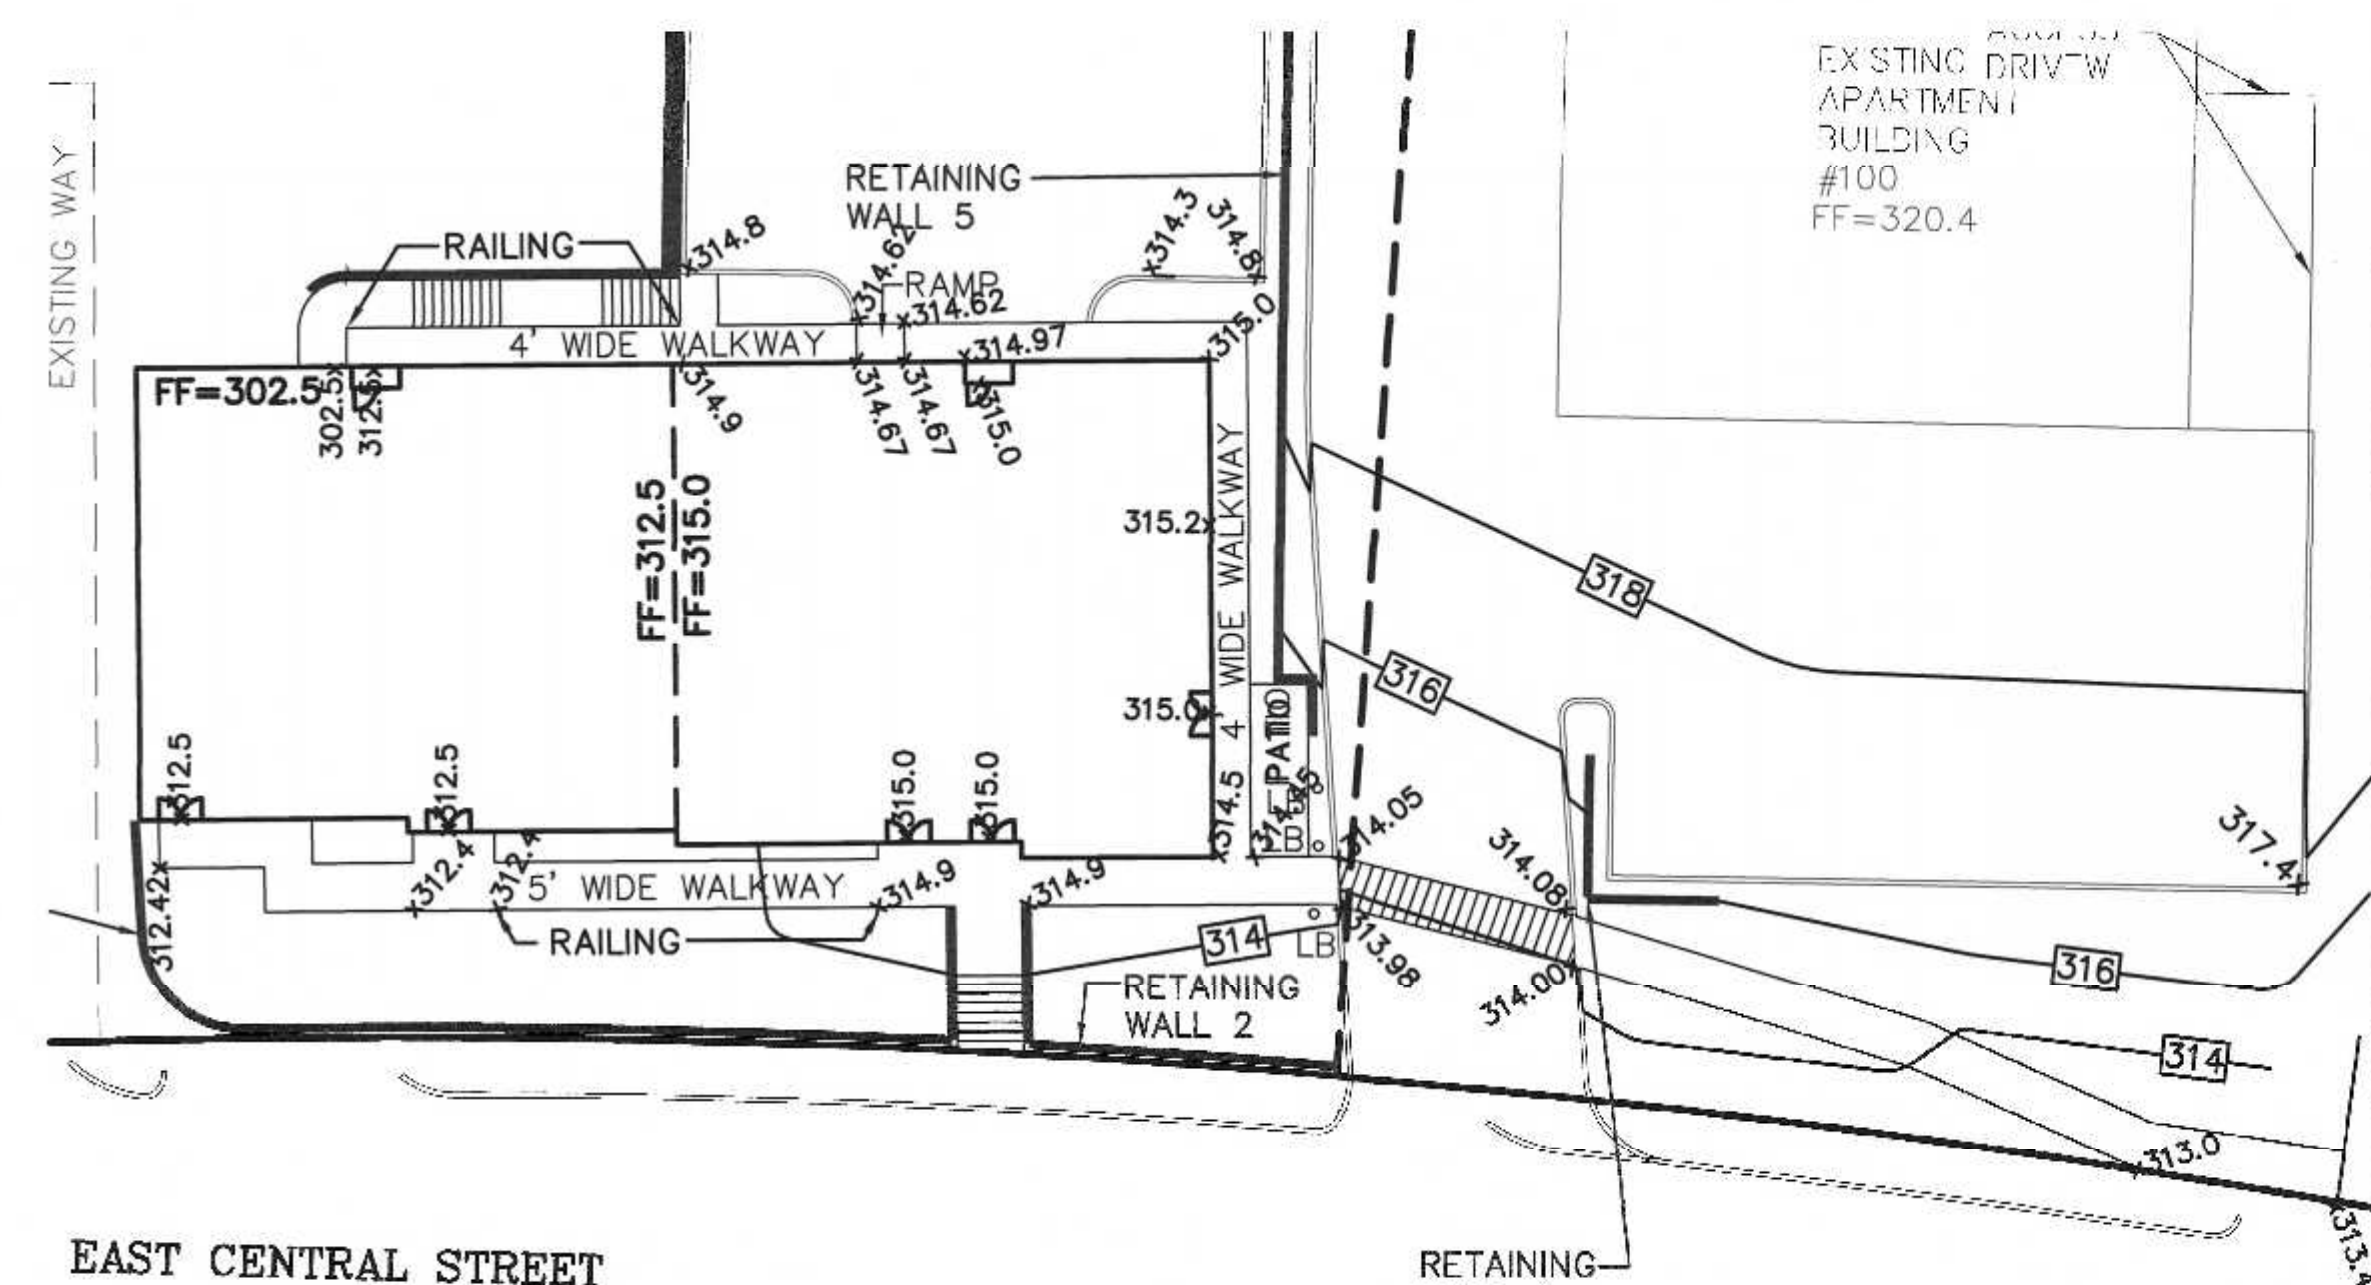

WALKWAY GRADING PLAN


SCALE: 1" = 20'

SITE PLAN
 CONSTRUCTION DETAILS - 4
 100 & 110 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 PREPARED FOR
 110 EAST CENTRAL STREET RE, LLC
 37 EAST CENTRAL STREET
 FRANKLIN, MASSACHUSETTS
 JANUARY 5, 2024
 SCALE: 1" = 100'

SITE PLAN APPROVAL
 REQUIRED
 FRANKLIN PLANNING BOARD

DATE

GRAPHIC SCALE

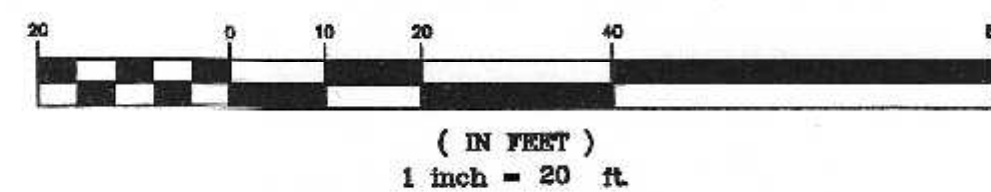


NO.	DATE	DESCRIPTION	BY
1	2/26/24	REVIEW COMMENTS	RRG



DATE	FIELD BY:	INT.
7/23	BL	
BK#	FIELD BOOK	PG#
1/24	CALCS BY:	RRG
1/24	DESIGNED BY:	RRG
1/24	DRAWN BY:	COMP
1/24	CHECKED BY:	CAQ

UNITED CONSULTANTS INC.
 850 FRANKLIN STREET SUITE 11D
 WRENTHAM, MASSACHUSETTS 02093
 508-384-8580 FAX 508-384-8586

DATE
JAN. 5, 2024
SCALE
1" = 20'
PROJECT
UC1587
SHEET
10 of 10

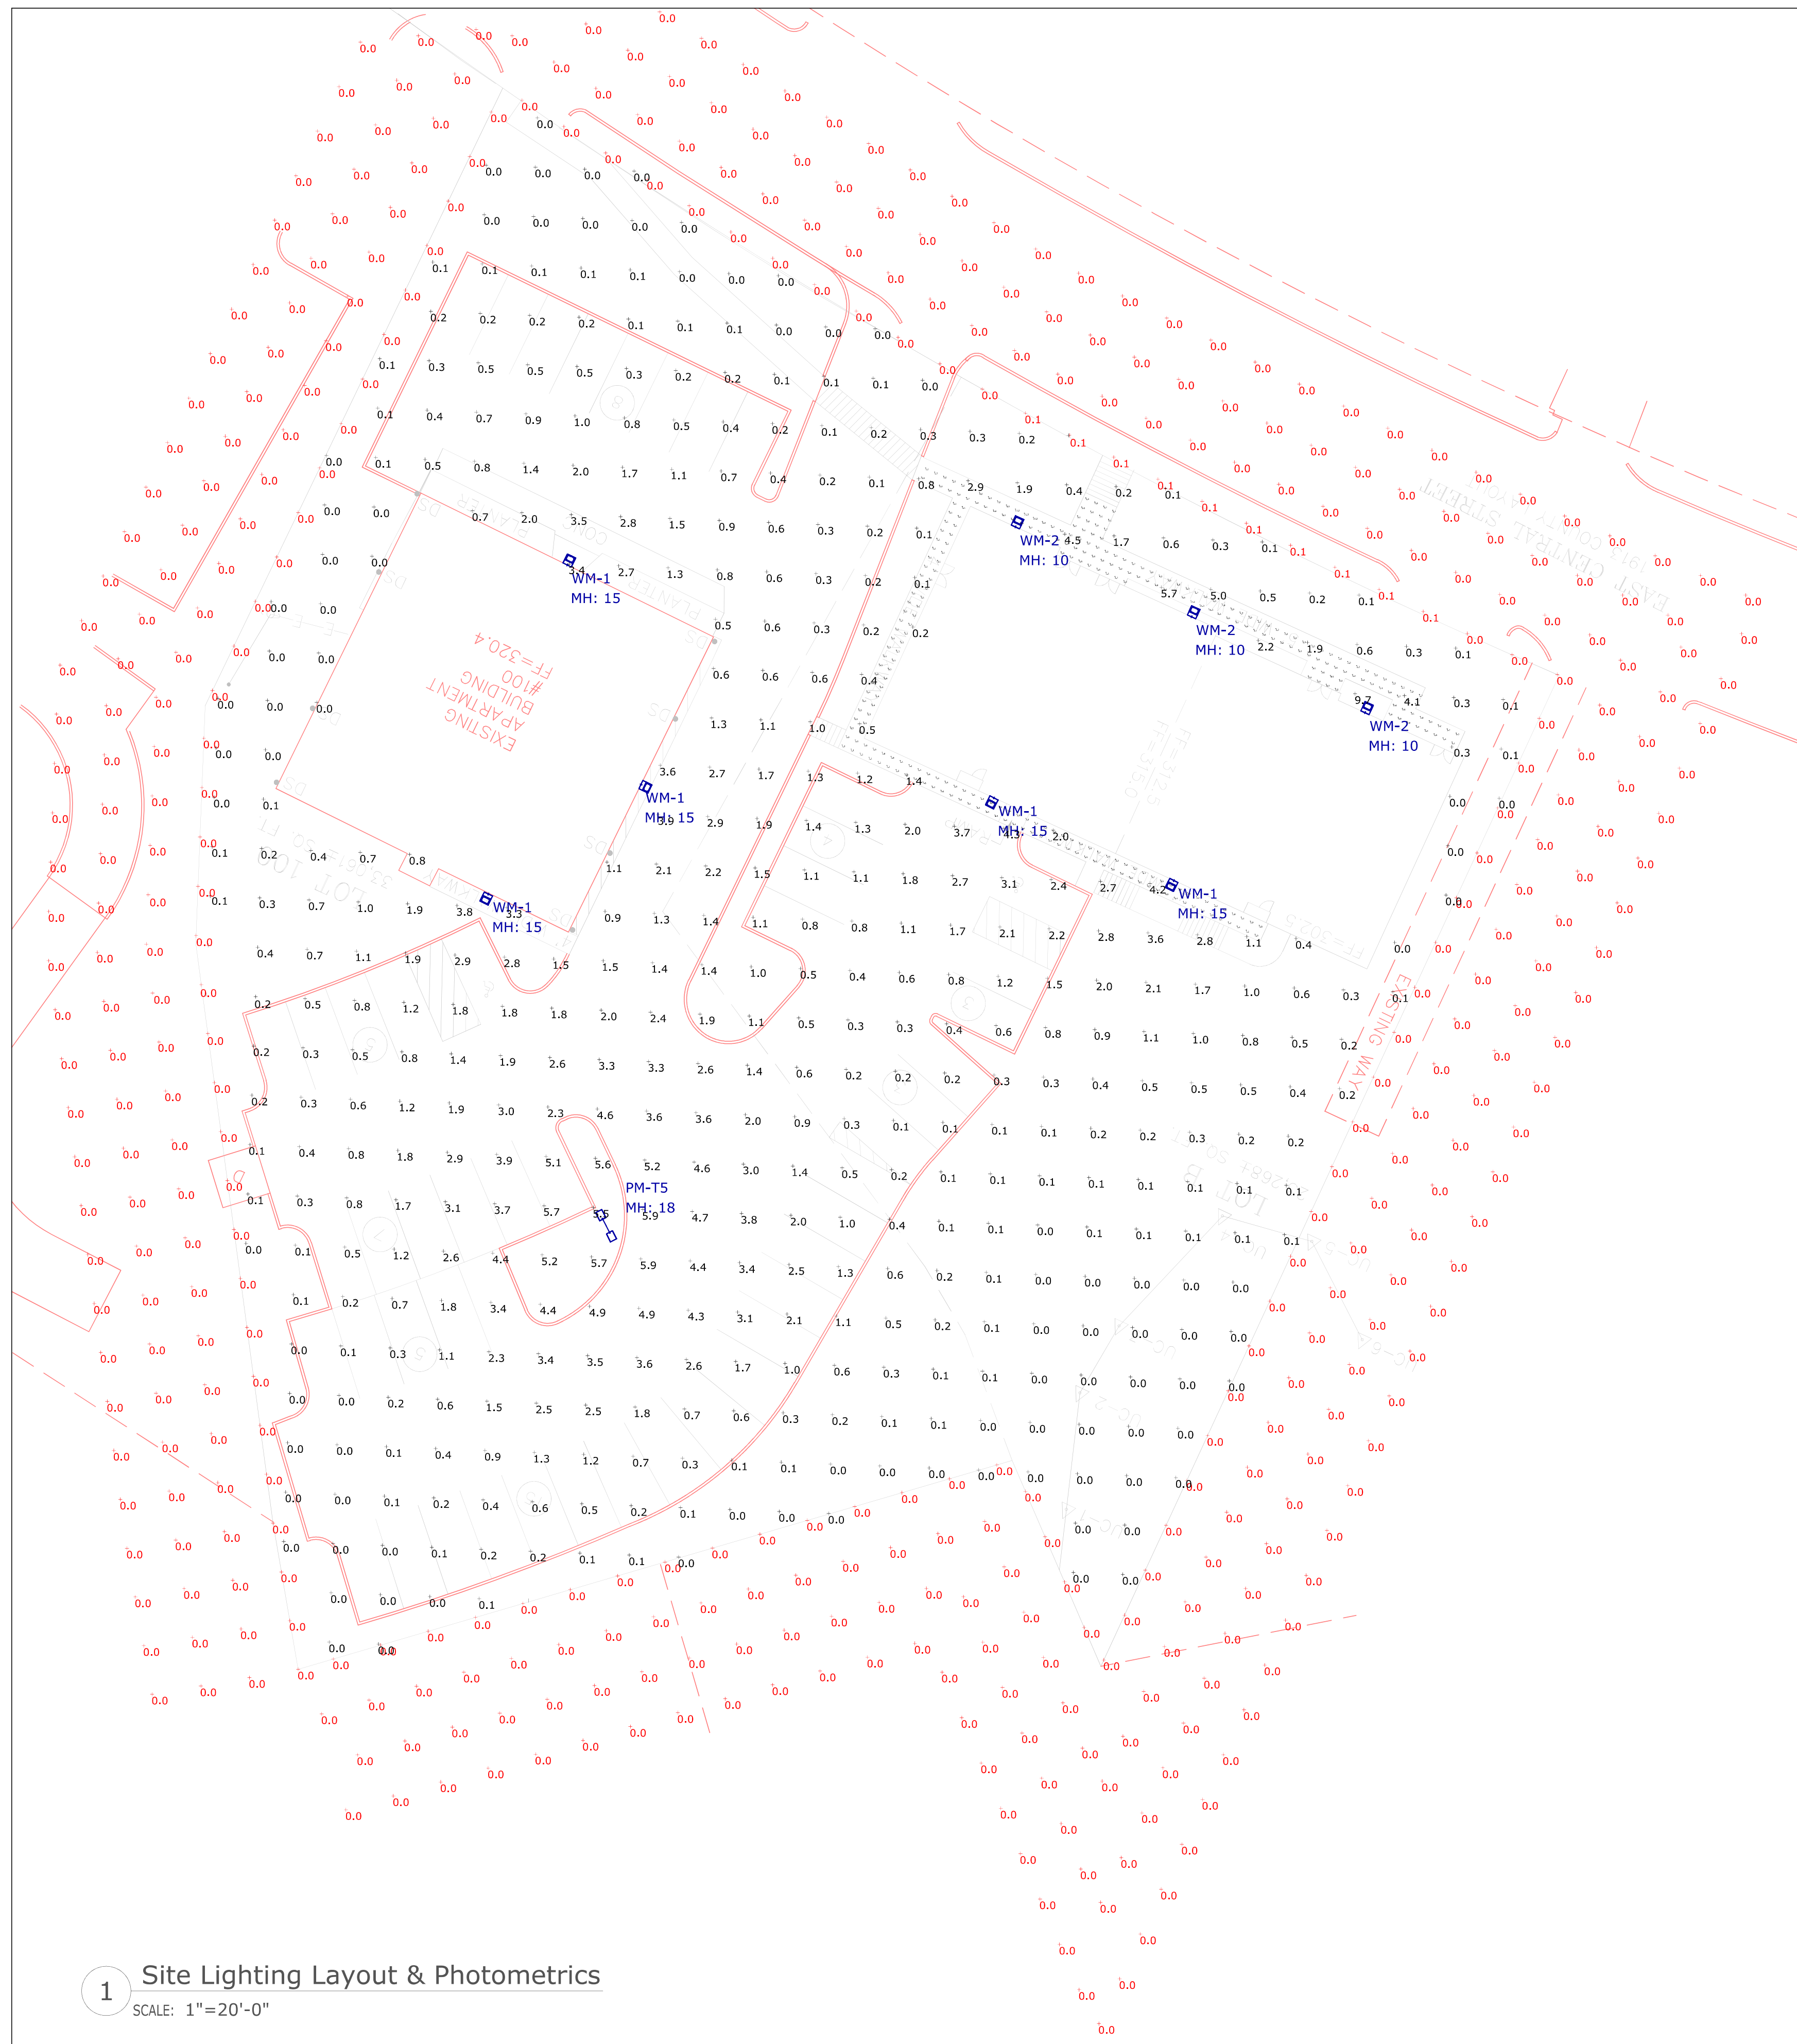

1 Site Lighting Layout & Photometrics
SCALE: 1"=20'-0"

Symbol	Label	Qty	Part Number	Arrangement	LLF	Total Watts	Total Luminaire Lumens	BUG Rating
[Symbol]	PM-T5	1	Solais Lighting # GL1-12H-SQS-730-STD-10-1PS-00-SBZ-ES / POLE # SSP18-5-11-BRZ-DM2180 / KAB13611R	Back-Back	0.950	164.56	24590	B4-U0-G2
[Symbol]	WM-1	5	Solais Lighting # GL1-5H-4WS-730-STD-10-0-BZ-WP	Single	0.950	44.5	5203	B1-U0-G2
[Symbol]	WM-2	3	Solais Lighting # GL1-2H-2RM-730-STD-10-0-BZ-WP-FS	Single	0.950	18	2232	B1-U0-G1

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
New Construction Walkway	Illuminance	Fc	2.85	11.5	0.1	28.50	115.00
Property Line	Illuminance	Fc	0.01	0.2	0.0	N.A.	N.A.
Site Points	Illuminance	Fc	1.03	9.7	0.0	N.A.	N.A.

- NOTES:
- A LIGHT LOSS FACTOR OF 0.950 HAS BEEN APPLIED TO FIXTURES UNLESS OTHERWISE NOTED. REFER TO LUMINAIRE SCHEDULE FOR LIGHT LOSS FACTOR AND LUMEN INFORMATION.
 - SEE "MH" ON LIGHTING FIXTURE TAG LOCATED ON PLAN FOR MOUNTING HEIGHT INFORMATION.
 - CALCULATION POINTS ARE TAKEN AT GRADE.
 - CALCULATION RESULTS ARE BASED ON IES STANDARDS UNLESS OTHERWISE REQUESTED.

GridLite GL3

LED SITE + AREA LUMINAIRE

QUICK FACTS	CONSTRUCTION	CONTRACTS	COMMENTS
<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory

ADDRESS INFORMATION

Line	Item	Quantity	Unit	Notes
1	GridLite GL3	1	Fixture	

2 Fixture Specification - Solais Lighting GridLite 3

GridLite Wall Pack

LED WALL PACK FIXTURE

QUICK FACTS	CONSTRUCTION	CONTRACTS	COMMENTS
<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory 	<ul style="list-style-type: none"> 120V - 277V Standard; 347 - 480V optional available 13 year warranty CHIP-scale package LEDs 0-10V dimming standard TGIC polyester super durable powder coating with superior gloss, color retention, and weather resistance; For incline grade finish, consult factory Die cast aluminum housing designed for optimal thermal performance Marine grade finish option available DAK Dark Sky listed 53000K IP65 milie optical and electrical chambers Surge Protection (ANSI C136.2-2015) 10kV 5kA Standard; 20kV 10kA optional Suitable for wet locations Rated for operation -40°C to 40°C; For 50°C, consult factory

ADDRESS INFORMATION

Line	Item	Quantity	Unit	Notes
1	GridLite Wall Pack	1	Fixture	

3 Fixture Specification - Solais Lighting GridLite WP

DATE:	REVISIONS	DESCRIPTION	DATE
January 11, 2024	1		
PROJECT NUMBER: 24-0028	2		
DRAWN BY: AD	3		
CHECKED BY: HD	4		
APPROVED BY: HD	5		
SCALE: AS NOTED	6		
	7		