

APPLICANT/OWNER: TMC HOLDINGS & DEVELOPMENT 2, LLC 25 FORGE PARKWAY FRANKLIN, MA 02038

CIVIL ENGINEER: ALLEN & MAJOR ASSOCIATES, INC. 400 HARVEY ROAD MANCHESTER, NH 03103


SURVEYOR: ALLEN & MAJOR ASSOCIATES, INC. 100 COMMERCE WAY **WOBURN, MA 01801**

SITE DEVELOPMENT PLANS FOR

25 FORGE PARKWAY

FRANKLIN, MA 02038

TAX MAP 275, LOT 14

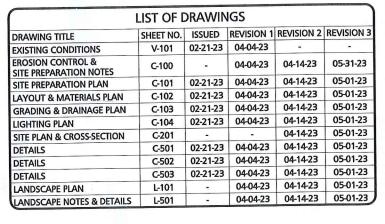





Copyright ©2023 Allen & Major Assor All Rights Reserved

RECEIVED TOWN OF FRANKLIN


MAY 08 2023

ZONING BOARD OF APPEALS


ISSUED FOR INITIAL REVIEW: FEBRUARY 21, 2023

REVISION 1: APRIL 4, 2023 REVISION 2: APRIL 14, 2023

REVISION 3: MAY 1, 2023



TOWN OF FRANKLIN APPROVAL STAMP

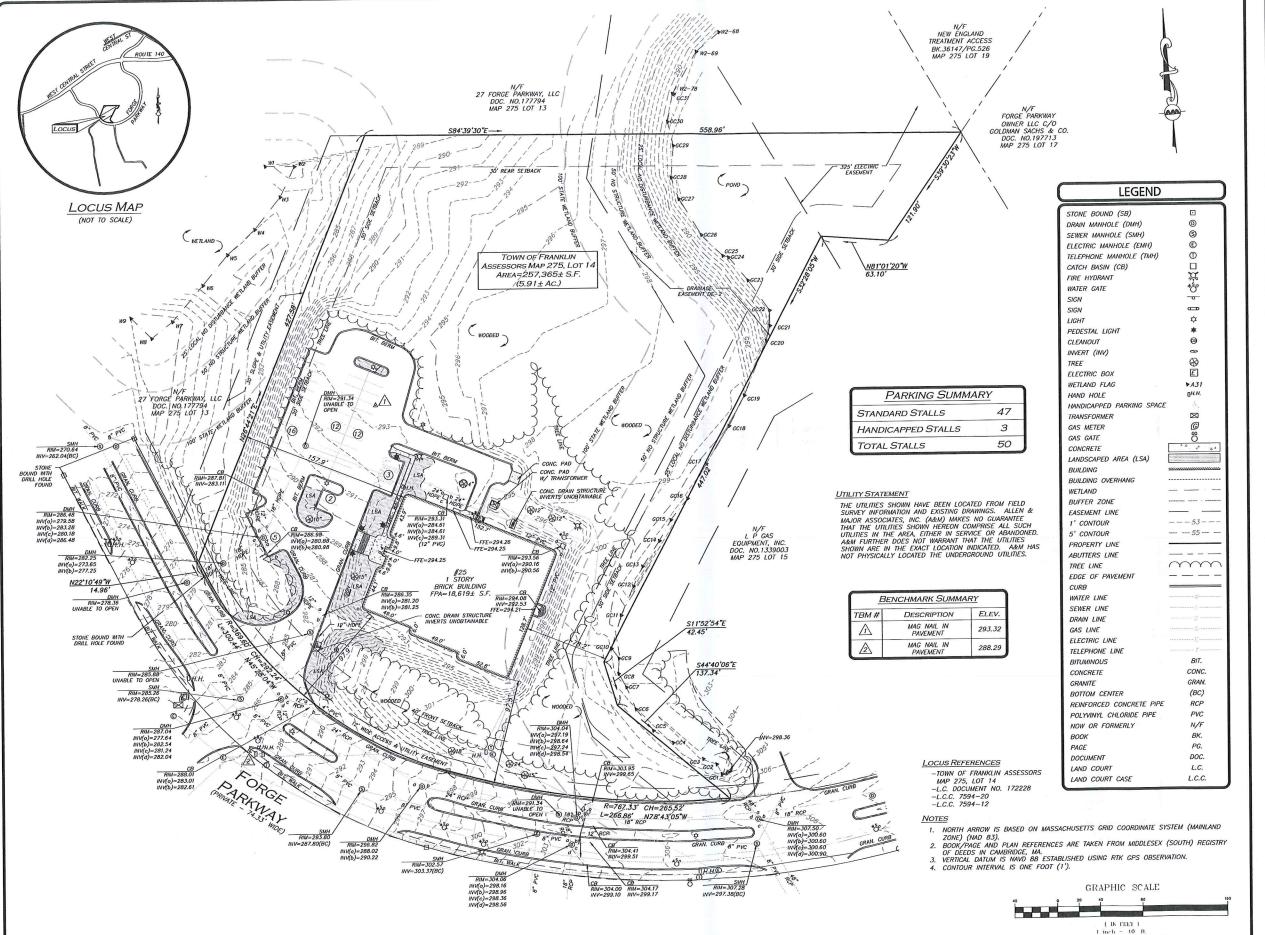

WE HEREBY CERTIFY THAT THIS PLAN IS THE RESULT OF AN ACTUAL ON THE GROUND SURVEY PERFORMED ON OR BETWEEN APRIL 1, 2021 AND FEBRUARY 15, 2023.

PROFESSIONAL LAND EURVEYOR FOR ALLEN & MAJOR ASSOCIATES, INC.



04/04/23 PEER REVIEW COMMENTS
 DATE DESCRIPTION

GREEN SITE SERVICES GROUP 24 WILLIAM WAY BELLINGHAM, MA 02019

PROJECT:

25 FORGE PARKWAY FRANKLIN, MA

 PROJECT NO.
 2712-02
 DATE:
 2/15/23

 SCALE:
 1* = 40'
 DWG. NAME:
 5-2712-02-EC

 DRAFTED BY:
 AJR
 CHECKED BY:
 NIII

PREPARED RV



civil engineering + land surveying ironmental consulting + landscape architec www.allenmajor.com

ntal consulting → landscape arch www.allenmajor.com 100 COMMERCE WAY WOBURN MA 01801-8501 TEL: (781) 935-6889 FAX: (781) 935-2896

WOBURN, MA . LAKEVILLE, MA . MANCHESTER, NE

THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT CLIENT/CLIENTS REPRESENTATIVE OR CONSULTANTS MAY BE PROVIDED COPES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HE INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT, DUE TO THE PROTECTION INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT, DUE TO THE PROTECTION OF THE PROTECTION

DRAWING TITLE:

R:\PROJECTS\2712-02\SURVEY\DRAWINGS\CURRENT\S-2712-02-EC.DWG

EXISTING CONDITIONS V-101

Copyright ©2023 Allen & Major Associates

- AREAS OF EXPOSED SOIL UNDERGOING CONSTRUCTION THAT WILL NOT BE COVERED AND OR FINISHED GRADED SHALL BE STABILIZED AS SOON AS PRACTICABLE BUT IN NO CASE MORE THAN 14 DAYS AFTER THE CONSTRUCTION ACTIVITY (UNLESS MUNICIPALITY HAS STRICTER REQUIREMENTS WHICH SHALL BE FOLLOWED) IN THAT PORTION OF THE SITE HAS TEMPORARILY OR PERMANENTLY CEASED. TEMPORARY EROSION CONTROL MEASURES SHALL INCLUDE EROSION CONTROL MESH, NETTING OR MULCH AS DIRECTED BY THE OWNER'S REPRESENTATIVE AND SHOWN ON THE DESIGN PLANS. IF MULCH IS USED, STRAW MULCH SHALL BE APPLIED AT THE RATE OF 4 BALES PER 1,000 SQUARE FEET. APPLICATION AREA SHALL BE SUFFICIENTLY COVERED WITH MULCH TO AVOID ANY VISIBLE SOIL EXPOSURE. MULCH SHALL BE KEPT MOIST TO AVOID LOSS DUE TO WIND. MULCH AND NETTING SHALL BE APPLIED IN THE BASE OF ALL GRASSED WATERWAYS, IN VEGETATIVE SLOPES WHICH EXCEED 15% AND DISTURBED AREAS WITHIN 100 FEET OF WEILANDS OR STREAMS.
- IF DISTURBED AREAS DO NOT RECEIVE FINAL SEEDING BY OCTOBER 1ST OF THE CONSTRUCTION YEAR, THEN ALL DISTURBED AREAS SHALL BE SEEDED WITH A WINTER COVER CROP AT THE RATE OF 3 LBS PER 1,000 SQUARE FEET. WINTER SEEDING SHALL BE COVERED WITH EROSION CONTROL MESH (MULCH AND NETTING). HEAVY GRADE MATS SHALL BE USED IN THE BASE OF ALL GRASSED WATERWAYS ON VEGETATED SLOPES IN EXCESS OF 15%, AND ANY DISTURBED AREAS WITHIN 100 FEET OF WETLANDS OR STREAMS. MULCH AND NETTING SHALL ALSO BE PROVIDED FOR ADDITIONAL WINTER PROTECTION.
- ALL TOPSOIL SHALL BE COLLECTED, STOCKPILED, SEEDED WITH RYE AT 3LBS PER 1,000 SQUARE FOOT AND MULCHED, AND REUSED AS REQUIRED. TUBULAR BARRIERS SHALL BE PIACED DOWN GRADIENT FROM STOCKPILED LOAM. LOAM SHALL BE STOCKPILED AT
- ALL TUBULAR BARRIERS, SILT SACKS, AND EROSION CONTROL BERMS SHALL BE INSTALLED ACCORDING TO THE SITE PREPARATION PLAN. THESE SHALL BE MAINTAINED DURING DEVELOPMENT TO REMOVE SEDIMENT FROM RUNOFF WATER. ALL THE FILTER BARRIERS AND EROSION CONTROL BERMS SHALL BE INSPECTED AFTER ANY RAINFALL OR RUNOFF EVENT, MAINTAINED AND CLEANED UNTIL ALL AREAS HAVE AT LEAST 85–90% VIGOROUS PERENNIAL COVER OF GRASSES.
- ADJACENT ROADS SHALL BE PERIODICALLY SWEPT OR WASHED TO AVOID TRACKING MUD, ADJACENT ROADS SHALL BE PERIODICALLY SWEP! OR WASHED IN AVOID INFECTION MOD. DUST OR DEBRIS FROM THE CONSTRUCTION AREA AS OFTEN AS NECESSARY (WHICH COULD BE ON A DAILY BASIS) TO REMOVE ANY SOIL OR SEDIMENTS AT NO ADDITIONAL COST TO THE OWNER. A WATERING TRUCK WILL BE USED TO PERIODICALLY SPRINKLE CONSTRUCTION AREAS IN ORDER TO KEEP THE LEVEL OF DUST TO A MINIMUM DURING THE DRY MONTHS AT NO ADDITIONAL COST TO THE OWNER.
- THE CONTRACTOR SHALL USE EXTREME CAUTION TO AVOID ALLOWING SEDIMENTS TO ENTER THE STORM DRAIN SYSTEM DURING CONSTRUCTION. BOTH EXISTING AND PROPOSED CATCH BASIN INLETS SHALL BE PROTECTED DURING CONSTRUCTION BY THE USE SILT SACKS AND/OR TUBULAR BARRIERS AROUND EACH INLET AS NOTED ON THE PLANS. INLET PROTECTION MAY BE REMOVED ONLY AFTER FINISHED AREAS ARE PAVED AND THE, VEGETATED SLOPES ARE ESTABLISHED WITH AT LEAST 85-90% OF VIGOROUS
- AS APPLICABLE, EROSION CONTROL MESH SHALL BE APPLIED IN ACCORDANCE WITH THE PLANS OVER ALL FINISHED SEEDED AREAS AS SPECIFIED ON THE DESIGN PLANS.
- AT A MINIMUM, ALL TUBULAR BARRIERS AND FILTER FABRIC SHALL REMAIN IN PLACE UNTIL SEEDINGS OR PLANTINGS HAVE BECOME 85-90% ESTABLISHED. THE LOCAL CONSERVATION COMMISSION MUST APPROVE THE REMOVAL OR RELOCATION OF ANY OF THE TUBULAR BARRIERS AND FILTER FABRIC. ONCE THE TUBULAR BARRIERS ARE REMOVED THE AREAS ARE TO BE LOAMED AND SEEDED TO ACHIEVE FULL STABILIZATION.
- AT THE OWNER'S DISCRETION ADDITIONAL EROSION CONTROL MEASURES MAY BE REQUIRED TO MAINTAIN STABILITY OF EARTHWORKS AND FINISHED GRADED AREAS. THE CONTRACTOR, AT HIS EXPENSE, WILL BE RESPONSIBLE FOR PROVIDING AND INSTALLING ANY ADDITIONAL MEASURES AS SPECIFIED BY THE OWNER. THIS INCLUDES BUT IS NOT LIMITED TO REQUESTS BY MA DEP, THE ENGINEER AND THE LOCAL MUNICIPALITY, AS AUTHORIZED BY THE OWNER. FAILURE TO COMPLY WITH THE OWNER'S DIRECTIONS WILL RESULT IN DISCONTINUATION OF CONSTRUCTION ACTIVITIES.
- 11. INSPECTIONS AND MONITORING MAINTENANCE MEASURES SHALL BE APPLIED AS NEEDED DURING THE ENTIRE CONSTRUCTION CYCLE. WEEKLY INSPECTIONS SHALL BE HELD THROUGH THE DURATION OF CONSTRUCTION ACTIVITY. WEEKLY INSPECTION REPORTS SHALL BE MAINTAINED BY THE CONTRACTOR AND LOCATED IN THE CONTRACTORS FIELD OFFICE ONSITE. IN ADDITION TO THE NORMAL WEEKLY INSPECTIONS, THE CONTRACTOR SHALL PERFORM AN INSPECTION OF ALL EROSION CONTROL MEASURES AFTER EACH RAINFALL OF 0.25" OR MORE, AND PERFORM THE NECESSARY REPAIRS. THE INSPECTIONS SHALL INCLUDE BUT NOT BE LIMITED TO THE SITE'S DOWN STREAM DISCHARGE POINTS.
- IF ANY EVIDENCE OF SEDIMENTATION IS OBSERVED AT THE STORMWATER MANAGEMENT AREA INLETS, THE CONTRACTOR SHALL, AT HIS OWN EXPENSE, PROVIDE A PLAN TO THE ENGINEER TO REMOVE ANY ACCUMULATED SEDIMENT IN THESE AREAS. THE CONTRACTOR SHALL ALSO IMMEDIATELY PROVIDE ADDITIONAL ON SITE EROSION AND SEDIMENTATION CONTROL MEASURES TO PREVENT FURTHER DEGRADATION OF THE AREA.
- FOLLOWING THE TEMPORARY OR FINAL SEEDINGS, THE CONTRACTOR SHALL INSPECT THE WORK AREA SEMI-MONTHLY TO ENSURE THE AREAS HAVE A MINIMUM OF 85-90% VEGETATED VIGOROUS GROWTH, RE-SEEDING SHALL BE CARRIED OUT BY THE CONTRACTOR WITH FOLLOW UP INSPECTIONS IN THE EVENT OF ANY FAILURES UNTIL VEGETATION IS ADEQUATELY ESTABLISHED.
- CONTRACTOR & ALL SITE SUBCONTRACTORS SHALL BE FAMILIAR WITH & FOLLOW ALL APPROVED PERMITS AND CONDITIONS. CONTRACTOR SHALL MAINTAIN A COPY OF ALL APPROVED PERMITS ONSITE. ALL CONDITIONS & RECOMMENDATIONS WITHIN THE APPROVED PERMITS SHALL BE COMPLETED.
- ALL EROSION MEASURES SHALL BE INSTALLED PRIOR TO CONSTRUCTION AND SHALL BE ADEQUATE TO MAINTAIN SEDIMENT ON SITE. ANY MODIFICATIONS SHALL BE INSTALLED AS DIRECTED BY THE ENGINEER OR THE LOCAL MUNICIPALITY.
- EROSION AND SEDIMENTATION CONTROL MEASURES SHALL BE MAINTAINED DURING CONSTRUCTION, AND SHALL REMAIN IN PLACE UNTIL ALL SITE WORK IS COMPLETE AND GROUND COVER IS ESTABLISHED.
- 17. TOP OF STOCKPILES SHALL BE COVERED IN SUCH MANNER THAT STORMWATER DOES NOT INFILTRATE THE MATERIALS AND THEREBY RENDER THE SAME UNSUITABLE FOR

EROSION & SEDIMENTATION CONTROL NOTES (CONTINUED):

- 18. ALL DISTURBED OR EXPOSED AREAS SUBJECT TO EROSION SHALL BE STABILIZED WITH MULCH OR SEEDED FOR TEMPORARY VEGETATIVE COVER. NO AREA, SUBJECT TO EROSION SHALL BE LEFT DISTURBED AND UNSTABILIZED FOR PERIODS LONGER THAN IS ABSOLUTELY NECESSARY TO CARRY OUT THAT PORTION OF THE CONSTRUCTION WORK OR SIX MONTHS AFTER SOIL HAS BEEN DISTURBED WHICHEVER IS LESS.
- CULVERT/PIPE INLETS AND OUTFALLS SHALL BE PROTECTED BY TUBULAR BARRIER STABILIZED.
- TUBULAR BARRIER DIKES SHALL BE CONSTRUCTED AT ALL EXISTING & PROPOSED CATCH BASINS. NO SEDIMENTATION SHALL ENTER THE ON-SITE OR OFF-SITE DRAINAGE SYSTEMS AT ANY TIME.
- ALL EROSION CONTROL MEASURES SHALL BE ROUTINELY INSPECTED, CLEANED AND REPAIRED OR REPLACED AS NECESSARY THROUGHOUT ALL PHASES OF CONSTRUCTION. IN ADDITION, INSPECTIONS SHALL TAKE PLACE WEEKLY AND BEFORE AND AFTER EACH RAINFALL EVENT.
- ALL PROPOSED SLOPES STEEPER THAN 3:1 SHALL BE STABILIZED WITH JUTE MESH AND PROTECTED FROM EROSION UNTIL WORK IS COMPLETE AND GROUND COVER IS ESTABLISHED.
- 23. THE CONTRACTOR SHALL KEEP ON SITE AT ALL TIMES ADDITIONAL TUBULAR BARRIERS FOR INSTALLATION AT THE DIRECTION OF THE ENGINEER OR THE TOWN ENGINEER TO MITIGATE ANY EMERGENCY CONDITION.
- AS CONSTRUCTION DISTURBANCE IS GREATER THAN 1 ACRE, A NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) CONSTRUCTION GENERAL PERMIT NOI, AND DISCHARGE ELIMINATION STSTEM (MPDES) CONSTRUCTION SCREEDE, FLANDING TO, AND STORM WATER POLLUTION PREVENTION PLAN (SWPPP) WILL NEED TO BE SUBMITTED IT THE FPA. THE NPDES PERMIT FOR STORM WATER DISCHARGE, & CONSTRUCTION GENERAL PERMIT NO! WILL BE REQUIRED TO BE SUBMITTED AT LEAST 14 DAYS PRIOR TO COMMENCING CONSTRUCTION BY THE CONTRACTOR.
- 25. OWNER AND CONTRACTOR ARE RESPONSIBLE FOR COMPLIANCE WITH THE CONSTRUCTION GENERAL PERMIT NOI. WEEKLY SWPPP INSPECTION REPORTS TO BE PERFORMED BY CONTRACTOR. COPIES OF ALL SWPPP INSPECTION REPORTS SHALL BE PROVIDED TO THE LOCAL MUNICIPALITY, EPA, DEP, OR ANY OTHER AUTHORITY REQUESTING WITHIN 3 DAYS OF EACH INSPECTION.
- 26. APPLICABLE WORK AND MATERIALS SHALL COMPLY WITH ALL LOCAL, MA DEP, EPA CONSTRUCTION GENERAL PERMIT STANDARDS. ALL CONSTRUCTION SHALL CONFORM TO THE APPLICABLE SITE PLAN REQULATIONS FROM THE LOCAL AND USDA SOIL CONSERVATION SERVICE VEGETATIVE PRACTICES IN SITE DEVELOPMENT.
- 27. A WATERING TRUCK SHALL BE USED TO PERIODICALLY SPRINKLE CONSTRUCTION AREAS IN ORDER TO KEEP THE LEVEL OF DUST TO A MINIMUM DURING THE DRY MONTHS AND AS REQUIRED.
- AND AS REQUIRED.

 28. IF DEWATERING IS NECESSARY IT SHALL ONLY BE COMPLETED AS FOLLOWS: THE DISCHARGE SHALL BE STOPPED IMMEDIATELY IF THE RECEIVING AREA SHOWS ANY SIGN OF INSTABILITY OR EROSION. ALL CHANNELS, SWALES, AND DITCHES DUG FOR DISCHARGING WATER FROM THE EXCAVATED AREA SHALL BE STABLE PRIOR TO DIRECTING DISCHARGE TO THEM. IF A CONSTRUCTION EQUIPMENT BUCKET IS USED, IT SHALL EMPTY THE MATERIAL TO A STABLE AREA. NO DEWATERING SHALL OCCUR DURING PERIODS OF INTENSE, HEAVY RAIN, FLOW TO THE SEDIMENT REMOVAL STRUCTURE SHALL NOT EXCEED THE STRUCTURE'S CAPACITY TO SETTLE AND FILTER FLOW OR ITS VOLUME CAPACITY. WHENEVER POSSIBLE, THE DISCHARGE FROM THE SEDIMENT REMOVAL STRUCTURE SHALL DRAIN TO A WELL—VECETATED BUFFER BY SHEET FLOW WHILE MAXIMIZING THE DISTANCE TO THE NEAREST WATER RESOURCE AND MINIMIZING THE SLOPE OF THE BUFFER AREA, THERE SHALL BE NO DIRECT DISCHARGE TO EXISTING WETLANDS OR STREAMS. ALL DISCHARGE SHALL BE IN COMPLIANCE WITH STATE, LOCAL, AND FEDERAL REQUIREMENTS.
- 29. INITIATE STABILIZATION OF EXPOSED AREAS IMMEDIATELY IF CONSTRUCTION WORK ORARILY OR PERMANENTLY CEASES.
- 30. ALL DISCHARGES FROM POLLUTION SOURCES ARE PROHIBITED ONSITE SUCH AS FUELS, ALL DISCHARGES FROM POLLUTION SOURCES ARE PROHIBITED ONSITE SUCH AS FUELS, WASTEWATER FROM WEAH OUT OF CONCRETE, WASTEWATER FROM CLEAN OUT OF PAINTS, FORM RELEASE OILS, SOLVENTS, ADHESIVES, CURING COMPOUNDS, POLLUTANTS USED FOR MAINTENANCE OF VEHICLES AND EQUIPMENT, SOAPS & SOLVENTS, TOXIC OR HAZARDOUS SUBSTANCES, CHEMICALS AND OILS. IF A POLLUTANT IS DISCHARGED IT NEEDS TO BE IMMEDIATELY CLEANED UP BY REMOVING THE CHEMICAL AND AFFECTED SOIL OR AREA OF SPILL FROM THE SITE IN ACCORDANCE WITH BOTH THE MANUFACTURER RECOMMENDATIONS, FEDERAL, STATE, AND LOCAL REQUIREMENTS. DO NOT HOSE DOWN AND SPREAD SPILLED ITEM. ALL CHEMICALS USED ON THE SITE SHALL BE IN LEAK—PROOF CONTAINERS STORED AWAY FROM WETLANDS, SURFACE WATERS, STORMWATER INLETS, AND DRAINAGE MEASURES. SPILL KITS SHALL BE AVAILABLE ONSITE FOR EMERGENCY USE. THERE SHALL BE A SECONDARY CONTAINMENT MEASURE OF ALL CHEMICALS IN ADDITION TO SPILL—PROOF CONTAINERS.
- 31. PRIOR TO COMMENCEMENT OF CONSTRUCTION, APPLICABLE CONTRACTOR PERSONNEL MUST HAVE AN UNDERSTANDING OF THE EPA CONSTRUCTION GENERAL PERMIT REQUIREMENTS AND THEIR SPECIFIC RESPONSIBILITIES UNDER THE PERMIT. AT A MINIMUM, PERSONNEL MUST BE TRAINED AND UNDERSTAND THE FOLLOWING: LOCATION OF ALL STORMWATER CONTROLS AND HOW TO MAINTAIN THEM, PROCEDURES FOR COMPLYING WITH THE POLLUTION PREVENTION REQUIREMENTS. PROCEDURES FOR CONDUCTING INSPECTIONS, RECORDING FINDINGS, AND TAKING CORRECTIVE ACTION.
- 32. ALL SEDIMENT TRACKED ONTO ROADWAYS MUST BE REMOVED AT END OF EACH WORK
- 33. ALL USE OF CATIONIC TREATMENT CHEMICALS (EXAMPLES INCLUDE POLYMERS, CHITOSAN, CATIONIC PAM, FLOCCULANTS OR OTHER CHEMICAL UTILIZED FOR STABILIZATION) ARE PROHIBITED, IF ALL OTHER AVAILABLE STABILIZATION MEASURES ARE NOT POSSIBLE AND USE OF CATIONIC CHEMICALS IS ABSOLUTELY NECESSARY THE CONTRACTOR WILL NEED TO CONTACT THE EPA NEW ENGLAND OFFICE IN WRITING FOR APPROVAL AND SPECIFIC REQUIREMENTS (MAXIMUM DOSAGE RATE, RESIDUAL TESTING, SPECIFIC LIMITATIONS, ETC) PRIOR TO USE.
- IF USING NON-VEGETATIVE STABILIZATION MEASURES, IT MUST BE COMPLETED NO LATER THAN 14 DAYS AFTER INITIATING STABILIZATION. ALL AREAS OF EXPOSED SOILS MUST BE COVERED.
- 35. INSPECTIONS OF EROSION CONTROL MEASURES SHALL BE AT LEAST ONCE EVERY 7
 DAYS BY THE CONTRACTOR. AT A MINIMUM INSPECTIONS SHALL INCLUDE ALL DISTURBED
 AREAS, ALL STORMWATER CONTROLS AND POLLUTION PREVENTION MEASURES, ALL
 LOCATIONS WHERE STABILIZATION MEASURES HAVE BEEN IMPLEMENTED, EQUIPMENT AND
 MATERIAL STORAGE AREAS, ALL AREAS WHERE STORMWATER FLOWS AND ALL POINTS OF
 DISCHARGE, WHEN CORRECTIVE ACTIONS ARE REQUIRED, THE CONTRACTOR MUST
 IMMEDIATELY TAKE ALL STEPS TO PREVENT POLLUTANT DISCHARGES UNTIL A
 PERMANENT SOLUTION IS IMPLEMENTED. AS NECESSARY NEW OR MODIFIED CONTROLS
 MUST BE INSTALLED AND OPERATIONAL, THE REPAIR MUST BE COMPLETED WITHIN 7
 DAYS FROM THE TIME OF DISCOVERY, WITHIN 24 HOURS OF A TRIGGERING CONDITION
 OCCURRING THAT REQUIRES A CORRECTIVE ACTION, A CORRECTIVE ACTION REPORT

ALL MEASURES STATED ON THE STORMWATER POLLUTION PREVENTION PLANS, SHALL BE MANITAINED IN FULLY FUNCTIONAL CONDITION BY CONTRACTOR UNTIL NO LONGER REQUIRED FOR A COMPLETED PHASE OF WORK OR FINAL STABILIZATION OF THE SITE. ALL EROSION AND SEDIMENTATION CONTROL MEASURES SHALL BE CHECKED BY A QUALIFIED PERSON IN ACCORDANCE WITH THE CONTRACT DOCUMENTS OR THE APPLICABLE PERMIT, WHICHEVER IS MORE STRINGENT, AND REPAIRED IN ACCORDANCE WITH THE FOLLOWING:

- 1. INLET PROTECTION DEVICES AND BARRIERS SHALL BE REPAIRED OR REPLACED IF THEY SIGNS OF UNDERMINING, OR DETERIORATION.
- ALL SEEDED AREAS SHALL BE CHECKED REGULARLY TO SEE THAT A HEALTHY STAND OF GRASS IS MAINTAINED. AREAS SHOULD BE FERTILIZED, WATERED, AND RESEEDED AS NEEDED.
- ALL SEDIMENT CONTROLS SHALL BE REPAIRED TO THEIR ORIGINAL CONDITIONS IF DAMAGED. SEDIMENT SHALL BE REMOVED FROM THE TUBULAR SEDIMENT CONTROLS WHEN IT REACHES HALF THE HEIGHT OF THE CONTROL MEASURE OR AS REQUESTED BY THE OWNER OR ENGINEER.
- THE CONSTRUCTION ENTRANCES SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOW OF MUD ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING OF THE CONSTRUCTION ENTRANCES AS CONDITIONS DELAMAD.
- THE TEMPORARY PARKING AND STORAGE AREA SHALL BE KEPT IN GOOD CONDITION (SUITABLE FOR PARKING AND STORAGE). THIS MAY REQUIRE PERIODIC TOP DRESSING OF THE TEMPORARY PARKING AS CONDITIONS DEMAND.
- OUTLET STRUCTURES IN THE SEDIMENTATION BASINS SHALL BE MAINTAINED IN OPERATIONAL CONDITIONS AT ALL TIMES. SEDIMENT SHALL BE REMOVED FROM SEDIMENT BASINS OR TRAPS WHEN THE DESIGN CAPACITY HAS BEEN REDUCED BY 50%.

CONSTRUCTION GENERAL PERMIT NOTES AND NARRATIVE:

NARRATIVE: THE STORMWATER POLLUTION PREVENTION PLANS CONSIST OF THE SITE PREPARATION PLAN TOGETHER WITH AN EXISTING CONDITIONS PLANS, GRADING PLANS, ABBREVIATIONS AND NOTES SHEETS, AND DETAIL SHEETS.

- THE EROSION CONTROL PLAN WILL BE IMPLEMENTED TO:
- A. TREAT EROSION AS SOON AS POSSIBLE AFTER DISTURBANCE.
- B. PREVENT SEDIMENT FROM LEAVING THE CONSTRUCTION AREA AND ENTERING THE
- C. CONSTRUCTION ACTIVITIES SHALL BE SCHEDULED TO MINIMIZE EROSION
- D. ONLY DISTURB, CLEAR, OR GRADE AREAS NECESSARY FOR CONSTRUCTION



3	05-01-23	REVISION 3 PER REVIEW COMMENT
2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

PROJECT NO. 2712-02A DATE: 02-21-2 C-2712-02 SCALE: DESIGNED BY: SM/JRG CHECKED BY:



civil engineering + land surveying ironmental consulting . landscape archite 100 COMMERCE WAY, SUITE 5

C-100

THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY B PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HEI PROVIDED COMES OF DRAWINGS AND SPECIFICATIONS FOR HISHHEI INFORMATION AMOJOR SPECIAL USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINTEMPONALITY OR OTHERWISE, ALIEN & MANDA ASSOCIATES, INC. MAY BEMOVE ALL INDICATION OF THE DOCUMENTS AUTHORSHIP ON THE DIGITAL MEDIA PRIMITED REPRESENTATIONS OF PORTABLE DOCUMENT FORMAT OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COMES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

FROSION CONTROL & SITE PREPARATION NOTES Copyright © 2023 Allen & Major Associates, Inc.

- PRESAME TEUPODARY PARKING AND STORAGE AREA. UPON INDELEDITATION AND INSTALLATION OF THE FOLLOWING RABES TRAILER, PARKING. LAY DOWN WHELL WICK. CONCRETE WISHOUT, MASONS AREA, FUEL AND MATERY STORAGE CONTAINERS, SICU, DEVIDE THEM ON THE STEE MAPS IMMEDIATELY AND NOTE ANY CHANGES IN THE LOCATIONS AS THEY OCCUR THROUGHOUT THE CONSTRUCTION PROCESS.
- INSTALL THE TUBULAR BARRIERS AND SILT SACKS AS SHOWN HEREON. EROSION CONTROL BARRIERS MUST BE INSPECTED AND APPROVED BY A PROFESSIONLE ABONERS OR LICENSED WEITHANDS SCIENTIST. NO SEDIMENTATION BARRIER MAY BE REMOVED WITHOUT PRIOR APPROVAL OF THE COMMISSION OR ITS STAFF.
- 5. CLEAR AND GRUB THE SITE.
- CONSTRUCT TEMPORARY SEDIMENTATION AND SEDIMENT TRAP BASINS AS NECESSARY.

- CONSTRUCT STORMWATER MEASURES. SITE SHALL BE STABILIZED PRIOR TO STORMWATER MEASURES RECEIVING RUNOFF.
- 8. START CONSTRUCTION OF BUILDING PAD AND STRUCTURES, TEMPORARIL SEED DENUDED AREAS. ALL CUT AND FILL SLOPES SHALL BE SEEDED / LOAMED WITHIN 72 HOURS OF ACHIEVING FINISH GRADE, EXCEPT WHERE RIP RAP IS APPLIED.
- 9. INSTALL BUILDING, UTILITIES, STORM SEWERS, CURBS AND GUTTERS.
- 10. INSTALL INLET PROTECTION DEVICES AROUND ALL STORM DRAIN STRUCTURES.
- 11. INSTALL RIP RAP AROUND OUTLET STRUCTURES.

W1 - W2

INSTALL DOUBLE ROW OF TUBULAR SEDIMENT BARRIER

FORGE

PART ANALY MOON

- 12. FINALIZE GRADING, AND PREPARE SITE FOR PAYING. NOTE, ALL PARKING LOTS SHALL BE STABILIZED WITHIN 72 HOURS OF ACHIEVING FINISH GRADE.
- 13. PAVE SITE. COMPLETE FINISH GRADING AND INSTALL PERMANENT SEEDING AND PLANTING.
- ONCE SITE IS STABILIZED, REMOVE ALL TEMPORARY EROSION AND SEDIMENT CONTROL DEVICES.
- 15. ALL EROSION CONTROL MEASURES SHALL BE INSPECTED WEEKLY AND AFTER ALL RAINFALL EVENTS GREATER THAN 0.25°, AND SHALL BE MAINTAINED, REPAIRED OR REPLACED AS REQUIRED OR AT THE DIRECTION OF THE OWNER'S ENGINEER, OR THE TOWN ENGINEER.

LIMIT OF WORK

INSTALL DOUBLE ROW OF TUBULAR SEDIMENT BARRIER WHERE SLOPE EXCEEDS 3:1

GAS METER, FE POV TO REMAIN COORDINATE W.

INSTALL SILT SACK INLE
PROTECTION WITHIN
EXISTING CATCH BASIN

PROTECT & MAINTAIN -EXISTING BUILDING TO REMAIN.

SMH RIM=302.57 RIM= to 1.72(80)

APPOXIMATE LOCATION OF TEMPORARY DEWATERING RECHARGE AREA

LIMIT OF WORK

INSTALL SILT SACK INLET

- 16. SEDIMENT ACCUMULATION UP-GRADIENT OF THE TUBULAR BARRIERS GREATER THAN 6" IN DEPTH SHALL BE REMOVED AND DISPOSED OF IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS.
- 17. IF IT APPEARS THAT SEDIMENT IS EXTING THE SITE, SILT SACKS SHALL BE INSTALLED IN ALL CATCH BASINS ADJACENT TO THE SITE. SEDIMENT ACCUMULATION ON ALL ADJACENT TACH BASIN NILETS SHALL BE REMOVED AND THE SILT SACK REPLACED IF TORN OR DAMAGED.
- THE CONTRACTOR SHALL COMPLY WITH THE GENERAL AND EROSION NOTES AS SHOWN ON THE SITE DEVELOPMENT PLANS, SEE ALSO SHEET C-001.

The state of the s

€GC30

EXISTING TREES T.B.R.

EXISTING ORAIN
LINE TO REMAIN
EXISTING GAS, ELECTRICAL
TELE/DATA CONDUITS TO
REMAIN. COORDINATE
CONNECTION TO EXISTING
BUILDING AND PROPOSED



LEGEND LIMIT OF DISTURBANCE LIMIT OF 'CLEAR AND GRUB' STABILIZED ENTRANCE STOCKPILE/STAGING AREA TUBULAR BARRIER E UTILITY CUT AND CAP CATCH BASIN FILTER \boxtimes

NOTES:

- 1. THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE . THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AND STRUCTURES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF VARIOUS UTILITY COMPANIES AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THIS INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE LOCATION OF ALL UNDERGROUND UTILITIES AND STRUCTURES SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION.
- 2. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE OCCASIONED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
- ONDERGROUD OTICHIES.

 3. THE CONTRACTOR MUST CONTACT THE APPROPRIATE UTILITY COMPANY, ANY GOVERNING PERMITTING AUTHORITY, AND "DIGSAFE" AT LEAST 72 HOURS PRIOR TO ANY EXCAVATION WORK TO REQUEST EXACT FIELD LOCATION OF UTILITIES. THE ENGINEER SHALL BE NOTHIED IN WRITING OF ANY UTILITIES INTERFERING WITH THE PROPOSED CONSTRUCTION AND APPROPRIATE REMEDIAL ACTION TAKEN BEFORE PROCEEDING WITH THE WORK, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.
- 4. ALTHOUGH CERTAIN ITEMS HAVE BEEN NOTED ON THIS DRAWING FOR DEMOLITION, NO ATTEMPT HAS BEEN MADE TO DELINEATE EACH AND EVERY ITEM THAT REQUIRES DEMOLITION FOR THE COMPLETION OF THE PROJECT. THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL NECESSARY DEMOLITION WORK TO COMPLETE THE PROJECT. ALLEN & MAJOR ASSOCIATES, INC. IS NOT RESPONSIBLE FOR SITE DEMOLITION ITEMS NOT SHOWN OTHE SURVEY, OR SPECIFICALLY NOTED. THE DEMOLITION NOTES AND ARROWS ON THIS PLAN ARE TYPICAL AND DO NOT REFLECT QUANTITY.
- 5. THE ENGINEER SHALL BE NOTIFIED IN WRITING OF ANY UTILITIES INTERFERING WITH THE PROPOSED CONSTRUCTION AND APPROPRIATE REMEDIAL ACTION TAKEN BEFORE PROCEEDING WITH THE WORK. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLAN.
- EROSION CONTROL MEASURES SHALL BE INSTALLED PRIOR TO THE START OF CONSTRUCTION. IF IT ADDITIONAL MEASURES ARE NECESSARY DURING CONSTRUCTION THEY SHALL BE INSTALLED IMMEDIATELY AND WITHOUT DELAY, SEE DETAIL SHEET C-501 FOR ADDITIONAL INFORMATION.
- 7. INLET PROTECTION SHALL BE INSTALLED IN PROPOSED CATCH BASINS IMMEDIATELY UPON CONSTRUCTION.
- 8. THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. ITS INTENDED USE IS TO PROVIDE INFORMATION. ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OR DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS STRICTLY PROHIBITED.

GRAPHIC SCALE (IN FEET) 1 inch - 40 ft.



PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

3	05-01-23	REVISION 3 PER REVIEW COMMENTS
2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

ROJECT NO. 2712-02A DATE: 02-21-2 1" = 40' DWG. NAME: C-2712-02 SCALE: DESIGNED BY: SM/JRG CHECKED BY:



civil engineering + land surveying nmental consulting + landscape architec www.allenmajor.com 100 COMMERCE WAY, SUITE 5 WOBURN MA 01801 TEL: (781) 935-6889 FAX: (781) 935-2896

OBURN, MA . LAKEVILLE, MA . MANCHESTER, 1

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NII
THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT.
CHENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE
PROVINDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/PIER
HORDAMATION AMOYOR SPECIFIC USE ON THIS PROJECT, DUE TO THE
POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED
UNINITERITONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES,
BUC. MAY REMOVE ALL INDICATION OF THE DOCUMENTS
AUTHORSHOP ON THE DIGITAL HEGDA PRINTER PRESENTATIONS OR
PORTABLE DOCUMENT FORMAT OF THE DRAWINGS AND
SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF
ALIEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

DENMANG, THE ...

LELEET MA.


C-101 SITE PREPARATION PLAN

Copyright ©2023 Allen & Major Associates, Inc. All Rights Reserved

REFORE YOU DIG CALL 811 OR 1-888-DIG-SAFE 1-888-344-7233

DIG SAFE

STONE BCUILD MITH DRILL HOLE FOUND

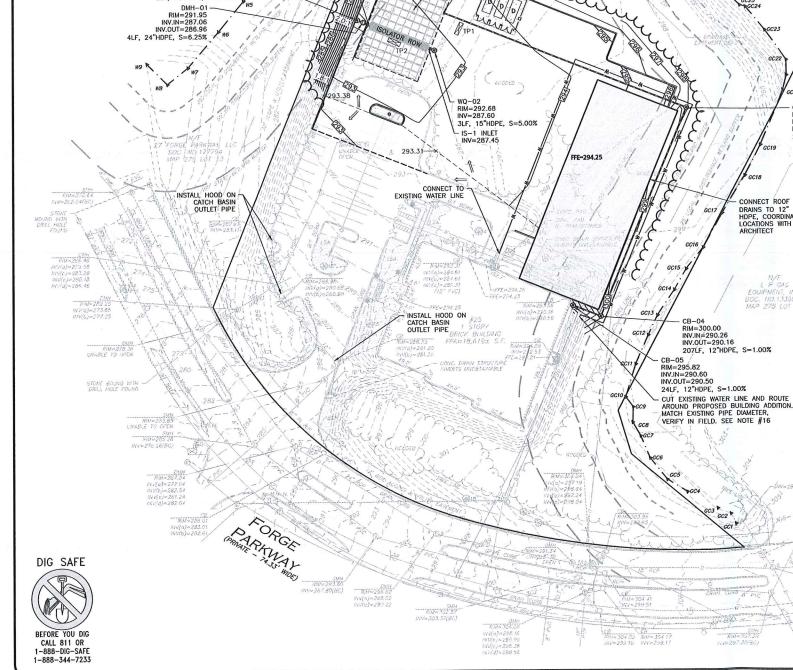

HW-01-INV=286.00

IS-1 INLET INV=286.71

OCS-01 RIM=293.23 WEIR=289.60 INV.IN=286.71 INV.OUT=286.50


25LF, 8"HDPE, S=2.00%

IS-1 OUTLET INV=286.71 3LF, 24"HDPE, S=0.0%

IMPERMEABLE LINER ON DOWN GRADIENT SIDE OF INFILTRATION SYSTEM, SEE DETAIL

INSPECTION PORT

INV=285.61

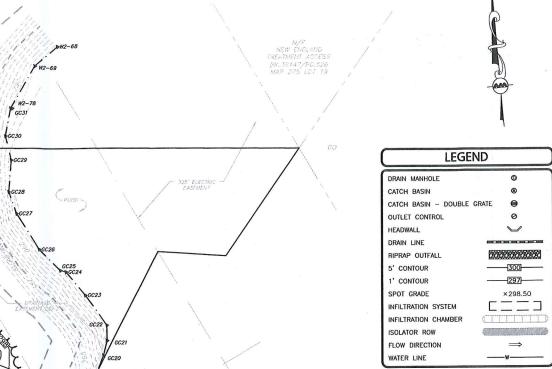

240LF, 12"HDPE, S=1.00%

C

ESHWT: NONE WEEP: NONE REFUSAL: NONE

- CONNECT ROOF DRAINS TO 12" HDPE, COORDINA LOCATIONS WITH ARCHITECT

TEST PIT #1 (TP1) PERFORMED BY: BRIAN D. JONES, PE DATE: 02-10-2023

TEST PIT #2 (TP2) PERFORMED BY: BRIAN D. JONES, PE DATE: 02-10-2023

TEST PIT #3 (TP3)
PERFORMED BY: BRIAN D. JONES, PE
DATE: 02-10-2023

HORIZON DEPTH TEXTURE COLOR STRUCTURE

0-8" LOAMY 10YR ₹ MASSIVE, FRIABLE

8-24" LOAMY SAND 10YR & MASSIVE, FRIABLE

24-66" LOAMY 2.5Y & MASSIVE, FRIABLE

HORIZON DEPTH TEXTURE COLOR STRUCTURE

0-8" LOAMY SAND 10YR ₹ MASSIVE, FRIABLE

8-28" LOAMY 10YR & MASSIVE, FRIABLE

28-108" LOAMY 2.5Y MASSIVE, FRIABLE

HORIZON DEPTH TEXTURE COLOR STRUCTURE

HTM 0-36" LOANY 10YR \$ MASSIVE, FRIABLE

C1 36-60" LOAMY 2.5Y \$ MASSIVE, FRIABLE C2 60-100 SANDY 10YR 8 MASSIVE, FIRM

NOTES:

NOTES

- EXISTING CONDITIONS WERE COMPILED FROM AN ON THE GROUND SURVEY PERFORMED BY ALLEN & MAJOR ASSOCIATES, INC. AS WALLABLE RECORD PLANS OBTAINED FROM THE TOWN OF FRANKLIN, MA AND OTHER SOURCES.
- VERTICAL DATUM IS NAVD88. EXISTING GRADE CONTOUR INTERVALS SHOWN AT 1 FOOT. PROPOSED GRADE CONTOUR INTERVALS SHOWN AT 1 FOOT.
- ALL CUT OR FILL SLOPES SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED. $\label{eq:control} % \begin{subarray}{ll} \end{subarray} % \begin{subarr$
- PIPE DIMENSIONS ARE MEASURED FROM THE INSIDE EDGE OF THE STRUCTURE.
- ROOF DRAIN LOCATIONS TO BE BASED ON FINAL BUILDING PLANS. CONNECTION POINTS SHALL BE AS SHOWN HEREON.
- IF ANY EXISTING STRUCTURES TO REMAIN ARE DAMAGED DURING CONSTRUCTION IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR AND/OR REPLACE THE EXISTING STRUCTURE AS NECESSARY TO RETURN IT TO EXISTING CONDITIONS OR BETTER.
- ALL STORM DRAIN MANHOLES IN PAVED AREAS SHALL BE FLUSH WITH PAVEMENT AND SHALL HAVE TRAFFIC BEARING RING & COVERS, H-20 MINIMUM.
- THE CONTRACTOR SHALL ADHERE TO ALL TERMS & CONDITIONS AS OUTLINED IN THE GENERAL N.P.D.E.S. PERMIT FOR STORMWATER DISCHARGE ASSOCIATED WITH CONSTRUCTION ACTIVITIES.
- CONTRACTOR SHALL ENSURE POSITIVE DRAINAGE AWAY FROM BUILDINGS FOR ALL NATURAL AND PAVED AREAS.
- ALL DRAINAGE SHALL CONFORM TO LOCAL REQUIREMENTS.
- 12. THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OR DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS
- 13. THE PROJECT RESULTS IN A NET EXPORT OF APPROXIMATELY 3,650 CUBIC YARDS OF MATERIAL. THIS VALUE DOES NOT INCLUDE EXCAVATION REQUIRED FOR BUILDING FOUNDATION, UTILITIES, OR STORMWATER INFRASTRUCTURE.
- 14. PRIOR TO CONSTRUCTION, ONE ADDITIONAL TEST PIT SHALL BE PERFORMED WITHIN THE FOOTPRINT OF THE PROPOSED INFILTRATION SYSTEM TO CONFIRM SEPARATION TO ESTIMATED SEASONAL HIGH GROUND WATER. THE TEST PIT SHALL BE OBSERVED BY THE ENGINEER OF RECORD.
- FLOOR DRAINS IN THE PROPOSED BUILDING ADDITION SHALL FLOW THROUGH A GAS TRAP PRIOR TO DISCHARGE TO THE MUNICIPAL SANITARY SYSTEM.
- 16. ALL WATERLINE WORK SHALL CONFORM TO THE MOST RECENT FRANKLIN DPW WATERLINE MATERIALS AND INSTALLATION STANDARDS.

GRAPHIC SCALE (IN FEET) 1 inch - 40



2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

PROJECT NO.	2712-02A	DATE:	02-21-2
SCALE:	1" - 40'	DWG. NAME:	C-2712-02
DESIGNED BY:	SM/JRG	CHECKED BY:	ВС



civil engineering + land surveying ironmental consulting + landscape architec www.allenmajor.com 100 COMMERCE WAY, SUITE 5 WOBURN MA 01801 TEL: (781) 935-6889 FAX: (781) 935-2896

WOBURN MA & LAKYVILL, MA & MANCHESTER, NITHE DRAWNING HAS BEEN REPRARED IN DIGITAL FORMAT.
CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE
REPROVIDED CORIS SO FORMANIOS AND SPECIFICATIONS FOR HIS/HER
INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE
POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED
UNINITERITIONALLY OR OTHERWISE, ALLEH & MAJOR ASSOCIATES, NIC. MAY REMOVE ALL INDICATION OF THE DOCUMENTS
AUTHORSHIP ON THE DIGITAL MEDIA, PRINTED REPRESENTATIONS OR
DOWNTRIED FOR THE DIGITAL MEDIA, PRINTED REPRESENTATIONS OR
DOWNTRIED FOR THE DIGITAL MEDIA, PRINTED REPRESENTATIONS OR
DOWNTRIED FOR SHALL BE THE GAILY RECORD CORES OF
AULIE A MAJOR ASSOCIATES, INC'S WORK PRODUCT
CORES OF
AULIE A MAJOR ASSOCIATES, INC'S WORK PRODUCT
OF THE PRINTED REPRESENTATIONS OF THE PROVINCE AND
AUGUST
AND THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROVINCE OF THE PROVINCE AND
THE PROVINCE OF THE PROV

GRADING & DRAINAGE PLAN | C-103

INFILTRATION SYSTEM PROTECTION NOTES

1. DO NOT TRAFFIC EXPOSED SOIL SURFACE WITH
CONSTRUCTION EQUIPMENT. IF FEASIBLE, PERFORM
EXCAVATIONS WITH EQUIPMENT POSTIONED OUTSIDE
THE LIMITS OF THE INFILTRATION SYSTEM.

DO NOT PLACE INFILTRATION SYSTEMS INTO SERVICE UNTIL THE CONTRIBUTING AREAS HAVE BEEN FULLY STABILIZED.

AFTER THE INFILTRATION SYSTEM AREA IS EXCAVATED TO THE FINAL DESIGN ELEVATION, THE FLOOR SHOULD BE DEEPLY ILLED WITH A ROTARY ILLER OR DISC HARROW TO RESTORE INFILTRATION RATES, FOLLOWED BY A PASS WITH A LEVELING DRAG.


INFILTRATION SYSTEM-1 (112) MC-3500 CHAMBERS FINISHED GRADE=292.00 (MIN) TOP OF STONE=290.50

CHAMBER INVERT=285.50 BOTTOM OF STONE=284.75

RIM=291.87

INV=287.16

2LF, 15"HDPE, S=5.00%




LIGHTING LEVEL SUMMARY							
AREA	UNITS	AVERAGE	MAX	MIN	AVG/MIN	MAX/MIN	
PAVEMENT AREA	Fc	0.26	4.1	0.0	N.A.	N.A.	

POLE LIGHT FIXTURE (LED)

BEACON LIGHTING - VIPER LUMINAIRE

WALL PACK LIGHT FIXTURE (LED)

HUBBELL LIGHTING INC, - RATIO WALL



20 00 00 00 00 00 00 00 01 01 02 02 04 08 08 10 12 13 13 12 12 11 10 07 08 03 02 03 05 08 14 23 22 24 28 33 20 00: 00 00 00 00 00 00 01 01 02 02 04 06 08 10 12 14 13 2 12 1.1 10 01 06 03 02 03 04 07 1.1 18 25 23 26 33 3 00 00 00 00 00 00 00 01 01 01 01 02 03 04 06 07 10 1.1 1.1 12 1.1 10 05 06 03 02 03 04 07 1.1 18 25 23 26 33 3

0.0 0.0 0.0

00 00 00 00 00 00 00 00 00 00 000 00 00 66180000 00 00 00 00 00 00 00 00 00 00 00 00 00 00 00

00 00 00 00 66'6 00 00 00 00 00 00 00 00 00 00 00 00 00 00 00 00

NOTES:


- 3. CONTROLS FOR ALL EXTERIOR LIGHTING BY BUILDING
- PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. IT'S INTENDED USE IS TO PROVIDE INFORMATION, ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OF DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS STRICTLY PROHIBITED.

GRAPHIC SCALE (IN FEET)

SINGLE POLE LIGHT WALL PACK LIGHT LIGHTING LEVELS GIVEN IN FOOT-CANDLES DOUBLE LUMINAIRE FIXTURE (AS PER PLAN) 00 00 00 00 00 00 00 00 08 08 00 00 00 00 00 00 00 00 00 00 00 00 00 00 0 00 00 00 00 00 00 00 00 00 00 00 60 00 2'-0" (MIN) TOP OF CONDUITS 200 00 00 00 co co co co co co co -5'-0" BELOW GROUND







LIGHTS WITHIN THE PARKING AREAS AND ACCESS DRIVES SHALL OPERATE ON A PHOTO-CELL & PROGRAMABLE TIMER.

LEGEND

0-

0.0 0.1 0.2 0.4 0.

-SINGLE LUMINAIRE FIXTURE

ANCHOR BOLTS FURNISHED BY THE ELECTRICAL CONTR. & INSTALLED BY GENERAL CONTR.

-1" CHAMFER AROUND BASE -FINISHED GRADE


-CONDUITS BY ELECTRICAL CONTR.

#3 TIES @ 12" O.C.

(AS PER PLAN) -5-INCH SQUARE STEEL LIGHT POLE 11 GUAGE COLOR: BLACK

- 4. WIRING OF BUILDING MOUNTED FIXTURES BY BUILDING CONTRACTOR.
- 5. THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE





PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

REV DATE DESCRIPTION

BELLINGHAM, MA 02019

24 WILLIAM WAY

ROJECT NO.

05-01-23 REVISION 3 PER REVIEW COMMEN

04-14-23 REVISION 2 PER DPW COMMENTS

04-04-23 REVISION 1 PER PEER REVIEW

TMC HOLDINGS & DEVELOPMENT 2, LLC

25 FORGE PARKWAY

FRANKLIN, MA

2712-02A DATE:



civil engineering + land surveying
onmental consulting + landscape archite
w w w . allen m ajor.com
100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 935-2899
FAX: (781) 935-2896

BURN, MA . LAKEVILLE, MA . MANCHESTER, I

IS DRAWING HAS BEEN PREPARED IN DIGITAL FORMA OTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODER INFORMATION MAY BE MODER INFORMATION MAY BE MODER INFORMATION OF THE DOCUMENT INFORMATION OF THE DOCUMENT INFORMATION OF THE DOCUMENT OF THE DOCUMENT OF THE DOCUMENT OF THE DRAWNINGS AND PROPER DESCRIPTIONS ISSUED SHALL BE THE ONLY EXCORT COPIES OF THE ORIGINAL RESERVENCES OF THE ORIGI


LIGHTING PLAN

C-104

02-21-23





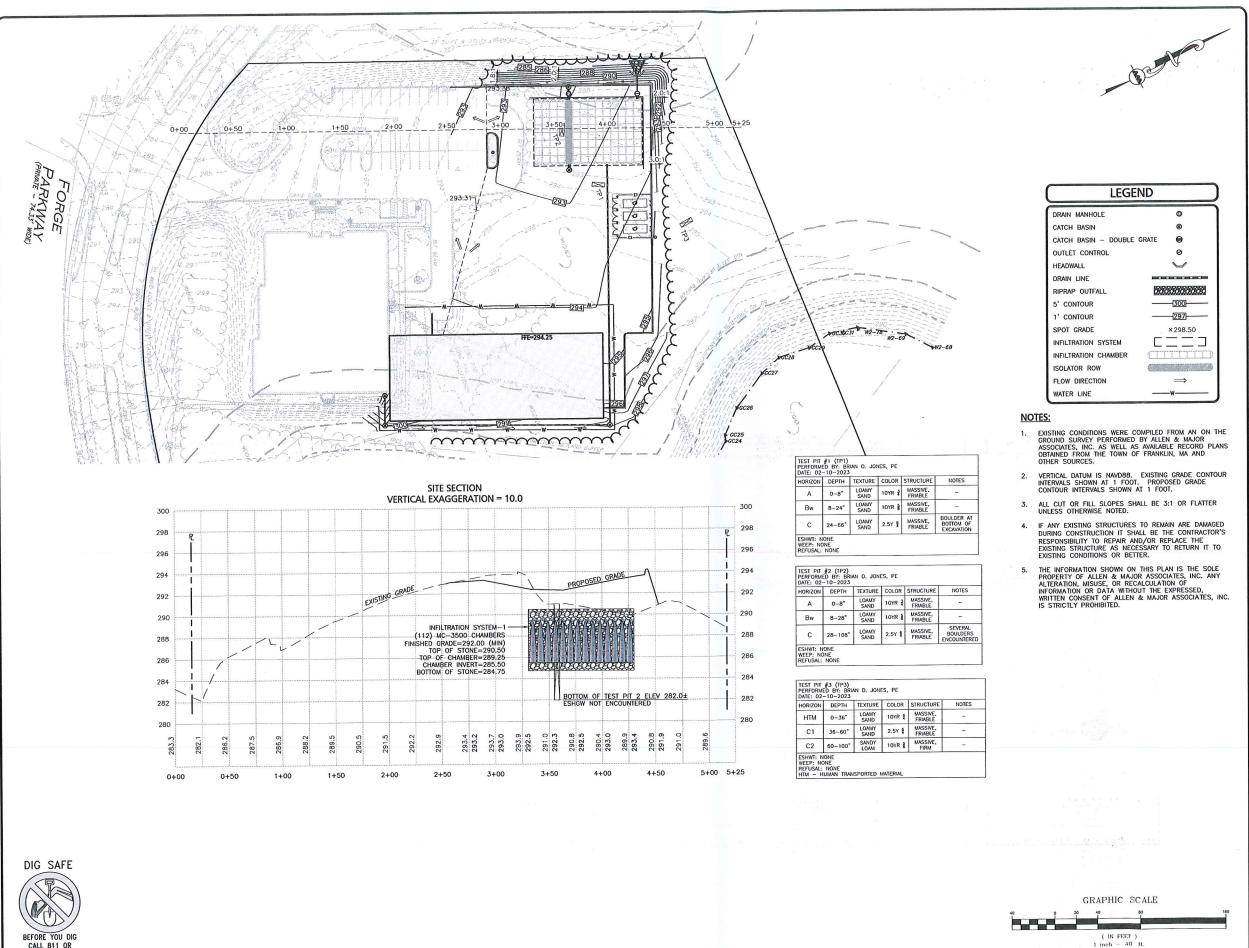



PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

02-21-23 ROJECT NO. 2712-02A DATE: SCALE 1" = 40' DWG, NAME: C-2712-02 ESIGNED BY: SM/JRG CHECKED BY:



civil engineering *land surveying onmental consulting *landscape architec w w w . a ll en m a j or . c o m 100 COMMERCE WAY, SUITE 5

WOBURN MA 01801
TEL: (781) 935-6889
FAX: (781) 935-2896

OBURN, MA . LAKEVILLE, MA . MANCHESTER,

WOULDIN, MA. * LAKEVITLI. MA. * SYNCHES LER. NI THIS DRAWMEN HAS BEEN PREPARED IN DIGITAL FORMAT PART BEEN PROVIDED CORE OF PARMINES AND SPECIFICATIONS FOR HIS/HE INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINTERTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES NIC. MAY REMOVE ALL RIGICATION OF THE DOCUMENTS AUTHORISE POTENTIAL THAT BE AND A PRINTED REPRESENTATIONS OF SECRECATIONS ISSUED SHALL BE THE ONLY RECORD CORE OF ALLEN & MAJOR ASSOCIATES IN THE PROVINCE OF TH


SITE PLAN & CROSS-SECTION Copyright ©2023 Allen & Major Associates, Inc All Rights Reserved

C-201

NOTES:

- 1. ALL MATERIALS TO MEET MANUFACTURERS SPECIFICATIONS.
- 2. INSTALL WOODEN STAKES IN A CRISS-CROSS PATTERN EVERY 8' ON CENTER.
- 2. OVERLAP TUBULAR BARRIER SEGMENTS A MINIMUM OF 12".
- THE CONTRACTOR SHALL MAINTAIN THE TUBULAR BARRIERS IN A FUNCTIONAL CONDITION AT ALL TIMES. THE CONTROLS SHALL BE ROUTINELY INSPECTED BY THE CONTRACTOR.
- 4. WHERE THE TUBULAR BARRIERS REQUIRE REPAIR OR SEDIMENT REMOVAL, IT WILL BE COMPLETED BY THE CONTRACTOR AT NO ADDITIONAL COST.
- 5. AT A MINIMUM, THE CONTRACTOR SHALL REMOVE SEDIMENTS COLLECTED AT THE BASE WHEN THEY REACH 1/3 THE EXPOSED HEIGHT OF THE BARRIER.

TUBULAR SEDIMENT BARRIEF

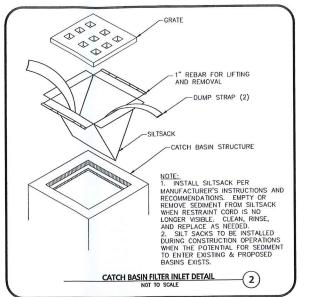

EROSION CONTROL BARRIER INSTALLED DOWN SLOPE OF PROPOSED STOCKPILE AREA PROPOSED STOCKPILE AREA PROVIDE DRAIN SWALE TO DIRECT WATER AWAY FROM PROPOSED STOCKPILE AREA

NOTES:

PROPOSED STOCKPILE AREA

1. SOIL AND FILL STOCKPILES EXPECTED TO REMAIN IN PLACE FOR LESS THAN

90 DAYS SHALL BE COVERED WITH STRAW AND MULCH (AT 100LBS/1,000 SF), OR

WITH AN ANCHORED TARP WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL

2. SOIL AND FILL STOCKPILES EXPECTED TO REMAIN IN PLACE FOR 90 DAYS OR

MORE SHALL BE SEEDED WITH WINTER RYE (FOR FALL SEEDING AT 1LB/1,000 SF)

OR OATS (FOR SUMMER SEEDING AT 2LB/1,000 SF) AND THEN COVERED WITH


STRAW MULCH (AT 100LB/1,000 SF) OR AN ANCHORED TARP WITHIN 7 DAYS OR

PRIOR TO ANY RAINFALL.

STOCKPILE PROTECTION DETAIL

NOT TO SCALE

DIVERSION RIDGE REQUIRED WHERE GRADE EXCEEDS 2% -2% OR GREATER ROADWAY SECTION A NOTES:
1. THE ENTRANCE SHALL BE MAINTAINED IN A
CONDITION THAT WILL PREVENT TRACKING OR
FLOWING OF SEDIMENT ONTO PUBLIC
RIGHT-OF-WAYS. THIS MAY REQUIRE TOP SPILLWAY DRESSING, REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. WATER SUPPLY TO WASH-2. WHEN NECESSARY, WHEELS SHALL BE CLEANED PRIOR TO ENTERING THE PUBLIC FLOW RIGHT-OF-WAY. 3. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED 2"-3" COURSE AGGREGATE MIN OF 6" THICK SEDIMENT TRAP OR SEDIMENT BASIN. 4. USE SANDBAGS, STRAW BALES, OR OTHER APPROVED METHODS TO CHANNELIZE RUNOFF TO BASIN AS REQUIRED. PLAN



NOTE: INCOMENTAL VIEW


1. SUPPLY SUPPLY SHALL BE FREE OF ROCKS, CLODS, STICKS AND GRASS.
FABRIC SHALL HAVE GOOD SOIL CONTACT.

2. APPLY PERMANENT SEDING BEFORE PLACING FABRIC.

3. LAY BLANKETS LOOSELY AND STAKE OR STAPLE TO MAINTAIN DIRECT CONTACT WITH THE SOIL. DO NOT STRETCH.

4. CHOOSE MATERIAL BASED ON SLOPE, SOILS, AND APPLICATION.

EROSION CONTROL FABRIC (5)



- ENGINEER'S RECOMMENDATIONS. IN THE ABSENCE OF A GEOTECHNICAL ENGINEER'S RECOMMENDATION, THE MATERIALS AND THICKNESS SHALL BE AS SHOWN HEREON.
- SUBGRADE SHALL BE COMPACTED TO 95% OF PROCTOR
- EXISTING SUBSURFACE SOILS SHALL BE PROOF-ROLLED.
- CLEANLY SAW CUT EXISTING PAVEMENT AND ENSURE A SMOOTH TRANSITION BETWEEN EXISTING AND PROPOSED PAVEMENT.

MATERIALS AND THICKNESSES:

- A = 1.5" ASPHALT CONCRETE SURFACE COURSE (M3.11.0, TABLE A, TOP COURSE)
 2.5" ASPHALT CONCRETE BINDER COURSE (M3.11.0, TABLE A, BINDER COURSE)
- B = 6" PROCESSED GRAVEL BASE (MHD M2.01.7)
- C = 12" BANK RUN GRAVEL MHD M1.03.0 TYPE B)

ASPHALT PAVEMENT SECTION
NOT TO SCALE -(6) 25 FORGE PARKWAY FRANKLIN, MA

PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

05-01-23 REVISION 3 PER REVIEW COMME

2 04-14-23 REVISION 2 PER DPW COMMENTS

TMC HOLDINGS & DEVELOPMENT 2, LLC

1 04-04-23 REVISION 1 PER PEER REVIEW

REV DATE DESCRIPTION PPLICANT\OWNER:

BELLINGHAM, MA 02019

24 WILLIAM WAY

PROJECT:

2712-02A DATE: AS SHOWN DWG. NAME: C-2712-02/ SM/JRG CHECKED BY:



100 COMMERCE WAY, SUITE 5 WOBURN MA 01801 TEL: (781) 935-6889 FAX: (781) 935-2896

OBURN, MA . LAKEVILLE, MA . MANCHESTER, N


THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT, CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HER NORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE DIGITAL MEDIA, PRINTER PRESENTATIONS OR PORTABLE DOCUMENT FORMAT OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

DRAWING TITLE:

Copyright ©2023 Allen & Major Associates,
All Rights Reserved


C-501 **DETAILS**


- SEE TYPICAL PAVEMENT DETAIL TACK COAT (MIN.) UNDISTURBED COMPACTED GRAVEL BASE

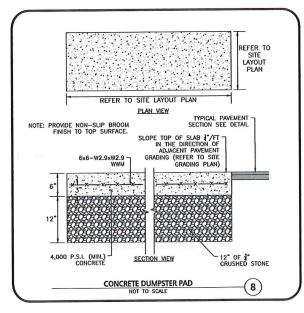



TEMPORARY CONSTRUCTION ENTRANCE

4



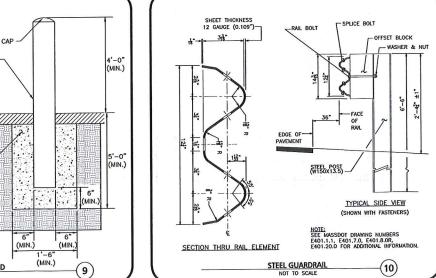



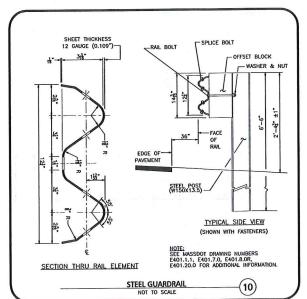

	MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS.
С	NITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER, NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145¹ A-1, A-2-4, A-3 07 07 AASHTO M43¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
В	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43¹ 3, 4	
Α	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43¹ 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}


- PLEASE NOTE:

 1. THE LISTED ASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4
 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (ASHTO MAS) STONE".

 2. STONEMEN COMPACIONS
 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (ASHTO MAS) STONE".

 2. STONEMEN COMPACIONS
 STONEMEN COMPACIONS
 STATEMENT OF THE FOR "A LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL
 STATEMENT OF THE STATEMENT SUFFRACES MAY BE COMPACIONS BY COMPACION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY PAKING
 OR BRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECUAL LOAD DESIGNS, CONTACT STORMERCH FOR COMPACTION REQUIREMENTS.

 4. NOCE LAKER "C' IS PLACED, ANY SOLL/MATERIAL CAN BE PLACED IN LAYRE "D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO
 REPLACE THE MATERIAL REQUIREMENTS OF LAYER "C' OR "D' AT THE SITE DESIGN ENGINEERS"S DISCRETION.

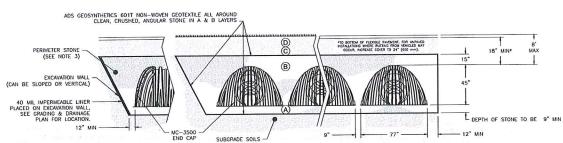

NOTES:

- 1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F241B, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
- MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATEL COLLECTION CHAMBERS".

- COLLECTION CHAMBERS*.

 3. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.

 4. REQUIREMENTS FOR HANDLING AND INSTALLATION:

 TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.

 TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3J.

 TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, 3) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR FOUND. EDURY-F1/%. NO b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

MC-3500 - CROSS SECTION DETAIL

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

- 2. CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
- 4. CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- 5. THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE ASSHTO LEFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION EDAD LOADS AND 2) SHORT-DURATION LEVE LOADS, BASED ON THE ASSHTO DESIGN TRUCK WITH CONSIDERATION FOR MAPPLAT AND MULTIPLE FRESENCES.
- CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOU (1 MR) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
- REQUIREMENTS FOR HANDLING AND INSTALLATION:

 TO LAMINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.

 TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 37.

 TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, o) THE ARCH SHIFTNESS CONSTANT SHALL BE GREATER THAN OR EQUAL TO 450
 LISS/FT/X. THE ASC IS DEFINED IN SECTION 6.2.8 OF ASTIM F2418. AND b) TO RESIST CHAMBER OFFORWATION DURING INSTALLATION AT ELEVATED
 TEMPERATURES (ABOVE 73' F / 23' C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
- 8. ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELYERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:

 * IN STRUCTURAL EVALUATION SHALL BE STATED BY A REGISTERED PROFESSIONAL ENGINEER.

 * INE STRUCTURAL EVALUATION SHALL DEMONSTRAIE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIKE LOAD, THE MIRRIUM REQUIRED BY ASTIM F2787 AND BY SECTIONS 3 AND 12.12 OF THE ASHTO LAFD BRIDGE DESIGN SPECIFICATIONS FOR THE MEROPLASTIC PIPE.


 * THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.

- 9. CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.




STORMTECH MC-3500 CHAMBER SYSTEM NOT TO SCALE






INSPECTION PORTS MAY BE CONNECTED THROUGH ANY CHAMBER CORRUGATION VALLEY.


4" PVC INSPECTION PORT

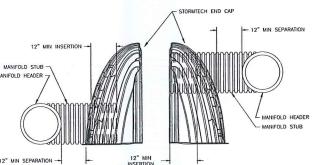

END CAP INSERTION DETAIL NOT TO SCALE

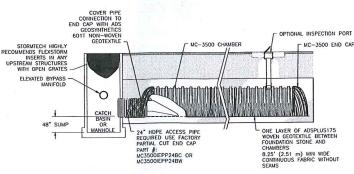

MC-3500 - ISOLATOR ROW PLUS DETAIL

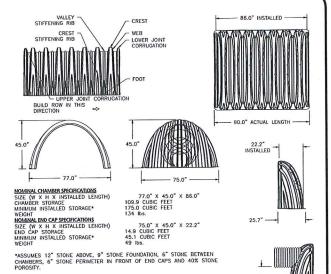

PARTIAL CUT HOLES AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B" PARTIAL CUT HOLES AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T" END CAPS WITH A PREFABRICATED WELDES TUB END WITH "W" END CAPS WITH A WELDED CROWN PLATE END WITH "C"

PART#	STUB	В	С	_ c
MC3500IEPP06T	6" (150 mm)	33.21" (844 mm)		+ 00000 081111411
MC3500IEPP06B	, ,		0.66" (17 mm)	CUSTOM PARTIAL CUT INVERTS
MC3500IEPP08T	8" (200 mm)	31.16" (791 mm)		ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24"
MC3500IEPP08B	,		0.81" (21 mm)	(300-600 mm) SIZE ON SIZ
MC3500IEPP10T	10" (250 mm)	29.04" (738 mm)		AND 15-48" (375-1200 mm ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS O
MC3500IEPP10B	1	79	0.93" (24 mm)	THE MC-3500 END CAP CUT IN THE FIELD ARE NOT
MC3500IEPP12T	12" (300 mm)	26.36" (670 mm)	10 100 110 110 110 110 110 110 110 110	RECOMMENDED FOR PIPE SIZES GREATER THAN 10"
MC3500IEPP12B			1.35" (34 mm)	(250 mm). THE INVERT LOCATION IN COLUMN 'B' ARE
MC3500IEPP15T	15" (375 mm)	23.39" (594 mm)		THE HIGHEST POSSIBLE FOR THE PIPE SIZE.
MC3500IEPP15B			1.50" (38 mm)	
MC3500IEPP18TC		20.03" (509		
MC3500IEPP18TW	18" (450 mm)	mm)		
MC3500IEPP18BC	10 (100 11111)		1.77" (45 mm)	
MC3500IEPP18BW	j w ii	1.50	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	
MC3500IEPP24TC		14.48" (368		
MC3500IEPP24TW	24" (600 mm)	mm)		
MC3500IEPP24BC	24 (600 mm)		2.06" (52 mm)	1
MC3500IEPP24BW			2.00 (02 11111)	
MC3500IEPP30BC	30" (750 mm)		2.75" (70 mm)	

TECHNICAL SPECIFICATIONS

INSPECTION & MAINTENANCE

- INSPECTION & MAINTENANCE

 STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT

 A. INSPECTION PORTS (IF PRESENT)

 A.1. REMOVE/OPEN CON INSPECTION PLAST INLINE DRAIN

 A.2. REMOVE/OPEN CON INSPECTION FLISTER IF INSTALLED

 A.3. USING A FLASHLIGHT AND STADA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON

 MAINTENANCE LOG

 IT. A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT

 LEVELS (OPHIONAL)

 A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO

 B. ALL ENDING COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS

 B. ALL STAD PLUS ROWS

 B. ALL SEDIMENT OF A STAD PLUS ROWS

 B. ALL STAD PLUS ROWS

 B. STAD PLUS ROWS OF CAMERAS MAY BE USED TO AVOID A CONTHENE SPACE ENTRY

 B) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONTHENE SPACE ENTRY

 B) FSEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO

 STEP 3. AND AND AND AND AND AND AND AND PROCEED TO STEP 2. IF NOT, PROCEED TO
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
 A. A PIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 B. APPLY WILLTPLE PASSES OF JETVÁC UNTIL BACKFLUSH WATER IS CLEAN
 C. VACUOUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

- INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
- CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.



PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

_	05-01-23	REVISION 3 PER REVIEW COMMEN
3		Notice of the second
2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

02-21-23 PROJECT NO. 2712-02A DATE: AS SHOWN DWG. NAME: C-2712-02 SCALE: SM/JRG CHECKED BY DESIGNED BY:





civil engineering + land surveying onmental consulting + land surveying www.allenmajor.com
100 COMMERCE WAY, SUITE 5
WODLURN MA 01801
TEL (781) 935-6889
FAX: (781) 935-2896

BURN, MA . LAKEVILLE, MA . MANCHESTER,

THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMA' CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY B CLIENT/CLIENTS REPRESENTATIVE OR CONSULTANTS MAY I PROVIDED COPIES OF DRAWNINGS AND SPECIFICATIONS FOR HIS/HIS INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIE UNINTERMICALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATE INFORMATION OF THE PROJECT OF THE DOCUMENT AUTHORISE ON THE PROJECT OF THE DRAWNINGS AN SPECIFICATION ISSUED SHALL BE THE ONLY RECORDS OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

DRAWING TITLE: C-502 DETAILS

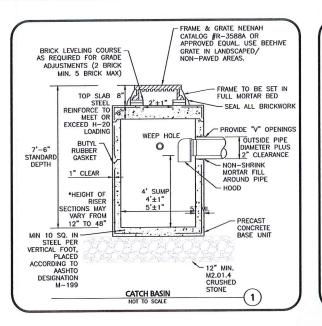



PLAN VIEW

ELEVATION B-8

4' DIAMETER OUTLET CONTROL STRUCTURE

WEIR CREST

- INV.=286.50(OL

- 12" CRUSHED

(6)

24" Ø MANHOLE FRAME &

COVER TO BE NEENAH FOUNDARY R-1720-A, H-20

LOADING (OR APPROVED EQUAL

STONE (M2.02.1)

WEIR CREST ELEV,=289.60

24" HDPE INLET INV.=286.71


8" HDPE OUTLET INV.=286.50


NOTES:


ELEVATION A-A


COVER TO BE LETTERED

"DRAIN" (3" HIGH)

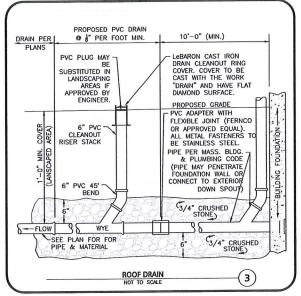



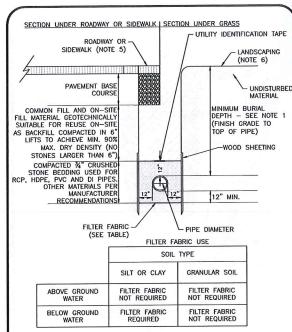



- PRESSURE FIFE BENEATH DIFFARED = 5
 WHERE BACKFILL IS DESIGNATED AS COMPACTED, THIS MEANS 90 TO 95%
 STANDARD PROCTOR, AASHTO T-99. ALL FILL PLACED BELOW PIPES AND
 STRUCTURES MUST MEET THIS REQUIREMENT.
 TRENCHES WITHIN PUBLIC RIGHT OF WAY MAY REQUIRE FLOWABLE FILL.
- TRENCHES WITHIN PUBLIC RIGHT OF WAY MAT REQUIRE FLUWBLE. FILL.
 VERIFY WITH MUNICIPAL ENGINEER.
 WHERE WASTE FILLS ARE ENCOUNTERED AT SUBGRADE LEVEL FOR NEW
 UTILITIES, THE FILL SHOULD BE OVER-EXCAVATED, THE SUBGRADE SHOULD
 BE RE-COMPACTED, AND BACKFILL CONSISTING OF PIPE BEDDING MATERIAL
 CRUSHED STONE OR OTHER SUITABLE GRANULAR FILL SHOULD BE PLACED
 TO A SUFFICIENT DEPTH TO CREATE A FIRM AND STABLE SUBGRADE
- TO A SUFFICIENT DEPTH TO CREATE A FIRM AND STABLE SUBGRADE (TYPICALLY 12 TO 18 INCHES OVER-EXCAVATION).

 REFER TO PAVING, CURBS, WALKS AND DRIVEWAY DETAILS.


 REFER TO LANDSCAPING DETAILS.


 SHEETING, WHEN REQUIRED, TO BE CUT OFF AT LEAST 5' BELOW STREET AND A MINIMUM OF 1' ABOVE TOP OF PIPE. WOOD SHEETING DRIVEN BELOW MID-DIAMETER OF THE PIPE SHALL BE LEFT IN PLACE. STEEL SHEETING DRIVEN BELOW MID-DIAMETER MAY BE WITHDRAWN IF APPROVED IN WRITING BY THE ENGINEER. FOR PVC PIPE ALL SHEETING DRIVEN BELOW MID-DIAMETER SHALL BE LEFT IN PLACE.


 WHEN APPROVED BY THE ENGINEER FOR PIPES OTHER THAN PVC, SELECTED CRAYF, FILL MATERIAL MAY BE USED FROM MID-DIAMETER OF PIPE TO 12"
- GRAVEL FILL MATERIAL MAY BE USED FROM MID-DIAMETER OF PIPE TO 12"
 ABOVE TOP OF PIPE. NO STONES LARGER THAN 2" IN ANY DIMENSION WILL
 BE PERMITTED IN THIS AREA MASSDOT MATERIAL STANDARD M1.03.0 TYPE
- C. PROVIDE AT LEAST ONE IMPERVIOUS DAM IN GRAVEL BEDDING BETWEEN EACH MANHOLE WHERE DIRECTED, OR EVERY 300 FT, WHICHEVER IS LESS. BEDDING MATERIAL FOR PVC PIPE SHALL MEET THE REQUIREMENTS OF ASTM D2321 CLASS I OR CLASS II EMBEDMENT MATERIALS.

(5)

NOT TO SCALE

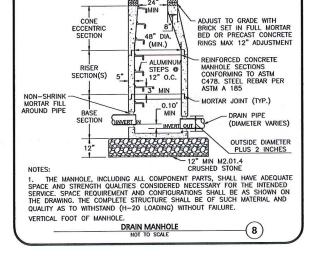

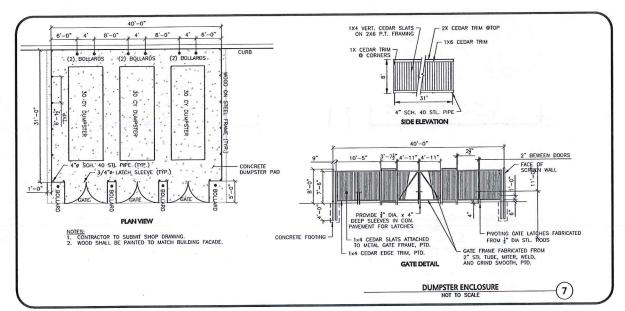

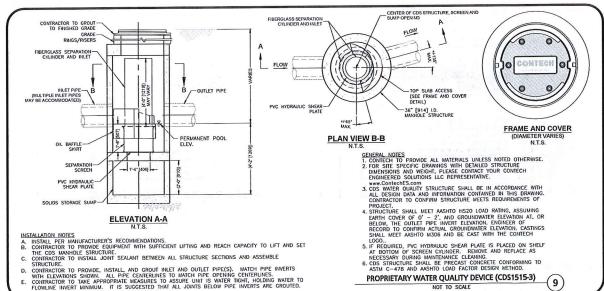



	04-14-23 04-04-23 DATE	REVISION 2 PER DPW COMMENTS REVISION 1 PER PEER REVIEW DESCRIPTION
		THE THE TENER OF T
2 (14-14-23	KEVISION 2 PER DPW COMMENTS
		DELECTION OF DED DENI COMMENTS
3 (5-01-23	REVISION 3 PER REVIEW COMMENTS

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

PROJECT NO.	2712-02A	DATE:	02-21-23
SCALE:	AS SHOWN	DWG. NAME:	C-2712-02A
DESIGNED BY:	SM/JRG	CHECKED BY:	BDJ




civil engineering + land surveying ronmental consulting + landscape archite www.allenmajor.com ww.allenmajor.com
100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 935-6889
FAX: (781) 935-2896

BURN, MA . LAKEVII.LE, MA . MANCHESTER,

HIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT JENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE CILENT/CIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE RROWDED CORES OF DRAWINGS AND S'ECCIFICATIONS FOR HIS/HEI INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT, DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED JUNITEMITIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, NC. MAY REMOVE ALL INDICATION OF THE DOCUMENTS AUTHORISH PON THE DIGITAL MEDIA. PRINTED REPRESENTATIONS OR ORNABLE DOCUMENT FORMATION STATE OF THE PROSPECTION OF SORT LEUCH AND AND AND THE CONTROL RECORD CORES OF VILLEN AND AND AND AND THE CONTROL RECORD CORES OF VILLEN AND AND ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No. C-503 DETAILS

- ALL TREES SHALL HAVE THE SAME RELATIONSHIP TO FINISH GRADE AFTER PLANTING AS THEY HAD AT THE ORIGINAL NURSERY SETTING. ROOT FLARE SHALL BE 2" ABOVE FINISH GRADE. REMOVE SOIL FROM TRUNK FLARE OF TREE TO DETERMINE ACTUAL ROOTBALL AREA.
- 2. BACKFILL WITH PLANTING MIX. PLANT MIX TO BE: 50% NATIVE TOPSOIL 20% COMPOST (LEAVES & ORGANIC MATERIAL, NO ASH) 20% PEAT MOSS, 10% SAND.
- 3. ADD MYCORRHIZA SOIL ADDITIVES AND SLOW RELEASE FERTILIZER WHEN PLANT HOLES ARE 50% FILLED AND WATER THOROUGHLY AT



DECIDUOUS TREE PLANTING DETAIL

LOAM AND SEEDING NOTES:

CONTRACTOR SHALL SEED ALL DISTURBED AREAS NOT NOTED TO RECEIVE OTHER MATERIALS, AND AT AREAS SHOWN ON THE PLAN PER SPECIFICATIONS

FESTUCA RUBRA "RUBRA" PAO PRAENTENSIS BARON KENTUCKY 40% BARON" BARON KENTUCKY 40% BLUEGRASS LOLIUM PERENNE "PALMER" PALMER PERENNIAL 15% PALMER" FESTUCA RUBRA MILMA CHEWINGS 8% 95% 90% 90%	SCIENTIFIC NAME	COMMON NAME	PROPORTION BY WEIGHT	PERCENT PURITY	PERCENT GERMINATIO
"BARON" BLUEGRASS LOLIUM PERENNE "PALMER PERENNIAL 15% "95% "90% "PALMER" 95% "90% "80% "95% "80% "95% "80% "80% "95% "80% "80% "95% "80% "80% "95% "80% "80% "80% "95% "80% "80% "80% "80% "80% "80% "80% "80			37%	95%	90%
"PALMER" RYEGRASS FESTUCA RUBRA WILMA CHEWINGS 8% 95% 80%			40%	85%	90%
			15%	95%	90%
		WLMA CHEWNGS	8%	95%	80%

1. SEED TO BE SPREAD AT MINIMUM RATE OF 5 LBS. PER 1000 SQ. FT.
2. SEEDING TO BE COMPLETED "IN SEASON" BETWEEN APRIL 1 TO JUNE 15 OR AUGUST 15 TO OCTOBER 1, EXCEPT FOR RESEDING OF BARE SPOTS.
IF UNABLE TO SEED WITHIN THESE TIMEFRAMES, CONTRACTOR TO INSTALL EROSION CONTROL MATS ON ALL SLOPES 3:1 AND OVER, HYDROSEED ALL EXPOSED AREAS, ADD SOIL STABILIZER "FLUX TERRA HP—FGM SOIL STABILIZER" AS MANUFACTURED BY "PROFILE" TO HYDROSEED (AT RATE

ALL EXPOSED AREAS, ADD SOIL STABILIZER "FLUX TERRA HP-FGM SOIL STABILIZER" AS MANUFACTURED BY "PROFILE" TO HYDROSED (AT RATE OF 3.000 LBS PER ACRE). AT NO ADDITIONAL COST TO THE OWNER. CONTRACTOR COMPLETE ALL ABOVE "OUT OF SEASON" REQUIREMENTS AND THEN ALSO BE RESPONSIBLE FOR RE-GRADING AND RE-SEEDING ALL DISTURBED, ERODED, OR BARE SPOTS WITHIN NEXT CLOSEST PLANTING SEASON IN FALL OR SPRING AT NO ADDITIONAL COST TO WITHER. CONTRACTOR RESPONSIBLE FOR ALL MANTENANCE UNTIL FINAL ACCEPTANCE OF LAWN AREAS INCLUDING: WATERING, ADDING FERTILIZERS AND LIME AND MOWING AT NO ADDITIONAL COST TO OWNER.


3. COMMERCIAL FERTILIZER SHALL BE APPLIED AT THE RATE OF 25 POUNDS PER 1000 SQ. FT. OR AS RECOMMENDED BY THE TESTING AGENCY.

LIME TO BE SPREAD AT THE RATE OF 100 POUNDS PER 1000 SQ. FT. OR AS RECOMMENDED BY THE TESTING AGENCY.

CHARLES OF A COMPLETE FERTILIZER CONTAINING AT LEAST 50% OF THE NITROGEN OF WHICH IS DERIVED FROM NATURAL ORGANIZE SOURCES OF UREAFORM. IT SHALL CONTAIN THE FOLLOWING PERCENTAGES BY WEIGHT. NITROGEN (N) 10%, PHOSPHORUS (P) 6%, POTASH (K) 4%. LIME SHALL BE AN APPROVED AGRICULTURAL LIMESTONE CONTAINING NOT LESS THAN 85% OF TOTAL CARBONATES. LIMESTONE SHALL BE GROUND TO SUCH FINENSS THAT 50% WILL PASS A 1000 MESH SIEVE AND 90% WILL PASS THROUGH A 20 MESH SIEVE.

4. LAWN AREAS TO BE SEEDED BY SOWING EVENLY WITH AN APPROVED MECHANICAL SEEDER AT THE RATE OF TEN POUNDS PER 1000 SQUARE FEET.

5. CONTRACTOR RESPONSIBLE FOR WATERING, MOWING, AND RESEEDING OF LAWN BARE SPOTS UNTIL A UNIFORM, HEALTHY STAND OF GRASS IS ESTABLISHED AND ACCEPTED.



 $\begin{array}{ll} \underline{\text{NOTES:}} \\ 1. & \text{TOP OF LOAM (TOPSOIL) IS FINISH GRADE.} \end{array}$

- 2. ALL TOPSOIL (BOTH ONSITE AND OFFSITE SOURCES) SHALL BE COMPOSED OF A NATURAL, FERTILE, FRIABLE SOIL TYPICAL OF CULTIVATED TOPSOILS OF THE LOCALITY. OFFSITE SOIL SHALL BE SUITABLE FOR THE GERMINATION OF SEEDS AND SUPPORT OF VEGETATIVE GROWTH, WITH ADDITIVES, IF REQUIRED, TO ACHIEVE PARTICLE DISTRIBUTION AND ORGANIC CONTENT BELOW. TOPSOIL SHALL BE TAKEN FROM A WELL-DRAINED, ARIABLE SITE, FREE OF SUBSOIL, LARGE STONES, EARTH CLODS, STICKS, STUMPS, CLAY LUMPS, ROOTS, OTHER OBJECTIONABLE, EXTRANEOUS MATTER OR DEBRIS NOR CONTAIN TOXIC SUBSTANCES. DEBRIS NOR CONTAIN TOXIC SUBSTANCES.
- 3. THE CONTRACTOR SHALL PROVIDE THE OWNER / LANDSCAPE ARCHITECT WITH TOPSOIL TEST RESULTS (RECOMMEND UMASS ARCHITECT WITH TOPSOIL TEST RESULTS (RECOMMEND UMASS MAHERST SOIL TESTING LAB) FOR APPROVAL PRIOR TO OBTAINING AND PLACING THE SOIL. IF ANY TOPSOIL IS PURCHASED OR PLACED PROTOR TO APPROVAL BY OWNER / LANDSCAPE ARCHITECT, IT IS AT CONTRACTORS RISK, AND IT CAN BE REMOVED AT NO ADDITIONAL COST TO THE OWNER. IF THE PLANTING SOIL (BOTH ONSITE AND OFFSITE SOURCES) DOES NOT FALL WITHIN THE REQUIRED SIEVE ANALYSIS, TEXTURAL CLASS, ORGANIC CONTENT, OR PH RANGE, IT SHALL BE ADJUSTED TO MEET THE SPECIFICATIONS THROUGH THE ADDITION OF SAND, COMPOST, LIMESTONE, OR ALUMINUM SULFATE TO BRING IT WITHIN THE SPECIFIED LIMITS AT NO ADDITIONAL COST TO THE OWNER.
- TOPSOIL SHALL HAVE A PH VALUE BETWEEN 5.5 AND 6.5. TOPSOIL SHALL CONTAIN BETWEEN 4% AND 8% ORGANIC MATTER OF TOTAL DRY WEIGHT AND SHALL CONFORM TO THE FOLLOWING GRADATION AND TEXTURE CLASS ABOVE.

(2)

TOPSOIL FOR LAWN, TREES, SHRUBS, & PERENNIALS

SEED MIX:

NEW ENGLAND WETLAND PLANTS
820 WEST STREET, AMHERST, MA 01002
PHONE: 413-548-8000 FAX 413-549-4000
EMAIL: INFO@NEWP.COM WEB ADDRESS: WWW.NEWP.COM

NEW ENGLAND EROSION CONTROL/RESTORATION MIX FOR DRY SITES


BOTANICAL NAME	COMMON NAME	WETLAND INDICATO
ELYMUS CANADENSIS	CANADA WILD RYE	FACU+
FESTUCA RUBRA	RED FESCUE	FACU
LOLIUM MULTIFLORUM	ANNUAL RYEGRASS	
LOLIUM PERENNE	PERRENIAL RYEGRASS	
PANICUM VIRGATUM	SWITCH GRASS	FAC
SORGHASTRUM NUTANS	INDIAN GRASS	UPL
SCHIZACHYRIUM SCOPARIUM	LITTLE BLUESTEM	FACU
AGROSTIS PERENNANS	UPLAND BENTGRASS	FACU


THE NEW ENGLAND EROSION CONTROL/RESTORATION MIX FOR DRY SITES PROVIDES AN APPROPRIATE SELECTION OF NATIVE AND NATURALIZED GRASSES TO ENURE THAT DRY AND RECENTLY DISTURBED SITES WILL BE QUICKLY REVEGETATED AND THE SOIL SURFACE STABILIZED. IT IS AN APPROPRIATE SEED MIX FOR ROAD CUTS, PIPELINES, STEEPER SLOPES, AND AREAS REQUIRING FOR ROAD CUTS, PIPELINES, STEEPER SLOPES, AND AREAS REQUIRING FOR COVER DURING THE ECOLOGICAL RESTORATION PROCESS. THE MIX MAY BE APPLIED BY HYDRO-SEEDING, BY MECHANICAL SPREADER, OR ON SMALL SITES IT CAN BE SPREAD BY HAND. LIGHTLY RAKE, OR ROLL TO ENSURE PROPER SOIL—SEED CONTACT. BEST RESULTS ARE OBTAINED WITH A SPRING OR LATE SUMMER SEEDING. LATE SPRING THROUGH MID—SUMMER SEEDING WILL BENEFIT FROM A LIGHT MULCHING OF WEED—FREE STRAY OF CONSERVE MOISTURE. IF CONDITIONS ARE DRIER THAN USUAL, WATERING WILL BE REQUIRED. FERTILIZATION IS NOT

REQUIRED UNLESS THE SOILS ARE PARTICULARLY INFERTILE. PREPARATION OF A CLEAN WEED FREE SEED BED IS NECESSARY FOR OPTIMAL RESULTS.

APPLY: 35 LBS/ACRE :1250 SQ FT/LB

EROSION CONTROL BLANKET FOR SLOPES SEE LANDSCAPE NOTES







PROFESSIONAL LANDSCAPE ARCHITECT FOR ALLEN & MAJOR ASSOCIATES, INC.

H			
t			
L	3	05-01-23	REVISION 3 PER REVIEW COMMENT
ı	2	04-14-23	REVISION 2 PER DPW COMMENTS
	1	04-04-23	REVISION 1 PER PEER REVIEW
	REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

PROJECT NO.	2712-02A	DATE:	02-21-2
SCALE:	AS SHOWN	DWG. NAME:	L-2712-02/
DESIGNED BY:	BCD	CHECKED BY:	BD




civil engineering + land surveying nmental consulting + landscape archi www.allenmajor.com 100 COMMERCE WAY, SUITE 5 WOBURN MA 01801 TEL: (781) 935-6889 FAX: (781) 935-2896

OBURN, MA . LAKEVILLE, MA . MANCHESTER, N

WOBURN, MA & LAREVILLE, MA & MANCHESTER, MI THIS DRAWM, HAS BEEN PREPARED IN DIGITAL FORMAT. CLIENT/CLIENTS REPRESENTATIVE OR CONSULTANTS MAY BE PROVIDED COPIES OF DRAWMOS AND SPECIFICATIONS FOR HIS/HER INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT, DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINITERMINALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENTS AUTHORSHIP ON THE DIGITAL MEDIA PRINTED BERFESSHITATIONS OR POSCIFICATION SSUED SHALLE THE ONLY EXCORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

ANDSCAPE NOTES & DETAILS L-501



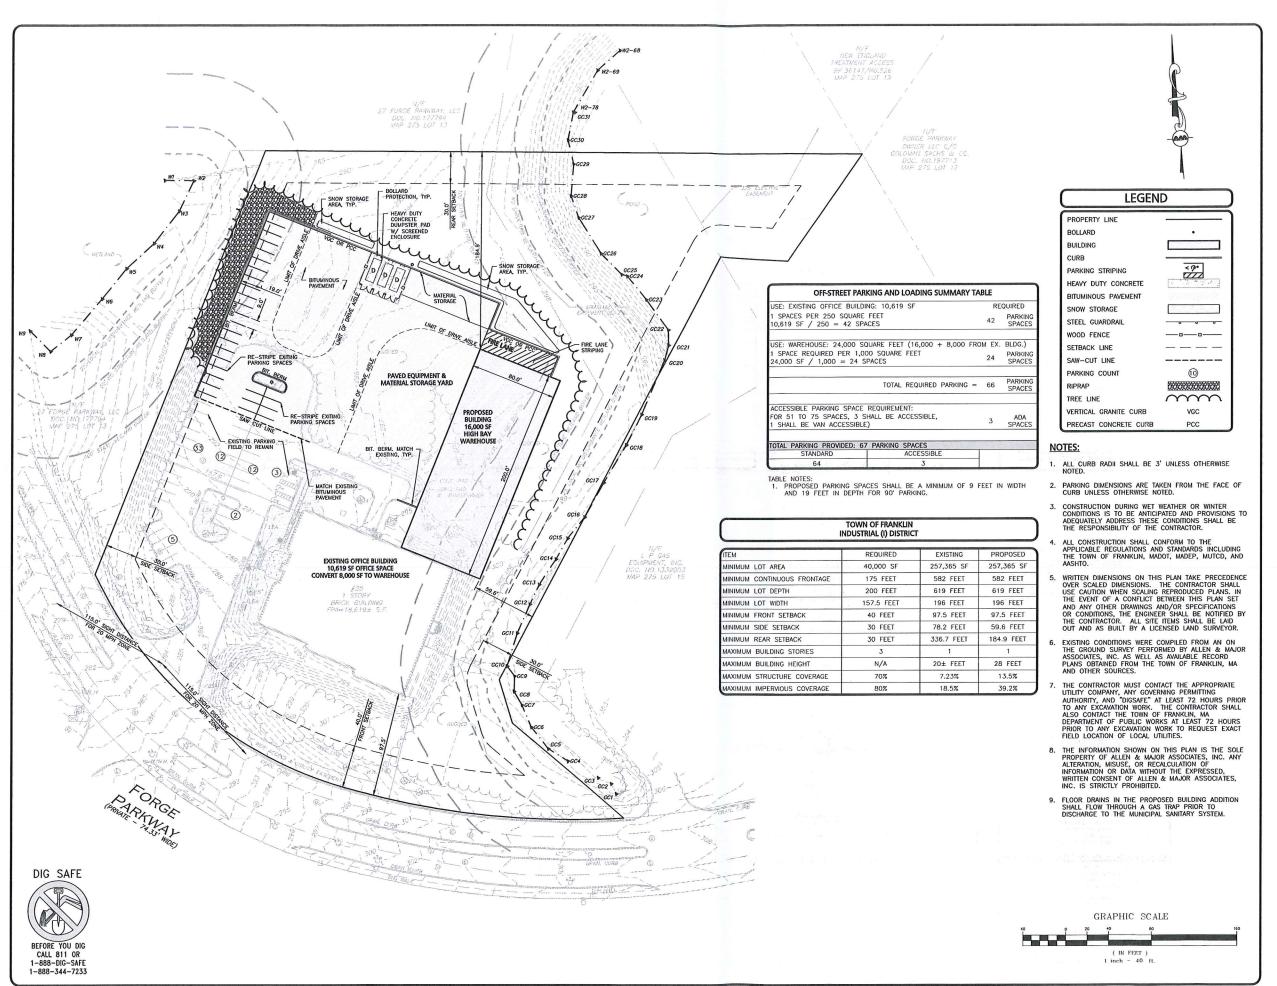



	T	
2	04-14-23	REVISION 2 PER DPW COMMENTS
1	04-04-23	REVISION 1 PER PEER REVIEW
REV	DATE	DESCRIPTION

TMC HOLDINGS & DEVELOPMENT 2, LLC 24 WILLIAM WAY BELLINGHAM, MA 02019

25 FORGE PARKWAY FRANKLIN, MA

2712-02A	DATE:	02-21-23	
1" - 40'	DWG. NAME:	C-2712-02A	
SM/JRG	CHECKED BY:	BDJ	
	1" - 40'	2712-02A DATE: 1" = 40' DWG, NAME: SM/JRG CHECKED BY:	



civil engineering + land surveying onmental consulting + landscape archite www.allenmajor.com 100 COMMERCE WAY, SUITE 5 WOBURN MA 01801 TEL: (781) 935-6889 FAX: (781) 935-2896

OBURN, MA . LAKEVILLE, MA . MANCHESTER, N

THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT.
CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANTS MAY BE
PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HER
INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE
OTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED
UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES,
INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S
ADMINISTRY OF THE DISCUSSION OF THE DOCUMENT'S
ADMINISTRY OF THE DISCUSSION OF THE DOCUMENT'S
OF THE DISCUSSION OF THE DISCUSSION OF THE DOCUMENT'S
OF THE DISCUSSION OF T

C-102 LAYOUT & MATERIALS PLAN

Copyright ©2023 Allen & Major Associates, Inc. All Rights Reserved